

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923261

Luminaire Tested: DFN2DIP-SQ4F0-120D090US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923261
REPORT IS A COMBINATION OF REPORTS P901645 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-120D090US940-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18538.7 lumens
Efficiency: N/A
Efficacy: 100.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 184.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLLONL

Luminous Intensity Polar Plot

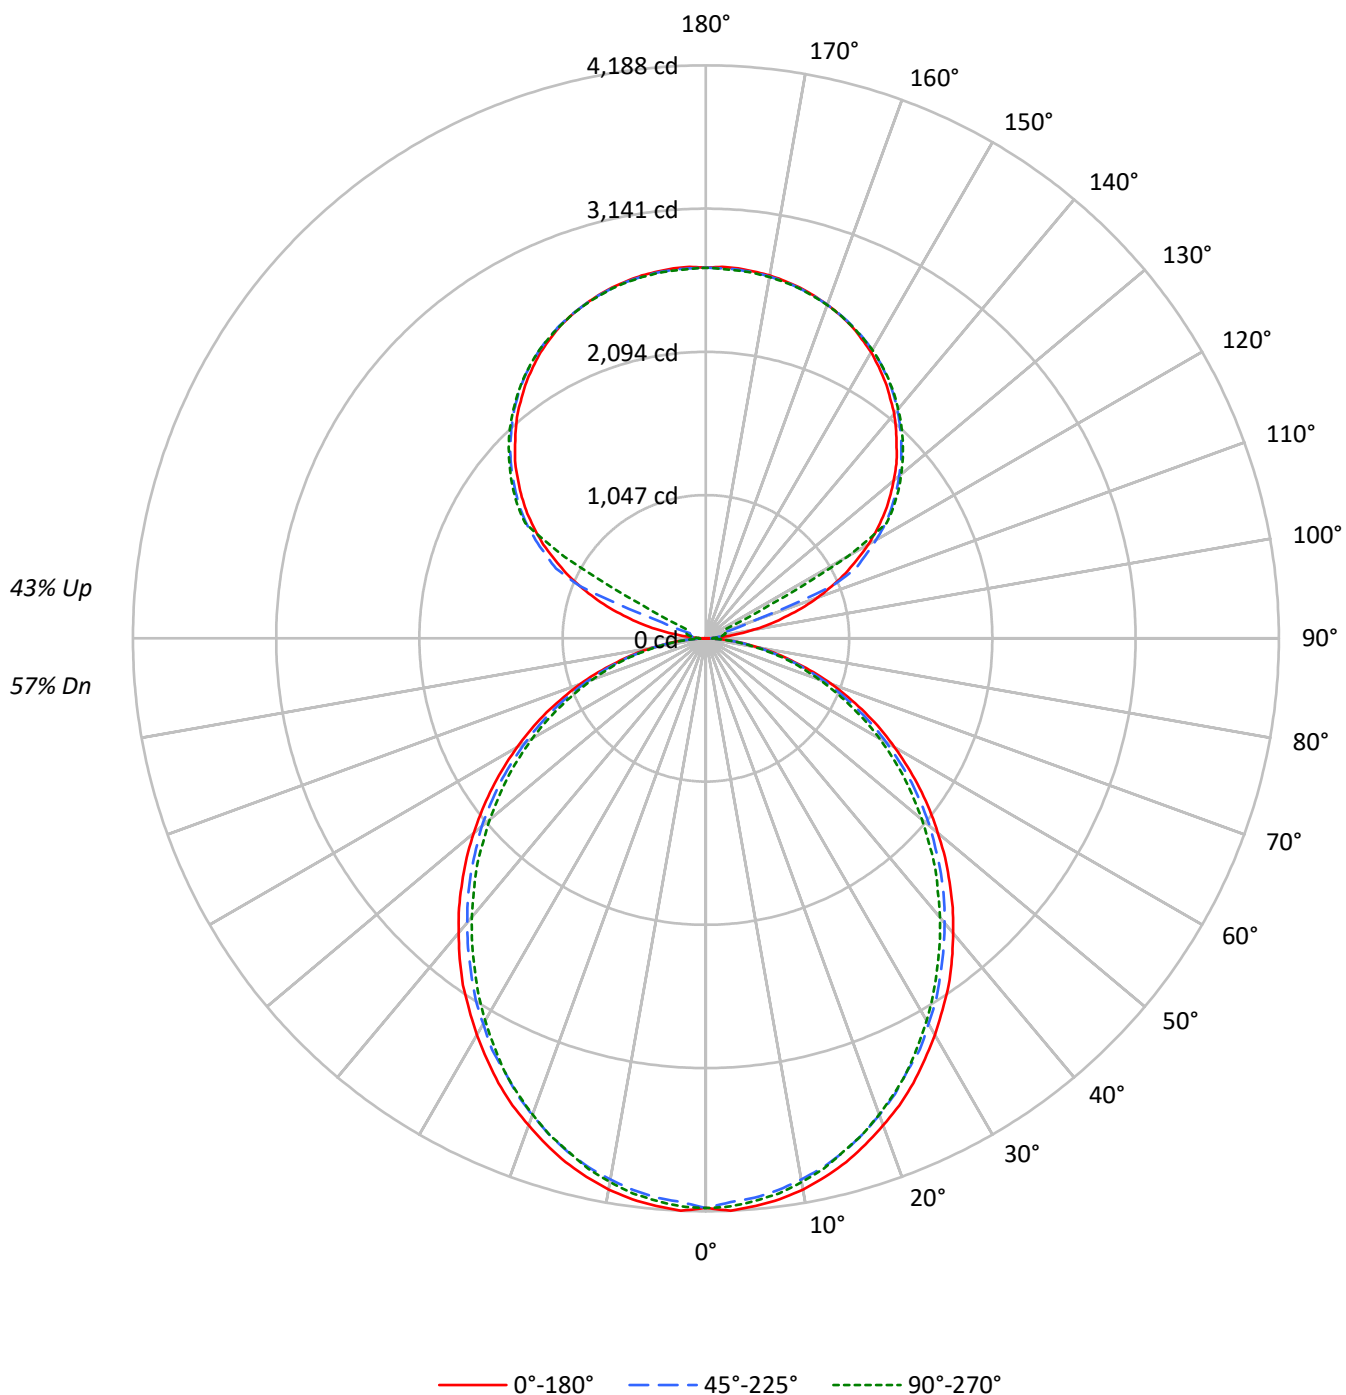

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2922	2922	2922
5°	2926	2881	2901
10°	2902	2843	2863
15°	2860	2797	2802
20°	2802	2733	2740
25°	2745	2655	2668
30°	2673	2583	2577
35°	2604	2499	2480
40°	2521	2413	2388
45°	2437	2327	2294
50°	2345	2237	2184
55°	2250	2133	2084
60°	2141	2010	1969
65°	2023	1882	1834
70°	1873	1726	1689
75°	1664	1539	1556
80°	1414	1302	1300
85°	1022	891	874

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2437 cd/sqm

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.9	2.1
10°-20°	1102.6	5.9
20°-30°	1620.4	8.7
30°-40°	1882.0	10.2
40°-50°	1879.7	10.1
50°-60°	1639.0	8.8
60°-70°	1211.6	6.5
70°-80°	685.5	3.7
80°-90°	185.7	1.0
90°-100°	89.3	0.5
100°-110°	332.9	1.8
110°-120°	883.0	4.8
120°-130°	1464.5	7.9
130°-140°	1555.6	8.4
140°-150°	1445.8	7.8
150°-160°	1162.4	6.3
160°-170°	749.0	4.0
170°-180°	257.8	1.4
0°-30°	3114.9	16.8
0°-40°	4996.9	27.0
0°-60°	8515.5	45.9
0°-90°	10598.3	57.2
90°-120°	1305.2	7.0
90°-150°	5771.2	31.1
90°-180°	7940.0	42.8
0°-180°	18538.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4164	4164	4164	4164	4164	
5°	4164	4148	4104	4136	4128	395
15°	3964	3940	3888	3904	3884	1116
25°	3587	3555	3487	3495	3487	1651
35°	3095	3055	2991	2967	2947	1933
45°	2518	2490	2430	2386	2370	1944
55°	1906	1882	1834	1786	1766	1704
65°	1285	1261	1221	1185	1165	1271
75°	672	665	644	621	629	718
85°	164	160	156	144	140	183
90°	2	24	39	49	53	17
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4163.7	4163.7	4163.7	4163.7	4163.7
2.5°	4187.8	4167.9	4123.7	4163.7	4156.0
5°	4163.7	4147.9	4103.7	4135.6	4127.9
7.5°	4135.6	4111.8	4067.6	4099.9	4091.9
10°	4091.9	4063.8	4015.8	4047.7	4035.8
12.5°	4031.5	4007.7	3959.7	3979.7	3971.6
15°	3963.6	3939.8	3887.5	3903.6	3883.7
17.5°	3879.5	3855.7	3803.4	3823.4	3803.4
20°	3787.3	3763.5	3707.5	3719.3	3703.6
22.5°	3695.5	3659.4	3607.1	3607.1	3599.1
25°	3587.2	3555.3	3487.4	3495.1	3487.4
27.5°	3467.0	3439.0	3387.2	3375.2	3355.3
30°	3347.2	3314.9	3255.0	3243.2	3227.0
32.5°	3218.9	3195.2	3131.0	3106.8	3090.7
35°	3094.9	3055.0	2990.8	2966.6	2946.7
37.5°	2954.7	2918.7	2854.5	2826.5	2806.5
40°	2810.8	2778.5	2714.3	2678.6	2662.5
42.5°	2670.6	2638.3	2574.5	2534.2	2510.4
45°	2518.5	2490.5	2430.1	2386.4	2370.3
47.5°	2370.3	2342.2	2278.1	2233.9	2210.1
50°	2213.9	2194.0	2137.9	2081.8	2061.8
52.5°	2061.8	2033.8	1982.0	1937.8	1909.8
55°	1905.9	1881.8	1833.7	1785.7	1765.8
57.5°	1749.6	1729.7	1677.4	1629.4	1613.3
60°	1593.3	1577.6	1521.5	1477.4	1465.4
62.5°	1441.3	1413.2	1373.3	1333.4	1317.2
65°	1285.4	1261.1	1221.2	1185.1	1165.2
67.5°	1125.2	1104.8	1069.2	1041.2	1025.0
70°	977.0	960.8	924.7	896.7	881.0
72.5°	824.9	808.8	788.8	760.8	748.9
75°	672.4	664.8	644.3	620.6	628.7
77.5°	536.5	520.3	512.3	500.3	488.5
80°	400.6	396.3	388.3	376.4	368.3
82.5°	272.2	272.2	268.5	252.4	252.4
85°	164.0	160.2	156.3	144.0	140.2
87.5°	72.2	64.1	56.1	44.1	39.9
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P923261

CATALOG NUMBER: DFN2DIP-SQ4F0-120D090US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.65	12.58	12.54	13.49	14.65	11.20	12.13	12.09	13.04	14.21
	3H	13.32	14.15	14.22	15.07	16.26	12.83	13.66	13.73	14.58	15.77
	4H	13.91	14.70	14.83	15.63	16.83	13.42	14.20	14.34	15.13	16.33
	6H	14.32	15.04	15.25	15.98	17.19	13.82	14.54	14.75	15.48	16.69
	8H	14.43	15.12	15.36	16.07	17.28	13.92	14.62	14.86	15.57	16.78
	12H	14.48	15.14	15.42	16.08	17.32	13.97	14.63	14.91	15.57	16.81
4H	2H	12.12	12.90	13.04	13.83	15.03	11.76	12.55	12.69	13.48	14.68
	3H	13.99	14.65	14.93	15.61	16.82	13.59	14.24	14.52	15.20	16.42
	4H	14.71	15.31	15.66	16.27	17.51	14.29	14.89	15.24	15.84	17.08
	6H	15.24	15.76	16.20	16.73	17.97	14.80	15.32	15.76	16.30	17.54
	8H	15.39	15.87	16.35	16.85	18.10	14.95	15.44	15.91	16.41	17.66
	12H	15.47	15.91	16.45	16.89	18.15	15.02	15.46	16.00	16.44	17.70
8H	4H	14.92	15.40	15.88	16.37	17.62	14.54	15.02	15.50	15.99	17.25
	6H	15.55	15.96	16.54	16.97	18.22	15.17	15.57	16.16	16.58	17.84
	8H	15.78	16.13	16.78	17.13	18.40	15.39	15.74	16.38	16.74	18.01
	12H	15.92	16.23	16.92	17.22	18.54	15.51	15.82	16.51	16.81	18.13
12H	4H	14.90	15.34	15.89	16.33	17.59	14.54	14.97	15.52	15.96	17.22
	6H	15.59	15.94	16.58	16.94	18.21	15.21	15.57	16.21	16.57	17.84
	8H	15.83	16.15	16.83	17.14	18.46	15.45	15.77	16.45	16.76	18.08

END OF REPORT