

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923295

Luminaire Tested: DFN2DIP-SQ4F0-140D080US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923295
REPORT IS A COMBINATION OF REPORTS P901630 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D080US940-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17673.7 lumens
Efficiency: N/A
Efficacy: 86.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 203.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLLONL

Luminous Intensity Polar Plot

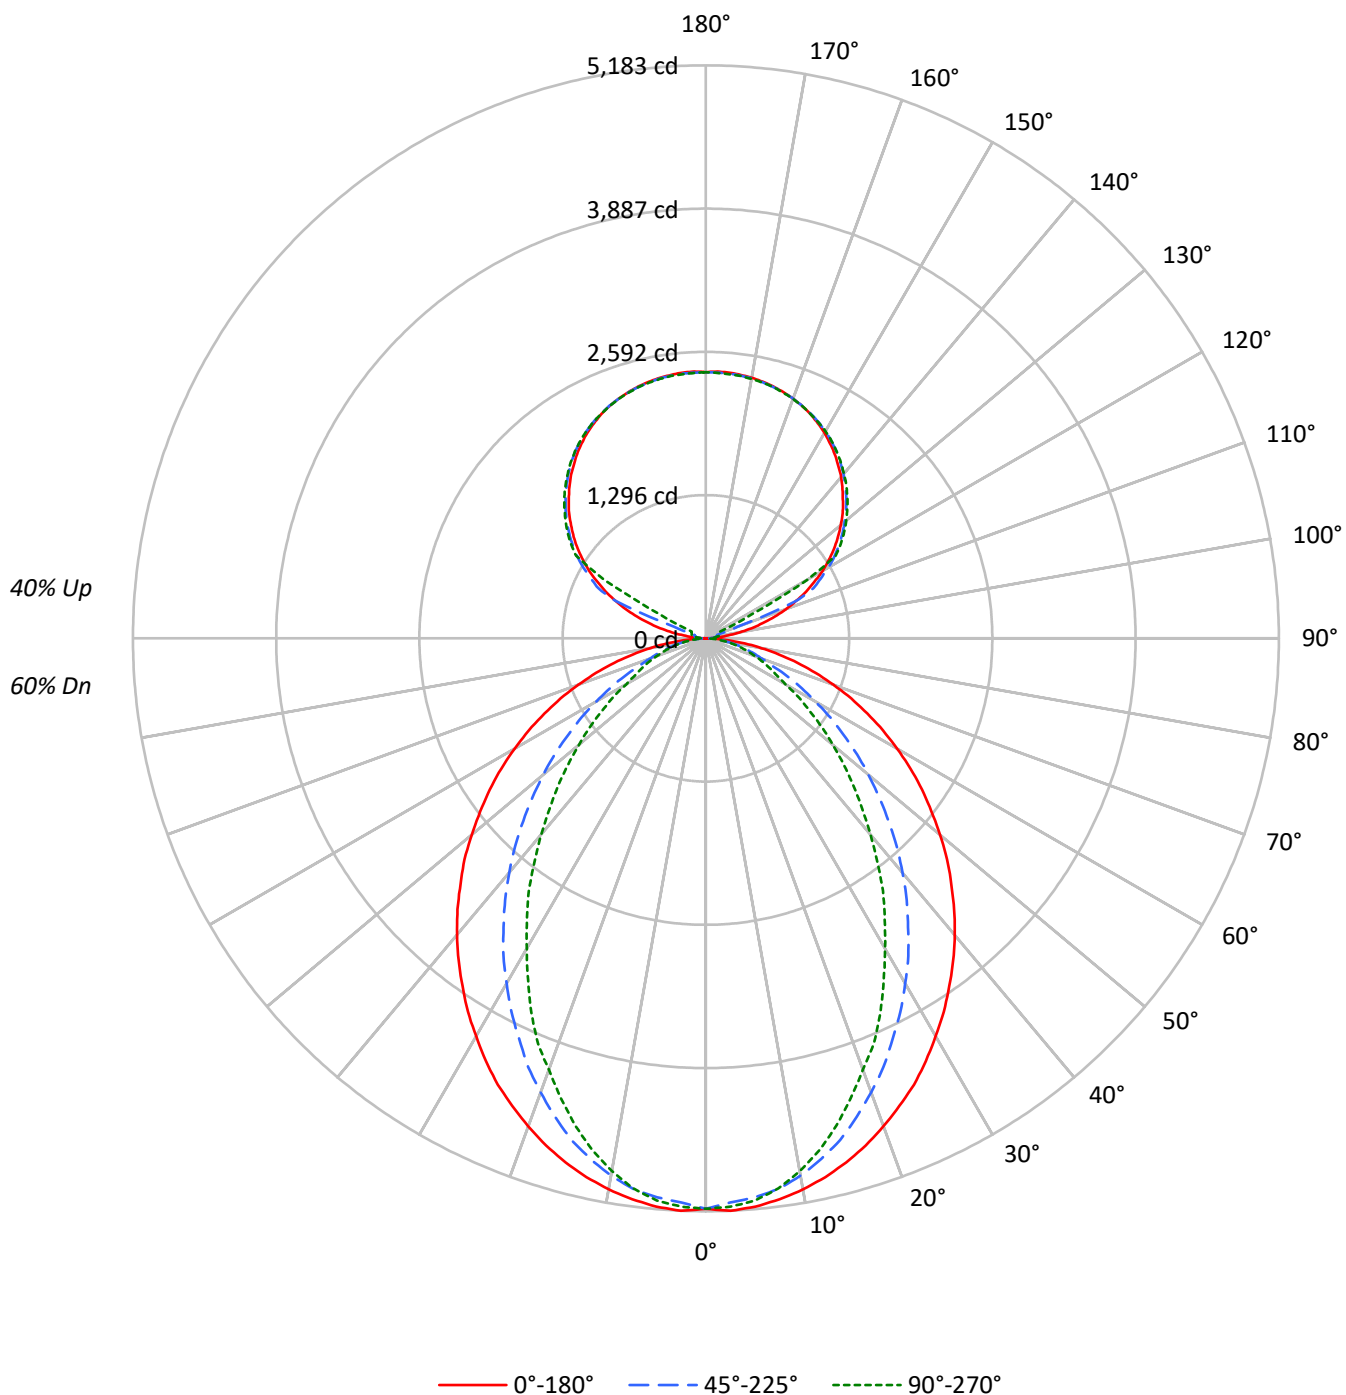

TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3620	3620	3620
5°	3626	3564	3587
10°	3590	3494	3471
15°	3541	3380	3292
20°	3475	3221	3071
25°	3408	3043	2858
30°	3318	2861	2587
35°	3230	2665	2350
40°	3140	2462	2077
45°	3036	2236	1830
50°	2928	2008	1588
55°	2816	1765	1356
60°	2686	1511	1117
65°	2536	1252	1007
70°	2354	1010	913
75°	2126	892	833
80°	1796	751	726
85°	1250	505	552

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3036 cd/sqm

TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	483.6	2.7
10°-20°	1327.5	7.5
20°-30°	1863.7	10.5
30°-40°	2031.6	11.5
40°-50°	1867.3	10.6
50°-60°	1466.4	8.3
60°-70°	954.5	5.4
70°-80°	491.3	2.8
80°-90°	129.7	0.7
90°-100°	79.4	0.4
100°-110°	295.9	1.7
110°-120°	784.9	4.4
120°-130°	1301.8	7.4
130°-140°	1382.8	7.8
140°-150°	1285.1	7.3
150°-160°	1033.2	5.8
160°-170°	665.8	3.8
170°-180°	229.2	1.3
0°-30°	3674.8	20.8
0°-40°	5706.4	32.3
0°-60°	9040.1	51.1
0°-90°	10615.6	60.1
90°-120°	1160.2	6.6
90°-150°	5129.9	29.0
90°-180°	7058.0	39.9
0°-180°	17673.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5160	5160	5160	5160	5160	
5°	5160	5136	5075	5118	5104	489
15°	4907	4856	4697	4609	4562	1383
25°	4455	4305	3997	3806	3735	2049
35°	3838	3600	3189	2895	2792	2402
45°	3138	2825	2335	2003	1891	2423
55°	2386	2022	1517	1238	1149	2132
65°	1611	1232	812	654	640	1597
75°	859	532	374	341	336	909
85°	201	102	89	89	89	230
90°	2	21	35	44	47	17
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1031	1075	268	143	986
125°	1416	1439	1472	1484	1489	1263
135°	1753	1780	1796	1814	1810	1354
145°	2033	2031	2061	2073	2064	1272
155°	2238	2223	2244	2254	2240	1032
165°	2359	2348	2354	2366	2354	666
175°	2413	2400	2404	2416	2399	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5159.6	5159.6	5159.6	5159.6	5159.6
2.5°	5182.9	5159.6	5108.1	5155.2	5145.7
5°	5159.6	5136.3	5075.3	5117.5	5103.6
7.5°	5117.5	5089.7	5024.3	5042.7	5019.4
10°	5061.5	5028.8	4935.7	4921.3	4893.5
12.5°	4991.6	4949.5	4823.2	4795.4	4744.0
15°	4907.4	4855.9	4697.4	4608.7	4562.2
17.5°	4809.4	4734.5	4538.4	4435.8	4361.0
20°	4697.4	4603.7	4370.5	4254.0	4151.0
22.5°	4576.0	4468.5	4197.5	4039.0	3969.2
25°	4454.6	4305.0	3996.9	3805.6	3735.3
27.5°	4310.0	4151.0	3810.1	3590.7	3483.2
30°	4155.9	3978.1	3604.6	3366.7	3240.4
32.5°	4006.3	3791.3	3408.8	3128.5	3011.6
35°	3838.4	3600.1	3189.4	2895.1	2792.0
37.5°	3674.9	3417.7	2983.8	2661.3	2544.9
40°	3502.0	3222.1	2768.8	2437.4	2316.0
42.5°	3324.7	3025.9	2554.3	2208.5	2092.0
45°	3137.8	2824.8	2334.9	2002.9	1891.0
47.5°	2960.5	2629.1	2124.8	1792.9	1690.3
50°	2764.3	2432.9	1919.1	1596.7	1499.1
52.5°	2572.6	2222.3	1723.0	1414.9	1326.2
55°	2385.9	2021.7	1517.4	1237.5	1148.8
57.5°	2194.6	1821.1	1335.6	1074.1	999.3
60°	1998.4	1624.9	1143.9	906.1	831.3
62.5°	1807.2	1433.7	980.4	756.4	719.3
65°	1611.1	1232.5	812.4	653.9	639.5
67.5°	1424.2	1045.8	653.9	574.2	560.3
70°	1228.1	864.0	541.4	494.9	476.1
72.5°	1041.3	695.5	452.8	415.6	406.3
75°	859.0	532.1	373.5	340.8	336.4
77.5°	677.3	378.0	294.3	275.4	266.0
80°	508.8	271.0	223.9	205.6	205.6
82.5°	354.7	182.3	154.1	144.6	144.6
85°	200.6	102.5	88.6	88.6	88.6
87.5°	74.8	37.2	37.2	32.7	32.7
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.6	41.8	45.3	47.0
95°	113.2	55.6	67.9	76.8	74.9
97.5°	203.8	61.0	88.7	94.2	95.8
100°	308.4	69.7	99.3	113.2	116.6
102.5°	423.3	419.9	102.8	121.8	127.2
105°	529.6	581.9	106.3	125.4	132.4
107.5°	653.3	696.7	109.9	128.9	135.9
110°	771.9	808.2	305.0	130.7	137.6



TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.3	914.5	885.0	134.0	139.5
115°	1001.7	1031.3	1074.9	268.3	142.9
117.5°	1104.5	1139.2	1169.0	919.7	463.4
120°	1219.5	1245.5	1277.0	1297.9	1062.7
122.5°	1316.9	1344.9	1379.8	1390.2	1392.0
125°	1416.2	1439.0	1472.0	1484.3	1489.4
127.5°	1506.8	1531.2	1557.6	1574.8	1576.5
130°	1592.2	1620.1	1639.2	1658.5	1656.8
132.5°	1679.4	1702.1	1721.2	1736.9	1735.2
135°	1752.6	1780.5	1796.0	1813.6	1810.1
137.5°	1829.2	1850.0	1867.6	1885.0	1879.8
140°	1904.0	1918.1	1937.2	1952.8	1944.1
142.5°	1966.9	1979.1	2001.6	2015.5	2006.8
145°	2033.1	2031.2	2060.8	2073.0	2064.3
147.5°	2090.4	2085.3	2114.8	2123.5	2116.7
150°	2146.3	2134.0	2162.0	2172.3	2163.6
152.5°	2193.3	2179.3	2205.4	2216.0	2203.8
155°	2238.5	2223.0	2243.9	2254.2	2240.4
157.5°	2275.1	2261.3	2277.0	2289.2	2275.1
160°	2306.6	2296.1	2306.6	2316.9	2304.7
162.5°	2334.3	2324.0	2332.6	2344.8	2329.1
165°	2358.8	2348.4	2353.6	2365.7	2353.6
167.5°	2377.9	2367.4	2372.8	2385.0	2369.3
170°	2393.7	2383.1	2386.7	2398.9	2383.1
172.5°	2404.1	2393.7	2397.2	2409.4	2393.7
175°	2412.7	2400.5	2404.1	2416.2	2398.9
177.5°	2416.2	2404.1	2405.8	2418.1	2402.4
180°	2407.5	2407.5	2407.5	2407.5	2407.5

TEST NUMBER: P923295

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.52	13.44	13.39	14.33	15.45	8.48	9.40	9.35	10.29	11.41
	3H	14.21	15.03	15.10	15.93	17.08	9.68	10.50	10.56	11.40	12.55
	4H	14.83	15.60	15.73	16.51	17.66	10.13	10.91	11.03	11.81	12.97
	6H	15.26	15.97	16.17	16.88	18.05	10.46	11.17	11.37	12.08	13.26
	8H	15.39	16.07	16.31	16.99	18.16	10.55	11.23	11.47	12.16	13.33
	12H	15.45	16.10	16.38	17.02	18.22	10.60	11.25	11.52	12.17	13.36
4H	2H	12.55	13.33	13.46	14.23	15.39	9.09	9.87	10.00	10.77	11.93
	3H	14.39	15.04	15.31	15.97	17.15	10.45	11.09	11.37	12.03	13.20
	4H	15.09	15.68	16.02	16.61	17.81	11.00	11.59	11.93	12.52	13.72
	6H	15.62	16.12	16.56	17.08	18.28	11.43	11.93	12.37	12.89	14.09
	8H	15.79	16.27	16.74	17.22	18.43	11.56	12.03	12.50	12.98	14.19
	12H	15.90	16.32	16.86	17.29	18.51	11.63	12.05	12.59	13.02	14.24
8H	4H	15.07	15.54	16.01	16.49	17.70	11.29	11.76	12.23	12.71	13.92
	6H	15.64	16.03	16.61	17.02	18.23	11.81	12.20	12.78	13.19	14.41
	8H	15.86	16.20	16.84	17.18	18.41	12.01	12.35	12.98	13.33	14.56
	12H	16.01	16.31	16.99	17.28	18.56	12.13	12.43	13.11	13.41	14.68
12H	4H	15.02	15.45	15.98	16.41	17.63	11.30	11.73	12.26	12.69	13.91
	6H	15.62	15.96	16.59	16.94	18.17	11.86	12.21	12.84	13.19	14.42
	8H	15.84	16.15	16.82	17.12	18.40	12.08	12.38	13.06	13.36	14.64

END OF REPORT