

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923301

Luminaire Tested: DFN2DIP-SQ4F0-140D100US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923301
REPORT IS A COMBINATION OF REPORTS P901665 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D100US940-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21187.1 lumens
Efficiency: N/A
Efficacy: 97.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 218.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLLONL

Luminous Intensity Polar Plot

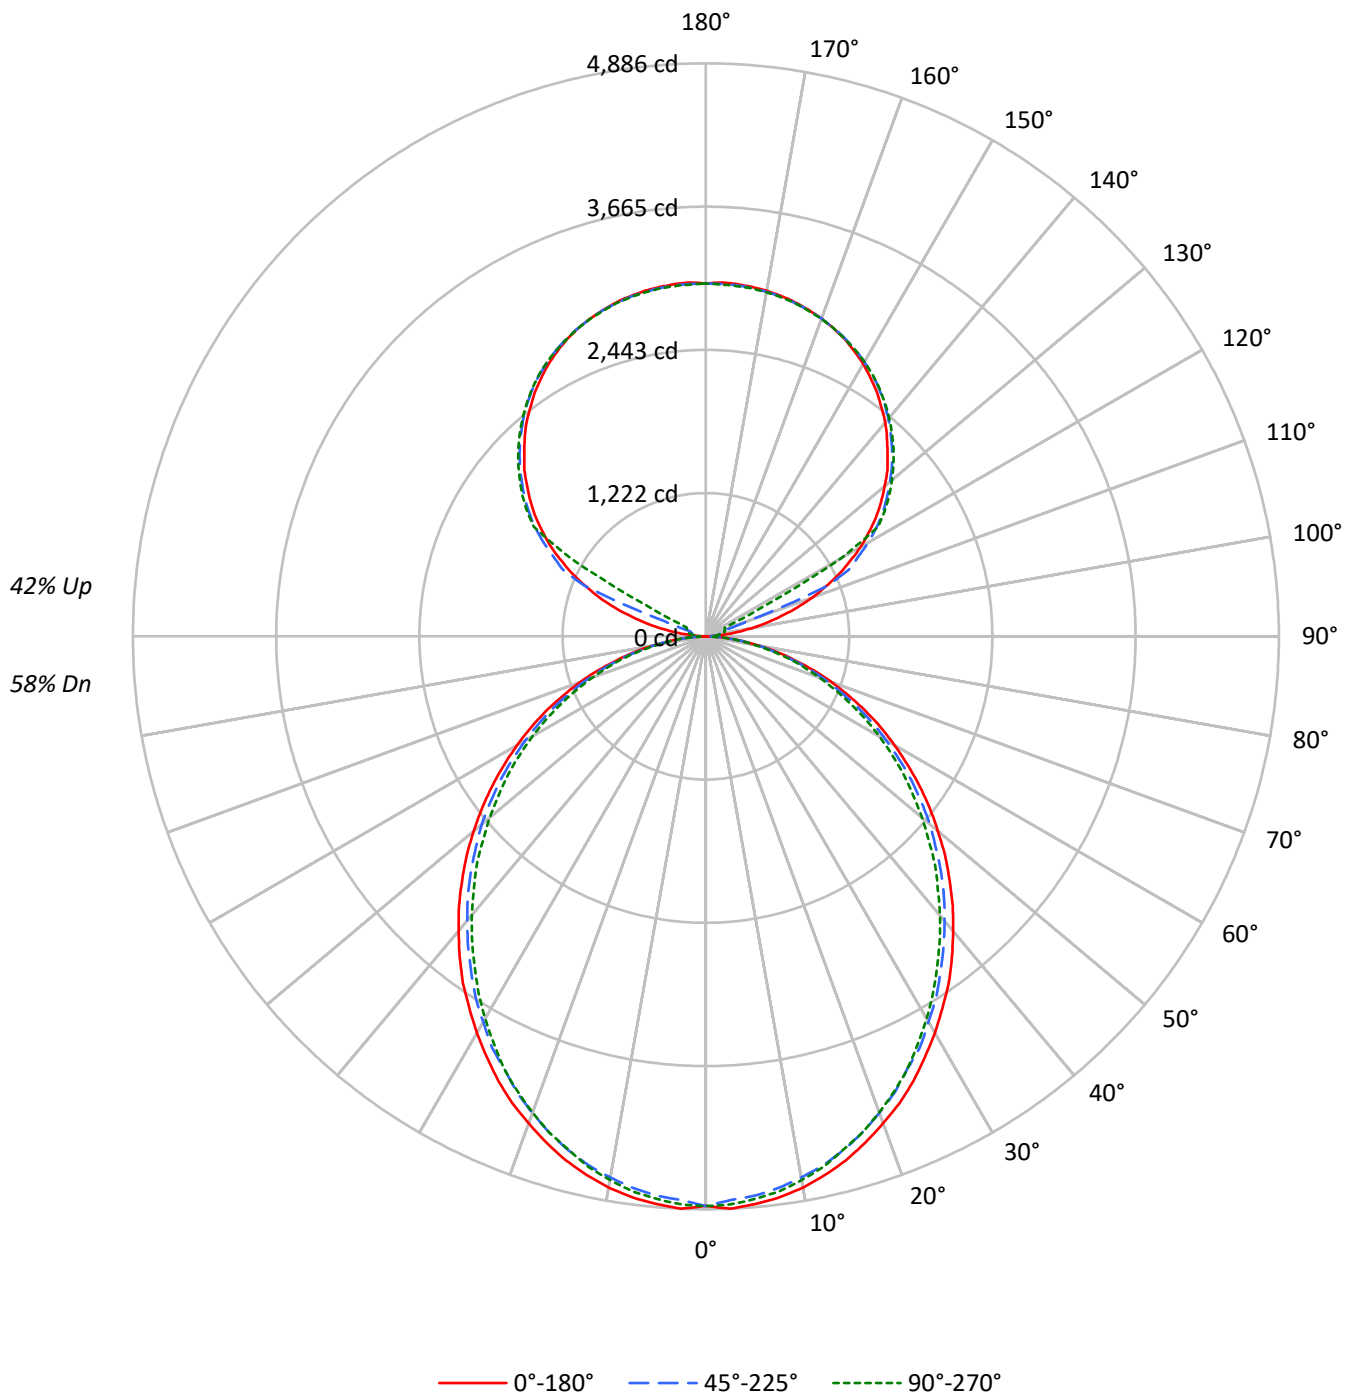

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	53	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3408	3408	3408
5°	3414	3362	3385
10°	3386	3317	3340
15°	3336	3263	3269
20°	3269	3188	3197
25°	3202	3098	3113
30°	3118	3014	3006
35°	3039	2915	2893
40°	2941	2815	2786
45°	2843	2715	2676
50°	2736	2610	2548
55°	2625	2489	2432
60°	2498	2344	2298
65°	2361	2196	2140
70°	2185	2014	1970
75°	1942	1796	1815
80°	1649	1519	1516
85°	1192	1039	1019

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2843 cd/sqm

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	457.2	2.2
10°-20°	1286.4	6.1
20°-30°	1890.5	8.9
30°-40°	2195.7	10.4
40°-50°	2192.9	10.4
50°-60°	1912.2	9.0
60°-70°	1413.5	6.7
70°-80°	799.7	3.8
80°-90°	216.4	1.0
90°-100°	99.2	0.5
100°-110°	369.9	1.7
110°-120°	981.1	4.6
120°-130°	1627.2	7.7
130°-140°	1728.5	8.2
140°-150°	1606.5	7.6
150°-160°	1291.5	6.1
160°-170°	832.2	3.9
170°-180°	286.4	1.4
0°-30°	3634.0	17.2
0°-40°	5829.7	27.5
0°-60°	9934.8	46.9
0°-90°	12364.4	58.4
90°-120°	1450.3	6.8
90°-150°	6412.5	30.3
90°-180°	8823.0	41.6
0°-180°	21187.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4858	4858	4858	4858	4858	
5°	4858	4839	4788	4825	4816	461
15°	4624	4596	4535	4554	4531	1302
25°	4185	4148	4069	4078	4069	1926
35°	3611	3564	3489	3461	3438	2255
45°	2938	2906	2835	2784	2765	2268
55°	2224	2195	2139	2083	2060	1988
65°	1500	1471	1425	1383	1359	1483
75°	784	776	752	724	733	837
85°	191	187	182	168	164	213
90°	2	26	43	55	59	20
95°	141	70	85	96	94	168
105°	662	727	133	157	166	707
115°	1252	1289	1344	335	179	1233
125°	1770	1799	1840	1855	1862	1579
135°	2191	2226	2245	2267	2263	1692
145°	2541	2539	2576	2591	2580	1589
155°	2798	2779	2805	2818	2800	1289
165°	2948	2935	2942	2957	2942	833
175°	3016	3001	3005	3020	2999	287
180°	3009	3009	3009	3009	3009	

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4857.6	4857.6	4857.6	4857.6	4857.6
2.5°	4885.8	4862.5	4811.0	4857.6	4848.7
5°	4857.6	4839.2	4787.7	4824.9	4815.9
7.5°	4824.9	4797.1	4745.6	4783.2	4773.8
10°	4773.8	4741.1	4685.1	4722.3	4708.4
12.5°	4703.4	4675.7	4619.7	4643.0	4633.6
15°	4624.1	4596.4	4535.4	4554.3	4531.0
17.5°	4526.1	4498.3	4437.3	4460.6	4437.3
20°	4418.5	4390.8	4325.3	4339.2	4320.9
22.5°	4311.4	4269.3	4208.3	4208.3	4199.0
25°	4185.1	4147.9	4068.6	4077.5	4068.6
27.5°	4044.8	4012.2	3951.7	3937.8	3914.5
30°	3905.1	3867.4	3797.5	3783.7	3764.8
32.5°	3755.4	3727.7	3652.8	3624.6	3605.7
35°	3610.7	3564.2	3489.3	3461.1	3437.7
37.5°	3447.2	3405.1	3330.2	3297.5	3274.2
40°	3279.2	3241.5	3166.6	3125.1	3106.2
42.5°	3115.6	3078.0	3003.6	2956.6	2928.8
45°	2938.2	2905.5	2835.2	2784.1	2765.3
47.5°	2765.3	2732.6	2657.7	2606.2	2578.5
50°	2582.9	2559.7	2494.2	2428.8	2405.5
52.5°	2405.5	2372.8	2312.3	2260.8	2228.1
55°	2223.7	2195.4	2139.4	2083.4	2060.1
57.5°	2041.2	2017.9	1957.0	1901.0	1882.1
60°	1858.9	1840.6	1775.1	1723.6	1709.7
62.5°	1681.5	1648.8	1602.1	1555.6	1536.8
65°	1499.6	1471.3	1424.8	1382.6	1359.3
67.5°	1312.8	1289.0	1247.3	1214.6	1195.8
70°	1139.8	1121.0	1078.9	1046.2	1027.8
72.5°	962.4	943.5	920.2	887.6	873.7
75°	784.5	775.6	751.8	724.1	733.4
77.5°	625.9	607.1	597.6	583.8	569.9
80°	467.3	462.4	453.0	439.1	429.6
82.5°	317.6	317.6	313.2	294.4	294.4
85°	191.3	186.8	182.4	168.0	163.5
87.5°	84.3	74.8	65.5	51.5	46.5
90°	2.1	26.1	43.4	54.6	58.7
92.5°	54.6	45.7	52.3	56.6	58.7
95°	141.4	69.6	84.8	95.9	93.6
97.5°	254.7	76.2	110.9	117.6	119.8
100°	385.6	87.1	124.1	141.4	145.9
102.5°	529.1	524.9	128.5	152.3	159.0
105°	662.0	727.4	133.0	156.7	165.5
107.5°	816.6	870.9	137.3	161.1	169.9
110°	964.7	1010.3	381.1	163.5	171.9

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1104.1	1143.2	1106.3	167.6	174.3
115°	1252.1	1289.1	1343.6	335.4	178.7
117.5°	1380.5	1424.1	1461.2	1149.7	579.3
120°	1524.4	1556.9	1596.3	1622.4	1328.4
122.5°	1646.2	1681.1	1724.7	1737.7	1740.0
125°	1770.3	1798.8	1840.1	1855.4	1861.8
127.5°	1883.6	1914.1	1946.9	1968.6	1970.7
130°	1990.3	2025.3	2049.1	2073.0	2071.0
132.5°	2099.2	2127.6	2151.4	2171.0	2169.0
135°	2190.8	2225.6	2245.1	2267.0	2262.6
137.5°	2286.4	2312.6	2334.5	2356.3	2349.7
140°	2380.0	2397.6	2421.4	2441.1	2430.2
142.5°	2458.6	2473.9	2502.1	2519.3	2508.6
145°	2541.4	2539.1	2576.1	2591.3	2580.4
147.5°	2613.0	2606.6	2643.5	2654.4	2645.9
150°	2682.8	2667.6	2702.5	2715.4	2704.6
152.5°	2741.5	2724.2	2756.8	2769.9	2754.7
155°	2798.2	2778.7	2804.9	2817.8	2800.5
157.5°	2843.9	2826.6	2846.3	2861.5	2843.9
160°	2883.3	2870.1	2883.3	2896.2	2880.9
162.5°	2917.9	2904.9	2915.8	2931.1	2911.4
165°	2948.4	2935.4	2941.9	2957.2	2941.9
167.5°	2972.4	2959.2	2966.0	2981.3	2961.5
170°	2992.0	2978.9	2983.3	2998.6	2978.9
172.5°	3005.0	2992.0	2996.5	3011.8	2992.0
175°	3015.9	3000.6	3005.0	3020.3	2998.6
177.5°	3020.3	3005.0	3007.4	3022.6	3002.9
180°	3009.4	3009.4	3009.4	3009.4	3009.4

TEST NUMBER: P923301

CATALOG NUMBER: DFN2DIP-SQ4F0-140D100US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.28	13.22	13.16	14.13	15.27	11.84	12.78	12.72	13.68	14.83
	3H	13.95	14.80	14.85	15.71	16.88	13.46	14.31	14.36	15.22	16.39
	4H	14.55	15.35	15.46	16.26	17.45	14.05	14.85	14.96	15.77	16.95
	6H	14.96	15.69	15.88	16.62	17.81	14.45	15.19	15.38	16.12	17.31
	8H	15.06	15.77	15.99	16.71	17.90	14.56	15.26	15.49	16.21	17.40
	12H	15.12	15.78	16.05	16.72	17.94	14.61	15.28	15.54	16.21	17.43
4H	2H	12.75	13.55	13.67	14.47	15.65	12.40	13.20	13.31	14.12	15.30
	3H	14.63	15.30	15.56	16.25	17.44	14.22	14.89	15.15	15.84	17.04
	4H	15.35	15.96	16.29	16.91	18.13	14.93	15.54	15.86	16.48	17.70
	6H	15.88	16.40	16.83	17.37	18.59	15.44	15.97	16.39	16.94	18.16
	8H	16.03	16.52	16.98	17.48	18.72	15.59	16.08	16.54	17.05	18.28
	12H	16.11	16.55	17.08	17.53	18.77	15.66	16.10	16.63	17.08	18.32
8H	4H	15.56	16.05	16.51	17.01	18.24	15.18	15.67	16.13	16.63	17.87
	6H	16.20	16.60	17.17	17.61	18.84	15.81	16.22	16.79	17.22	18.46
	8H	16.42	16.78	17.41	17.77	19.02	16.03	16.39	17.01	17.38	18.63
	12H	16.56	16.87	17.55	17.86	19.16	16.15	16.46	17.14	17.45	18.75
12H	4H	15.55	15.99	16.52	16.97	18.21	15.18	15.62	16.15	16.60	17.84
	6H	16.23	16.59	17.21	17.58	18.83	15.85	16.21	16.84	17.21	18.46
	8H	16.48	16.79	17.47	17.78	19.08	16.10	16.41	17.09	17.40	18.70