

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925802

Luminaire Tested: DFN2DIP-SQ4F0-070D070US950-RLLFLL

Issue Date: 11/21/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P925802  
REPORT IS A COMBINATION OF REPORTS P900080 AND P896915  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-SQ4F0-070D070US950-RLLFLL  
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 11586.3 lumens  
Efficiency: N/A  
Efficacy: 102.1 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16  
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')  
CIE Type: General Diffuse

Input Watts (W): 113.5  
Input Voltage (V):  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: 0.9967  
Total Harmonic Distortion (THDi): 0.063  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLLFLL

### Luminous Intensity Polar Plot

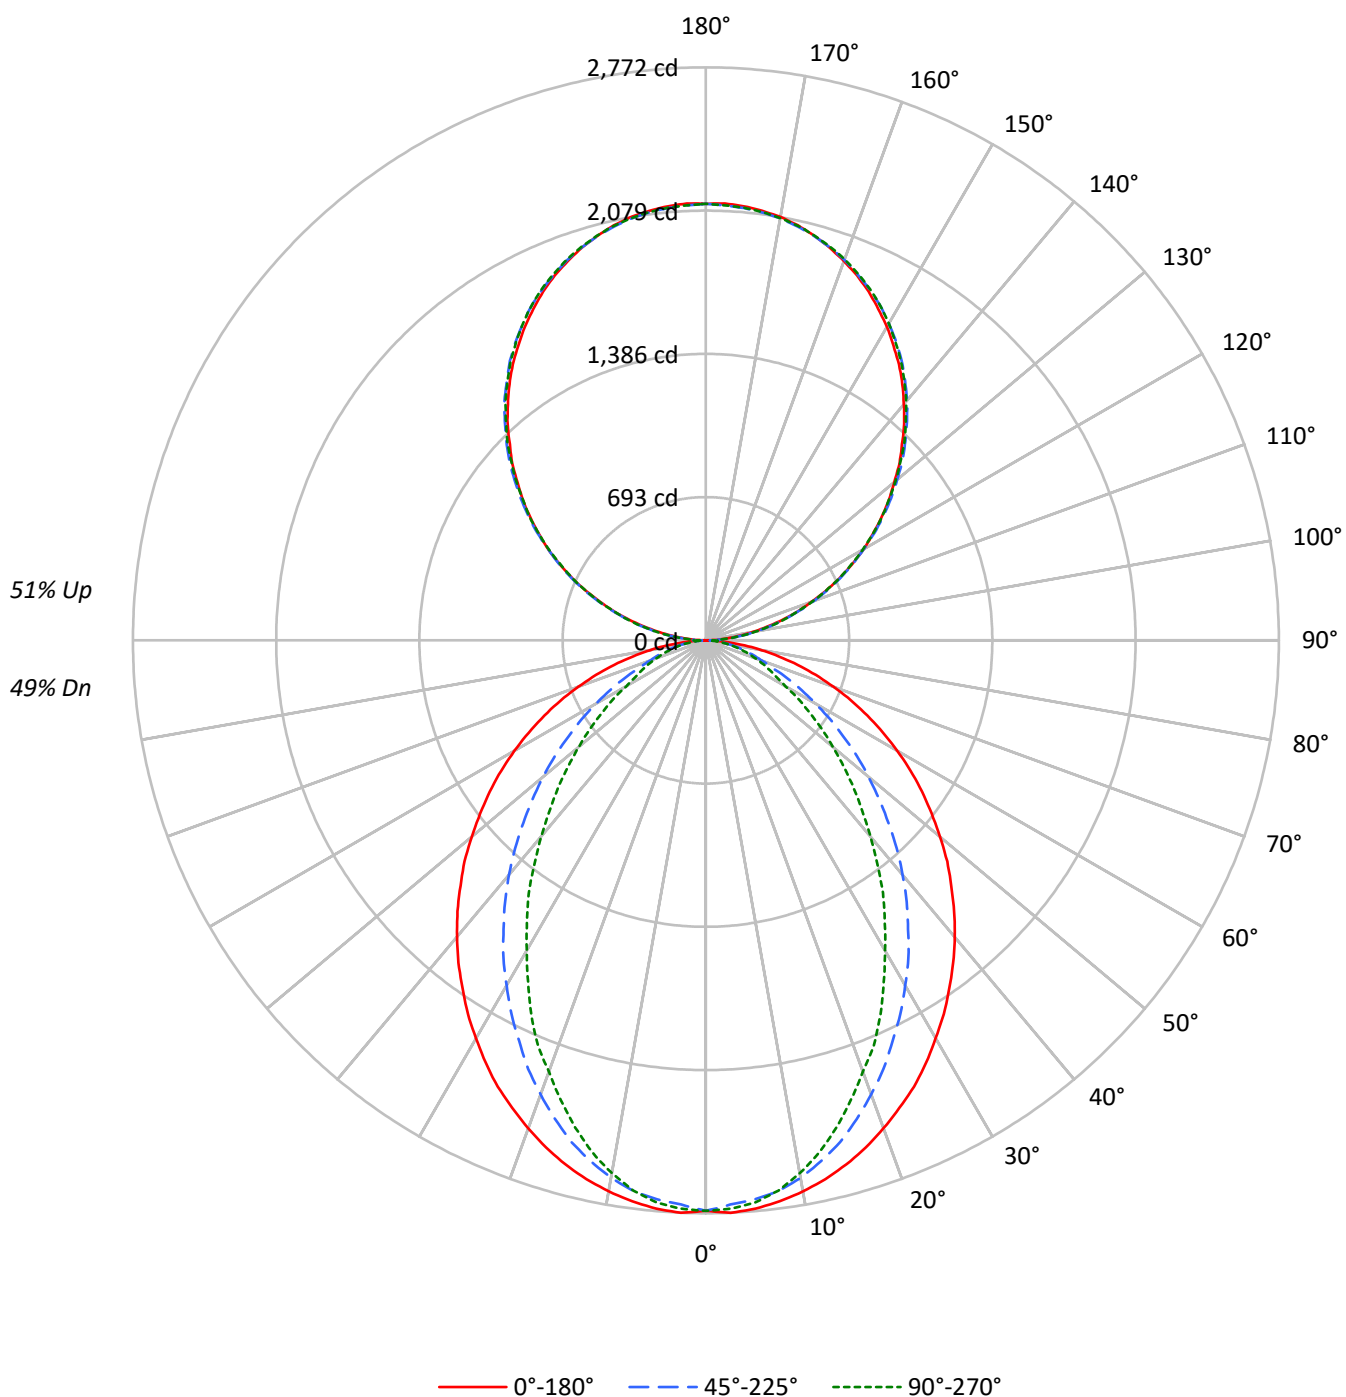

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLFL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| RF  | 20  |     |     |     | 20 |    |    |    | 20 |    |    |    | 20 |    |    |    | 20 |
| RC  | 80  |     |     |     | 70 |    |    |    | 50 |    |    |    | 30 |    |    |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 |
| RCR |     |     |     |     |    |    |    |    |    |    |    |    |    |    |    |    |    |
| 0   | 107 | 107 | 107 | 107 | 99 | 99 | 99 | 99 | 83 | 83 | 83 | 68 | 68 | 68 | 55 | 55 | 55 |
| 1   | 98  | 94  | 90  | 87  | 90 | 87 | 84 | 81 | 73 | 71 | 69 | 61 | 59 | 58 | 50 | 49 | 48 |
| 2   | 90  | 83  | 77  | 72  | 82 | 76 | 71 | 67 | 65 | 61 | 58 | 54 | 51 | 49 | 44 | 42 | 41 |
| 3   | 82  | 73  | 66  | 60  | 75 | 68 | 61 | 57 | 58 | 53 | 49 | 48 | 45 | 42 | 40 | 37 | 35 |
| 4   | 75  | 65  | 57  | 51  | 69 | 60 | 54 | 48 | 51 | 46 | 42 | 43 | 40 | 36 | 36 | 33 | 31 |
| 5   | 69  | 58  | 50  | 44  | 64 | 54 | 47 | 42 | 46 | 41 | 37 | 39 | 35 | 32 | 32 | 29 | 27 |
| 6   | 64  | 52  | 44  | 39  | 59 | 49 | 42 | 37 | 42 | 36 | 32 | 35 | 31 | 28 | 30 | 26 | 24 |
| 7   | 59  | 47  | 40  | 34  | 55 | 44 | 37 | 32 | 38 | 33 | 29 | 32 | 28 | 25 | 27 | 24 | 22 |
| 8   | 55  | 43  | 36  | 30  | 51 | 40 | 33 | 29 | 35 | 29 | 26 | 30 | 26 | 23 | 25 | 22 | 20 |
| 9   | 51  | 39  | 32  | 27  | 47 | 37 | 30 | 26 | 32 | 27 | 23 | 27 | 23 | 20 | 23 | 20 | 18 |
| 10  | 48  | 36  | 29  | 24  | 44 | 34 | 28 | 23 | 30 | 24 | 21 | 25 | 21 | 19 | 22 | 18 | 16 |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°   | 45°  | 90°  |
|-----|------|------|------|
| 0°  | 1937 | 1937 | 1937 |
| 5°  | 1940 | 1906 | 1919 |
| 10° | 1920 | 1869 | 1857 |
| 15° | 1894 | 1808 | 1761 |
| 20° | 1859 | 1723 | 1643 |
| 25° | 1823 | 1628 | 1529 |
| 30° | 1775 | 1530 | 1384 |
| 35° | 1728 | 1425 | 1257 |
| 40° | 1680 | 1317 | 1111 |
| 45° | 1624 | 1196 | 979  |
| 50° | 1567 | 1074 | 850  |
| 55° | 1506 | 944  | 725  |
| 60° | 1437 | 808  | 598  |
| 65° | 1356 | 670  | 539  |
| 70° | 1259 | 541  | 488  |
| 75° | 1137 | 477  | 445  |
| 80° | 961  | 402  | 388  |
| 85° | 669  | 270  | 295  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1663 cd/sqm

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLLFLL

**ZONAL LUMENS:**

| Zone      | Lumens  | % Fixture |
|-----------|---------|-----------|
| 0°-10°    | 258.7   | 2.2       |
| 10°-20°   | 710.1   | 6.1       |
| 20°-30°   | 997.0   | 8.6       |
| 30°-40°   | 1086.8  | 9.4       |
| 40°-50°   | 998.8   | 8.6       |
| 50°-60°   | 784.4   | 6.8       |
| 60°-70°   | 510.6   | 4.4       |
| 70°-80°   | 262.8   | 2.3       |
| 80°-90°   | 73.1    | 0.6       |
| 90°-100°  | 130.7   | 1.1       |
| 100°-110° | 415.3   | 3.6       |
| 110°-120° | 710.6   | 6.1       |
| 120°-130° | 934.6   | 8.1       |
| 130°-140° | 1049.0  | 9.1       |
| 140°-150° | 1028.7  | 8.9       |
| 150°-160° | 862.9   | 7.4       |
| 160°-170° | 572.3   | 4.9       |
| 170°-180° | 200.0   | 1.7       |
| 0°-30°    | 1965.7  | 17.0      |
| 0°-40°    | 3052.5  | 26.3      |
| 0°-60°    | 4835.8  | 41.7      |
| 0°-90°    | 5682.2  | 49.0      |
| 90°-120°  | 1256.6  | 10.8      |
| 90°-150°  | 4268.9  | 36.8      |
| 90°-180°  | 5904.0  | 51.0      |
| 0°-180°   | 11586.3 | 100.0     |

**CANDELA DISTRIBUTION:**

|      | 0°   | 22.5° | 45°  | 67.5° | 90°  | Flux |
|------|------|-------|------|-------|------|------|
| 0°   | 2760 | 2760  | 2760 | 2760  | 2760 |      |
| 5°   | 2760 | 2748  | 2715 | 2738  | 2730 | 262  |
| 15°  | 2625 | 2598  | 2513 | 2465  | 2440 | 740  |
| 25°  | 2383 | 2303  | 2138 | 2036  | 1998 | 1096 |
| 35°  | 2053 | 1926  | 1706 | 1549  | 1494 | 1285 |
| 45°  | 1679 | 1511  | 1249 | 1071  | 1012 | 1296 |
| 55°  | 1276 | 1082  | 812  | 662   | 615  | 1140 |
| 65°  | 862  | 659   | 435  | 350   | 342  | 854  |
| 75°  | 460  | 285   | 200  | 182   | 180  | 486  |
| 85°  | 107  | 55    | 47   | 47    | 47   | 123  |
| 90°  | 2    | 23    | 62   | 59    | 60   | 11   |
| 95°  | 93   | 111   | 114  | 114   | 111  | 103  |
| 105° | 383  | 388   | 392  | 395   | 395  | 405  |
| 115° | 713  | 723   | 720  | 718   | 713  | 705  |
| 125° | 1037 | 1053  | 1048 | 1042  | 1040 | 927  |
| 135° | 1342 | 1361  | 1365 | 1363  | 1358 | 1037 |
| 145° | 1629 | 1642  | 1652 | 1654  | 1647 | 1018 |
| 155° | 1862 | 1868  | 1873 | 1882  | 1876 | 857  |
| 165° | 2026 | 2024  | 2024 | 2037  | 2028 | 572  |
| 175° | 2108 | 2103  | 2099 | 2112  | 2101 | 200  |
| 180° | 2112 | 2112  | 2112 | 2112  | 2112 |      |

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLFL

**CANDELA DISTRIBUTION (FULL):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 0°     | 2760.0 | 2760.0 | 2760.0 | 2760.0 | 2760.0 |
| 2.5°   | 2772.4 | 2760.0 | 2732.4 | 2757.6 | 2752.6 |
| 5°     | 2760.0 | 2747.5 | 2715.0 | 2737.5 | 2730.1 |
| 7.5°   | 2737.5 | 2722.6 | 2687.7 | 2697.4 | 2685.0 |
| 10°    | 2707.5 | 2690.1 | 2640.2 | 2632.6 | 2617.7 |
| 12.5°  | 2670.2 | 2647.6 | 2580.1 | 2565.2 | 2537.6 |
| 15°    | 2625.1 | 2597.6 | 2512.7 | 2465.3 | 2440.4 |
| 17.5°  | 2572.7 | 2532.7 | 2427.7 | 2372.8 | 2332.8 |
| 20°    | 2512.7 | 2462.7 | 2337.9 | 2275.6 | 2220.4 |
| 22.5°  | 2447.9 | 2390.3 | 2245.3 | 2160.5 | 2123.2 |
| 25°    | 2382.9 | 2302.9 | 2138.0 | 2035.7 | 1998.2 |
| 27.5°  | 2305.5 | 2220.4 | 2038.1 | 1920.8 | 1863.3 |
| 30°    | 2223.1 | 2128.0 | 1928.1 | 1801.0 | 1733.4 |
| 32.5°  | 2143.1 | 2028.1 | 1823.5 | 1673.5 | 1610.9 |
| 35°    | 2053.2 | 1925.7 | 1706.1 | 1548.7 | 1493.6 |
| 37.5°  | 1965.8 | 1828.2 | 1596.1 | 1423.6 | 1361.4 |
| 40°    | 1873.3 | 1723.6 | 1481.1 | 1303.8 | 1238.9 |
| 42.5°  | 1778.4 | 1618.7 | 1366.3 | 1181.3 | 1119.1 |
| 45°    | 1678.6 | 1511.0 | 1249.0 | 1071.4 | 1011.5 |
| 47.5°  | 1583.6 | 1406.4 | 1136.6 | 959.1  | 904.2  |
| 50°    | 1478.7 | 1301.4 | 1026.6 | 854.1  | 801.9  |
| 52.5°  | 1376.1 | 1188.8 | 921.7  | 756.8  | 709.4  |
| 55°    | 1276.3 | 1081.5 | 811.7  | 662.0  | 614.6  |
| 57.5°  | 1174.0 | 974.1  | 714.5  | 574.5  | 534.5  |
| 60°    | 1069.1 | 869.2  | 611.9  | 484.7  | 444.7  |
| 62.5°  | 966.7  | 766.9  | 524.4  | 404.7  | 384.7  |
| 65°    | 861.7  | 659.3  | 434.6  | 349.8  | 342.1  |
| 67.5°  | 761.9  | 559.4  | 349.8  | 307.1  | 299.7  |
| 70°    | 656.9  | 462.1  | 289.6  | 264.7  | 254.6  |
| 72.5°  | 557.0  | 372.1  | 242.2  | 222.4  | 217.3  |
| 75°    | 459.5  | 284.6  | 199.8  | 182.3  | 179.9  |
| 77.5°  | 362.2  | 202.2  | 157.4  | 147.3  | 142.3  |
| 80°    | 272.2  | 144.9  | 119.8  | 110.0  | 110.0  |
| 82.5°  | 189.8  | 97.5   | 82.4   | 77.4   | 77.4   |
| 85°    | 107.3  | 54.9   | 47.4   | 47.4   | 47.4   |
| 87.5°  | 40.0   | 19.8   | 19.8   | 17.5   | 17.5   |
| 90°    | 1.9    | 22.9   | 62.4   | 58.6   | 60.5   |
| 92.5°  | 39.5   | 53.5   | 55.4   | 57.3   | 57.3   |
| 95°    | 92.9   | 110.8  | 114.0  | 114.0  | 110.8  |
| 97.5°  | 154.7  | 171.2  | 178.3  | 178.3  | 178.3  |
| 100°   | 226.0  | 240.7  | 245.8  | 245.8  | 243.8  |
| 102.5° | 301.2  | 312.0  | 319.0  | 320.9  | 319.0  |
| 105°   | 383.3  | 388.4  | 392.2  | 395.4  | 395.4  |
| 107.5° | 464.8  | 472.4  | 472.4  | 473.8  | 464.8  |
| 110°   | 543.8  | 554.0  | 554.0  | 554.0  | 548.8  |

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLLFLL

**CANDELA DISTRIBUTION (continued):**

|        | 0°     | 22.5°  | 45°    | 67.5°  | 90°    |
|--------|--------|--------|--------|--------|--------|
| 112.5° | 629.1  | 639.9  | 638.0  | 632.9  | 629.1  |
| 115°   | 713.1  | 723.3  | 720.2  | 718.3  | 713.1  |
| 117.5° | 796.5  | 810.5  | 801.6  | 796.5  | 791.4  |
| 120°   | 880.5  | 894.6  | 880.5  | 880.5  | 874.8  |
| 122.5° | 957.0  | 974.8  | 965.9  | 960.8  | 957.0  |
| 125°   | 1037.2 | 1053.1 | 1048.1 | 1042.3 | 1040.4 |
| 127.5° | 1115.5 | 1135.3 | 1128.3 | 1120.7 | 1115.5 |
| 130°   | 1188.8 | 1211.7 | 1208.5 | 1204.7 | 1197.7 |
| 132.5° | 1270.9 | 1288.8 | 1290.0 | 1281.1 | 1276.0 |
| 135°   | 1341.6 | 1361.3 | 1365.2 | 1363.2 | 1358.1 |
| 137.5° | 1420.5 | 1436.4 | 1439.6 | 1438.3 | 1430.7 |
| 140°   | 1490.0 | 1505.9 | 1514.8 | 1514.8 | 1507.8 |
| 142.5° | 1561.2 | 1577.2 | 1582.2 | 1584.1 | 1577.2 |
| 145°   | 1628.8 | 1641.5 | 1651.7 | 1653.6 | 1646.6 |
| 147.5° | 1689.2 | 1705.2 | 1712.8 | 1716.0 | 1709.0 |
| 150°   | 1751.6 | 1762.4 | 1769.5 | 1775.2 | 1769.5 |
| 152.5° | 1807.0 | 1817.8 | 1826.7 | 1833.8 | 1826.7 |
| 155°   | 1862.4 | 1867.5 | 1873.3 | 1882.1 | 1876.4 |
| 157.5° | 1910.2 | 1914.0 | 1917.2 | 1929.9 | 1921.0 |
| 160°   | 1952.8 | 1956.7 | 1958.6 | 1969.3 | 1961.7 |
| 162.5° | 1992.3 | 1992.3 | 1994.2 | 2006.3 | 1997.4 |
| 165°   | 2026.0 | 2024.1 | 2024.1 | 2036.9 | 2027.9 |
| 167.5° | 2056.6 | 2050.9 | 2050.9 | 2063.6 | 2054.7 |
| 170°   | 2079.5 | 2074.5 | 2072.6 | 2085.3 | 2074.5 |
| 172.5° | 2095.5 | 2090.3 | 2088.4 | 2101.2 | 2090.3 |
| 175°   | 2108.1 | 2103.1 | 2099.3 | 2112.0 | 2101.2 |
| 177.5° | 2115.2 | 2110.1 | 2106.2 | 2117.1 | 2106.2 |
| 180°   | 2112.0 | 2112.0 | 2112.0 | 2112.0 | 2112.0 |

TEST NUMBER: P925802

CATALOG NUMBER: DFN2DIP-SQ4F0-070D070US950-RLLFLL

**CIE UGR TABLE:**

| Reflectances:   |      |                  |       |       |       |       |                |      |       |       |       |
|-----------------|------|------------------|-------|-------|-------|-------|----------------|------|-------|-------|-------|
| Ceiling         |      | 0.7              | 0.7   | 0.5   | 0.5   | 0.3   | 0.7            | 0.7  | 0.5   | 0.5   | 0.3   |
| Wall            |      | 0.5              | 0.3   | 0.5   | 0.3   | 0.3   | 0.5            | 0.3  | 0.5   | 0.3   | 0.3   |
| Reference plane |      | 0.2              | 0.2   | 0.2   | 0.2   | 0.2   | 0.2            | 0.2  | 0.2   | 0.2   | 0.2   |
| Room dimensions |      | Viewed crosswise |       |       |       |       | Viewed endwise |      |       |       |       |
| X=2H            | Y=2H | 9.36             | 10.19 | 10.34 | 11.17 | 12.46 | 5.32           | 6.15 | 6.30  | 7.13  | 8.42  |
|                 | 3H   | 11.05            | 11.78 | 12.03 | 12.77 | 14.08 | 6.51           | 7.25 | 7.50  | 8.24  | 9.55  |
|                 | 4H   | 11.66            | 12.35 | 12.65 | 13.35 | 14.66 | 6.96           | 7.66 | 7.96  | 8.65  | 9.97  |
|                 | 6H   | 12.08            | 12.72 | 13.09 | 13.72 | 15.05 | 7.28           | 7.92 | 8.29  | 8.92  | 10.25 |
|                 | 8H   | 12.21            | 12.82 | 13.22 | 13.83 | 15.16 | 7.38           | 7.98 | 8.39  | 9.00  | 10.33 |
|                 | 12H  | 12.27            | 12.85 | 13.29 | 13.86 | 15.21 | 7.42           | 8.00 | 8.44  | 9.01  | 10.36 |
| 4H              | 2H   | 9.38             | 10.08 | 10.38 | 11.07 | 12.39 | 5.92           | 6.62 | 6.92  | 7.61  | 8.93  |
|                 | 3H   | 11.21            | 11.79 | 12.23 | 12.82 | 14.15 | 7.27           | 7.85 | 8.28  | 8.87  | 10.20 |
|                 | 4H   | 11.91            | 12.44 | 12.93 | 13.45 | 14.81 | 7.82           | 8.35 | 8.84  | 9.36  | 10.72 |
|                 | 6H   | 12.43            | 12.88 | 13.46 | 13.92 | 15.27 | 8.24           | 8.69 | 9.27  | 9.73  | 11.08 |
|                 | 8H   | 12.61            | 13.03 | 13.64 | 14.06 | 15.43 | 8.37           | 8.79 | 9.40  | 9.82  | 11.19 |
|                 | 12H  | 12.70            | 13.09 | 13.75 | 14.13 | 15.50 | 8.43           | 8.82 | 9.48  | 9.86  | 11.23 |
| 8H              | 4H   | 11.88            | 12.30 | 12.91 | 13.33 | 14.70 | 8.10           | 8.53 | 9.13  | 9.56  | 10.92 |
|                 | 6H   | 12.45            | 12.80 | 13.50 | 13.87 | 15.23 | 8.62           | 8.97 | 9.68  | 10.05 | 11.41 |
|                 | 8H   | 12.67            | 12.97 | 13.73 | 14.03 | 15.42 | 8.81           | 9.12 | 9.88  | 10.18 | 11.56 |
|                 | 12H  | 12.81            | 13.08 | 13.87 | 14.13 | 15.56 | 8.93           | 9.20 | 10.00 | 10.26 | 11.68 |
| 12H             | 4H   | 11.83            | 12.21 | 12.88 | 13.26 | 14.63 | 8.11           | 8.49 | 9.16  | 9.54  | 10.91 |
|                 | 6H   | 12.42            | 12.73 | 13.48 | 13.79 | 15.17 | 8.67           | 8.98 | 9.73  | 10.04 | 11.42 |
|                 | 8H   | 12.65            | 12.92 | 13.71 | 13.97 | 15.40 | 8.88           | 9.15 | 9.95  | 10.21 | 11.63 |