

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925836

Luminaire Tested: DFN2DIP-SQ4F0-080D070US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925836
REPORT IS A COMBINATION OF REPORTS P900081 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D070US950-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13465.7 lumens
Efficiency: N/A
Efficacy: 108.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 123.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFLL

Luminous Intensity Polar Plot

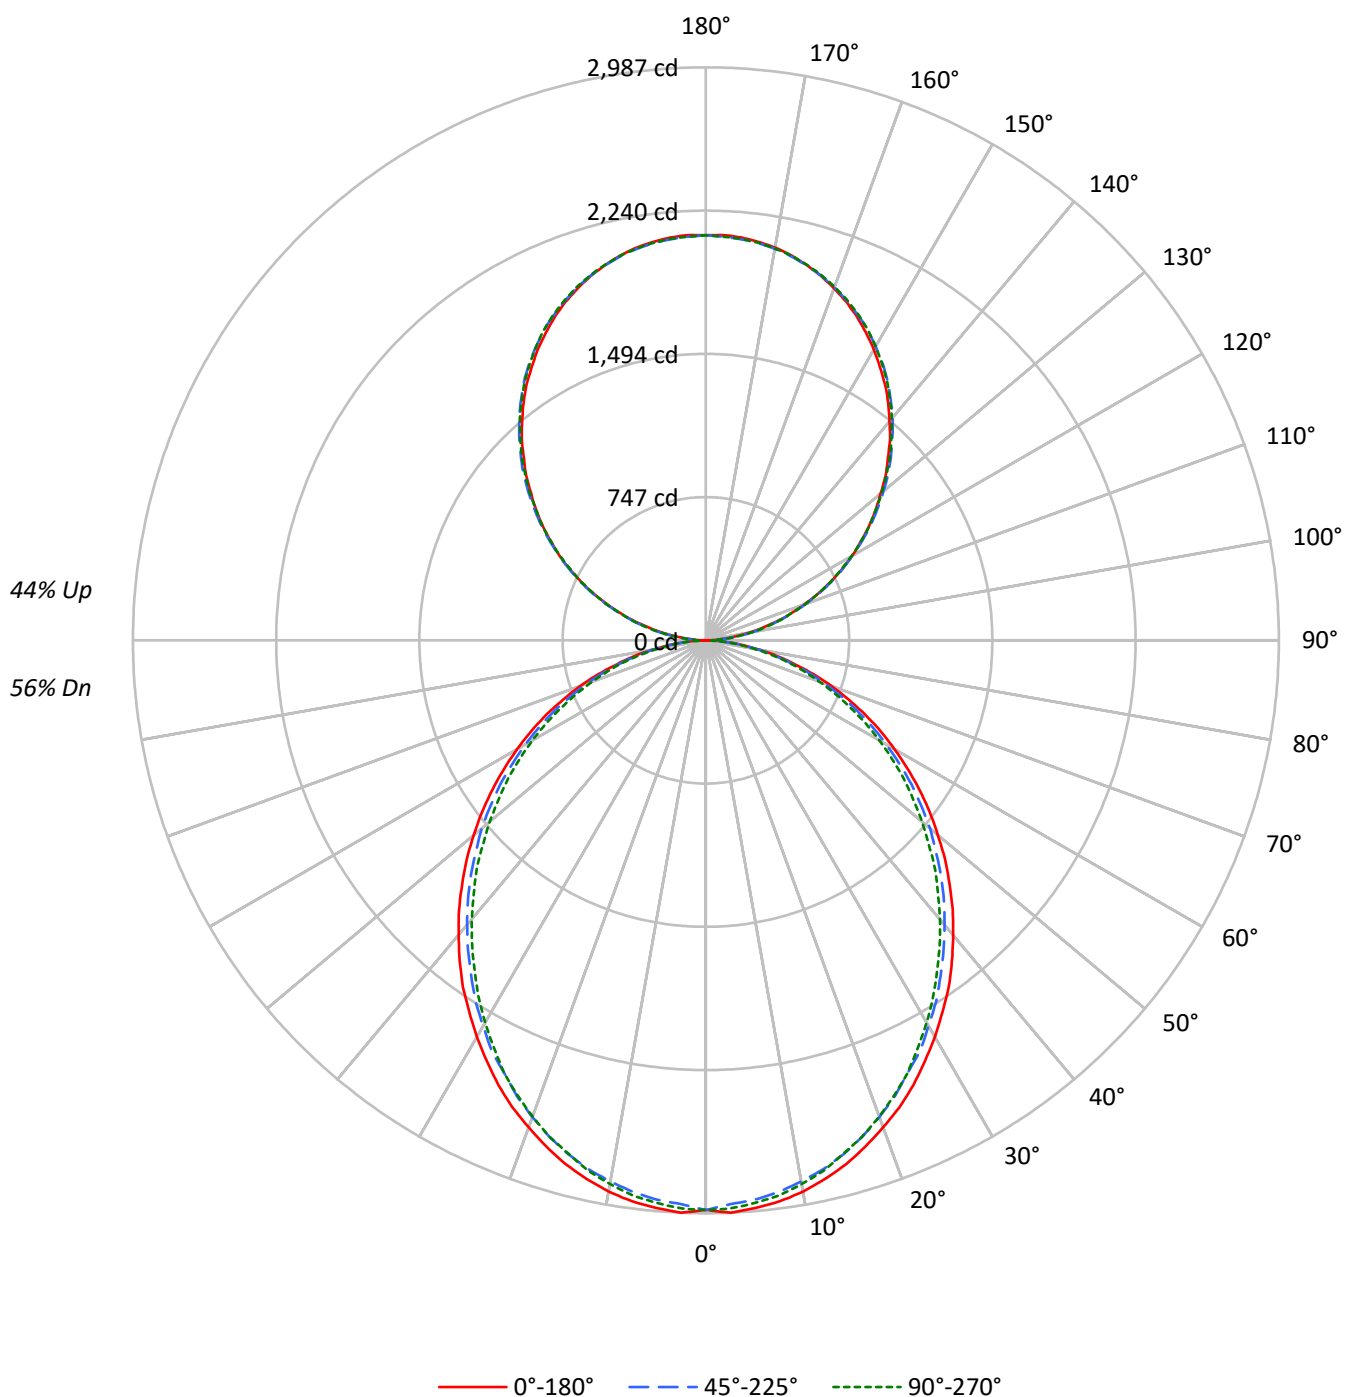

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	71	65	63	61	55	53	52
2	90	83	77	71	84	77	72	67	67	63	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	47	43	43	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	37	40	36	32	34	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	32	28	33	29	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	23	20
9	51	39	31	26	47	36	30	25	32	26	23	28	23	20	24	21	18
10	48	36	28	23	44	34	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2084	2084	2084
5°	2087	2055	2069
10°	2070	2028	2042
15°	2040	1995	1999
20°	1999	1949	1954
25°	1958	1894	1903
30°	1906	1843	1838
35°	1858	1782	1769
40°	1798	1721	1703
45°	1738	1660	1636
50°	1673	1596	1558
55°	1604	1522	1486
60°	1527	1433	1405
65°	1443	1342	1308
70°	1336	1231	1205
75°	1187	1098	1110
80°	1008	929	927
85°	729	635	623

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1738 cd/sqm

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	2.1
10°-20°	786.4	5.8
20°-30°	1155.7	8.6
30°-40°	1342.3	10.0
40°-50°	1340.6	10.0
50°-60°	1169.0	8.7
60°-70°	864.1	6.4
70°-80°	488.9	3.6
80°-90°	135.0	1.0
90°-100°	130.7	1.0
100°-110°	415.3	3.1
110°-120°	710.6	5.3
120°-130°	934.6	6.9
130°-140°	1049.0	7.8
140°-150°	1028.7	7.6
150°-160°	862.9	6.4
160°-170°	572.3	4.2
170°-180°	200.0	1.5
0°-30°	2221.6	16.5
0°-40°	3563.9	26.5
0°-60°	6073.6	45.1
0°-90°	7561.7	56.2
90°-120°	1256.6	9.3
90°-150°	4268.9	31.7
90°-180°	5904.0	43.8
0°-180°	13465.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	2	23	62	59	60	13
95°	93	111	114	114	111	103
105°	383	388	392	395	395	405
115°	713	723	720	718	713	705
125°	1037	1053	1048	1042	1040	927
135°	1342	1361	1365	1363	1358	1037
145°	1629	1642	1652	1654	1647	1018
155°	1862	1868	1873	1882	1876	857
165°	2026	2024	2024	2037	2028	572
175°	2108	2103	2099	2112	2101	200
180°	2112	2112	2112	2112	2112	

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	1.9	22.9	62.4	58.6	60.5
92.5°	39.5	53.5	55.4	57.3	57.3
95°	92.9	110.8	114.0	114.0	110.8
97.5°	154.7	171.2	178.3	178.3	178.3
100°	226.0	240.7	245.8	245.8	243.8
102.5°	301.2	312.0	319.0	320.9	319.0
105°	383.3	388.4	392.2	395.4	395.4
107.5°	464.8	472.4	472.4	473.8	464.8
110°	543.8	554.0	554.0	554.0	548.8

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	629.1	639.9	638.0	632.9	629.1
115°	713.1	723.3	720.2	718.3	713.1
117.5°	796.5	810.5	801.6	796.5	791.4
120°	880.5	894.6	880.5	880.5	874.8
122.5°	957.0	974.8	965.9	960.8	957.0
125°	1037.2	1053.1	1048.1	1042.3	1040.4
127.5°	1115.5	1135.3	1128.3	1120.7	1115.5
130°	1188.8	1211.7	1208.5	1204.7	1197.7
132.5°	1270.9	1288.8	1290.0	1281.1	1276.0
135°	1341.6	1361.3	1365.2	1363.2	1358.1
137.5°	1420.5	1436.4	1439.6	1438.3	1430.7
140°	1490.0	1505.9	1514.8	1514.8	1507.8
142.5°	1561.2	1577.2	1582.2	1584.1	1577.2
145°	1628.8	1641.5	1651.7	1653.6	1646.6
147.5°	1689.2	1705.2	1712.8	1716.0	1709.0
150°	1751.6	1762.4	1769.5	1775.2	1769.5
152.5°	1807.0	1817.8	1826.7	1833.8	1826.7
155°	1862.4	1867.5	1873.3	1882.1	1876.4
157.5°	1910.2	1914.0	1917.2	1929.9	1921.0
160°	1952.8	1956.7	1958.6	1969.3	1961.7
162.5°	1992.3	1992.3	1994.2	2006.3	1997.4
165°	2026.0	2024.1	2024.1	2036.9	2027.9
167.5°	2056.6	2050.9	2050.9	2063.6	2054.7
170°	2079.5	2074.5	2072.6	2085.3	2074.5
172.5°	2095.5	2090.3	2088.4	2101.2	2090.3
175°	2108.1	2103.1	2099.3	2112.0	2101.2
177.5°	2115.2	2110.1	2106.2	2117.1	2106.2
180°	2112.0	2112.0	2112.0	2112.0	2112.0

TEST NUMBER: P925836

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.38	11.30	11.29	12.23	13.41	9.94	10.86	10.84	11.78	12.96
	3H	12.05	12.88	12.97	13.81	15.01	11.56	12.39	12.48	13.32	14.52
	4H	12.65	13.43	13.58	14.36	15.58	12.15	12.93	13.08	13.87	15.08
	6H	13.05	13.77	13.99	14.71	15.94	12.55	13.27	13.49	14.21	15.44
	8H	13.16	13.85	14.11	14.81	16.03	12.66	13.34	13.61	14.30	15.53
	12H	13.21	13.87	14.17	14.82	16.07	12.70	13.36	13.66	14.31	15.56
4H	2H	10.85	11.63	11.79	12.57	13.78	10.50	11.28	11.43	12.21	13.43
	3H	12.73	13.38	13.67	14.35	15.58	12.32	12.97	13.27	13.94	15.17
	4H	13.45	14.04	14.40	15.00	16.26	13.02	13.62	13.98	14.58	15.83
	6H	13.97	14.48	14.94	15.47	16.72	13.54	14.05	14.51	15.04	16.29
	8H	14.12	14.60	15.09	15.58	16.85	13.69	14.17	14.66	15.15	16.41
	12H	14.20	14.64	15.19	15.63	16.90	13.75	14.19	14.74	15.18	16.45
8H	4H	13.65	14.13	14.62	15.11	16.38	13.27	13.75	14.24	14.73	16.00
	6H	14.29	14.69	15.28	15.71	16.97	13.91	14.30	14.90	15.32	16.59
	8H	14.51	14.86	15.52	15.87	17.16	14.12	14.47	15.12	15.48	16.76
	12H	14.65	14.96	15.66	15.96	17.29	14.24	14.55	15.25	15.55	16.88
12H	4H	13.64	14.07	14.63	15.07	16.34	13.27	13.70	14.26	14.70	15.97
	6H	14.32	14.67	15.32	15.68	16.96	13.95	14.30	14.95	15.31	16.59
	8H	14.57	14.88	15.58	15.88	17.21	14.19	14.50	15.19	15.50	16.83

END OF REPORT