

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925882

Luminaire Tested: DFN2DIP-SQ4F0-090D090US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925882
REPORT IS A COMBINATION OF REPORTS P900120 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D090US950-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14896.7 lumens
Efficiency: N/A
Efficacy: 99.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 149.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLLFLL

Luminous Intensity Polar Plot

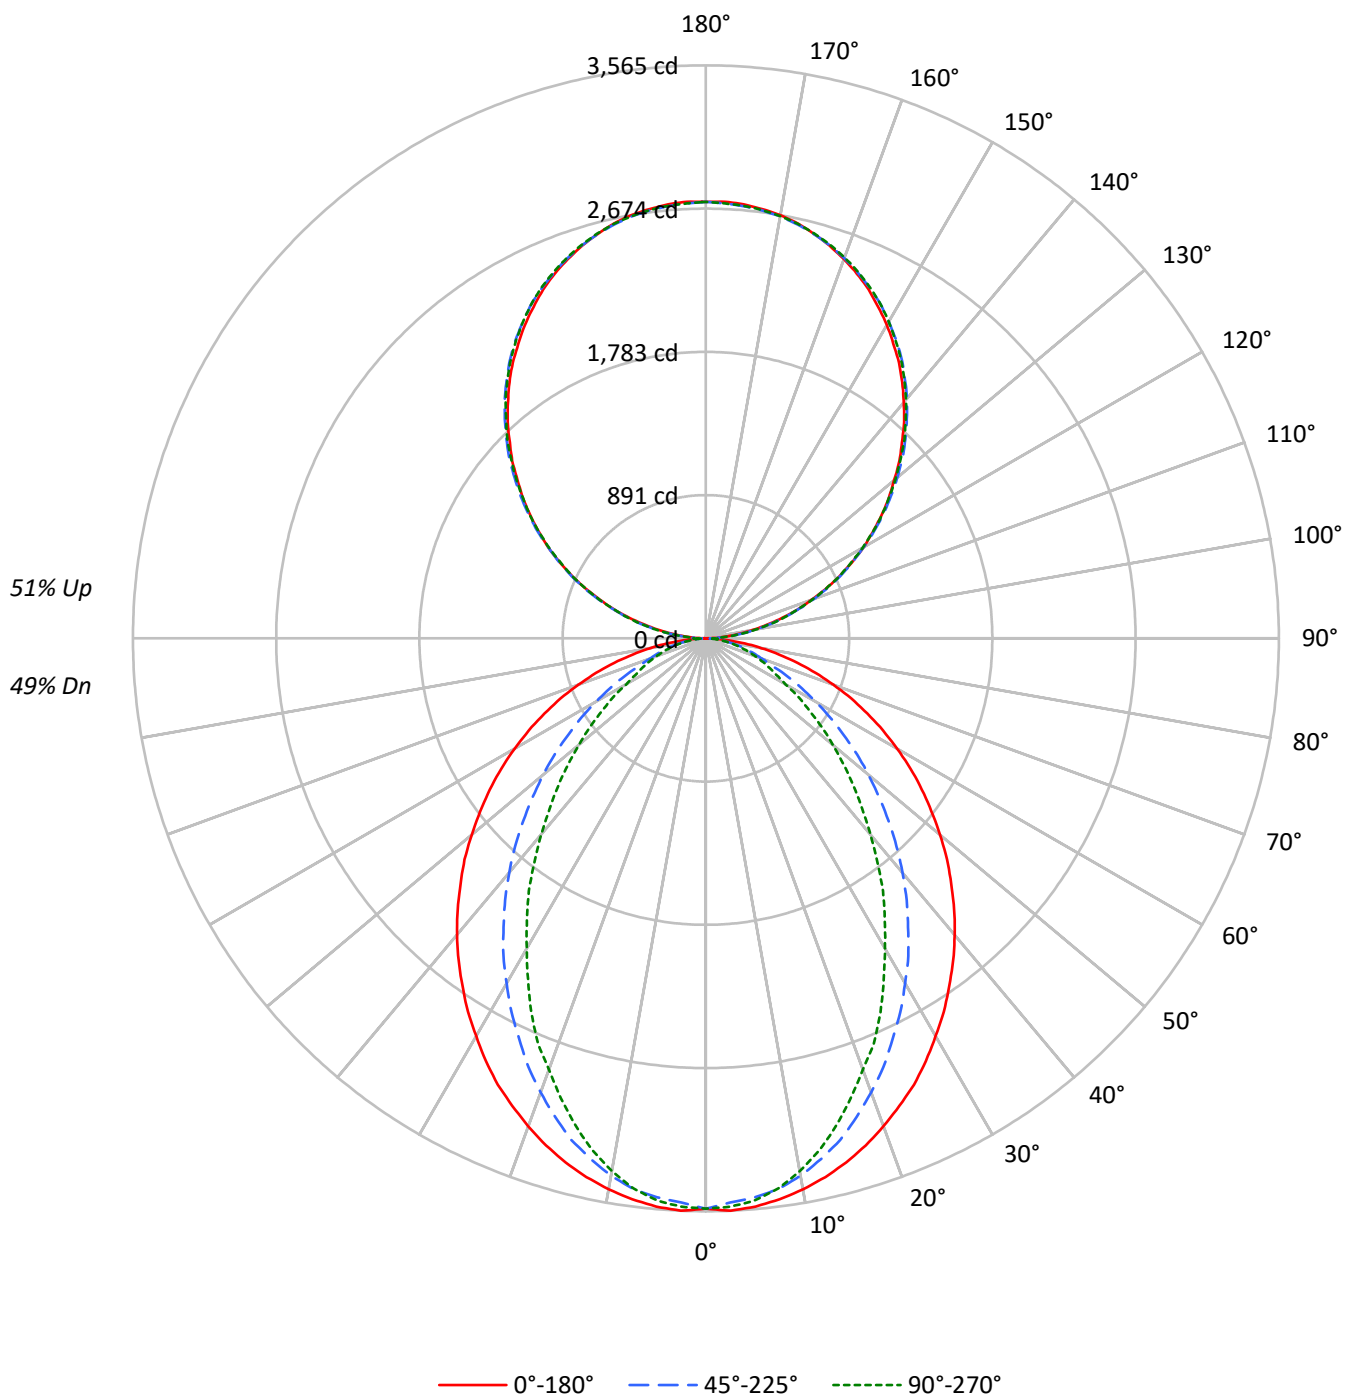

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2490	2490	2490
5°	2494	2451	2467
10°	2469	2403	2387
15°	2435	2324	2264
20°	2390	2215	2112
25°	2344	2093	1966
30°	2282	1968	1779
35°	2222	1833	1616
40°	2160	1693	1428
45°	2088	1538	1258
50°	2014	1381	1092
55°	1937	1214	933
60°	1847	1039	768
65°	1744	861	692
70°	1619	695	628
75°	1462	614	573
80°	1235	517	499
85°	859	348	380

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2138 cd/sqm

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.6	2.2
10°-20°	913.0	6.1
20°-30°	1281.8	8.6
30°-40°	1397.3	9.4
40°-50°	1284.2	8.6
50°-60°	1008.6	6.8
60°-70°	656.5	4.4
70°-80°	337.9	2.3
80°-90°	94.0	0.6
90°-100°	168.0	1.1
100°-110°	533.9	3.6
110°-120°	913.7	6.1
120°-130°	1201.6	8.1
130°-140°	1348.7	9.1
140°-150°	1322.6	8.9
150°-160°	1109.5	7.4
160°-170°	735.8	4.9
170°-180°	257.2	1.7
0°-30°	2527.4	17.0
0°-40°	3924.6	26.3
0°-60°	6217.4	41.7
0°-90°	7305.8	49.0
90°-120°	1615.6	10.8
90°-150°	5488.5	36.8
90°-180°	7591.0	51.0
0°-180°	14896.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3549	3549	3549	3549	3549	
5°	3549	3533	3491	3520	3510	336
15°	3375	3340	3231	3170	3138	951
25°	3064	2961	2749	2617	2569	1409
35°	2640	2476	2194	1991	1920	1652
45°	2158	1943	1606	1378	1300	1667
55°	1641	1390	1044	851	790	1466
65°	1108	848	559	450	440	1099
75°	591	366	257	234	231	625
85°	138	70	61	61	61	158
90°	2	30	80	75	78	15
95°	120	142	146	146	142	133
105°	493	499	504	508	508	520
115°	917	930	926	924	917	907
125°	1334	1354	1348	1340	1338	1192
135°	1725	1750	1755	1753	1746	1333
145°	2094	2110	2124	2126	2117	1308
155°	2394	2401	2408	2420	2413	1102
165°	2605	2602	2602	2619	2607	735
175°	2710	2704	2699	2716	2702	258
180°	2716	2716	2716	2716	2716	

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3548.6	3548.6	3548.6	3548.6	3548.6
2.5°	3564.6	3548.6	3513.1	3545.5	3539.1
5°	3548.6	3532.6	3490.7	3519.6	3510.1
7.5°	3519.6	3500.5	3455.6	3468.2	3452.1
10°	3481.1	3458.6	3394.6	3384.7	3365.6
12.5°	3433.1	3404.2	3317.2	3298.2	3262.7
15°	3375.2	3339.8	3230.7	3169.7	3137.7
17.5°	3307.7	3256.3	3121.3	3050.8	2999.4
20°	3230.7	3166.3	3005.8	2925.7	2854.8
22.5°	3147.2	3073.3	2886.9	2777.9	2729.9
25°	3063.8	2960.8	2749.0	2617.4	2569.0
27.5°	2964.3	2854.8	2620.4	2469.5	2395.6
30°	2858.3	2736.0	2479.1	2315.5	2228.6
32.5°	2755.3	2607.5	2344.5	2151.7	2071.2
35°	2639.9	2476.0	2193.5	1991.2	1920.3
37.5°	2527.4	2350.7	2052.1	1830.3	1750.3
40°	2408.6	2216.0	1904.3	1676.4	1592.9
42.5°	2286.5	2081.2	1756.7	1519.0	1438.8
45°	2158.1	1942.8	1605.8	1377.5	1300.5
47.5°	2036.1	1808.2	1461.3	1233.0	1162.5
50°	1901.2	1673.2	1320.0	1098.1	1031.0
52.5°	1769.4	1528.5	1185.1	973.1	912.1
55°	1640.9	1390.5	1043.6	851.2	790.1
57.5°	1509.4	1252.5	918.6	738.7	687.3
60°	1374.4	1117.5	786.8	623.2	571.7
62.5°	1243.0	986.1	674.3	520.3	494.7
65°	1108.0	847.7	558.8	449.7	439.9
67.5°	979.6	719.2	449.7	394.9	385.3
70°	844.7	594.2	372.4	340.4	327.4
72.5°	716.2	478.3	311.4	285.8	279.4
75°	590.8	366.0	256.9	234.4	231.3
77.5°	465.7	260.0	202.3	189.5	183.0
80°	349.9	186.4	154.0	141.4	141.4
82.5°	243.9	125.4	106.0	99.5	99.5
85°	137.9	70.5	61.0	61.0	61.0
87.5°	51.4	25.6	25.6	22.5	22.5
90°	2.5	29.5	80.2	75.3	77.8
92.5°	50.8	68.8	71.3	73.6	73.6
95°	119.5	142.4	146.5	146.5	142.4
97.5°	198.9	220.2	229.2	229.2	229.2
100°	290.6	309.5	316.0	316.0	313.6
102.5°	387.2	401.2	410.1	412.6	410.1
105°	492.8	499.3	504.3	508.4	508.4
107.5°	597.6	607.4	607.4	609.0	597.6
110°	699.1	712.3	712.3	712.3	705.7

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	808.8	822.7	820.2	813.8	808.8
115°	916.9	930.0	925.9	923.5	916.9
117.5°	1024.1	1042.1	1030.7	1024.1	1017.5
120°	1132.2	1150.1	1132.2	1132.2	1124.8
122.5°	1230.4	1253.4	1241.9	1235.3	1230.4
125°	1333.6	1354.0	1347.5	1340.1	1337.7
127.5°	1434.2	1459.6	1450.7	1440.8	1434.2
130°	1528.4	1557.9	1553.8	1548.8	1539.9
132.5°	1634.0	1656.9	1658.5	1647.1	1640.6
135°	1724.8	1750.2	1755.2	1752.7	1746.2
137.5°	1826.3	1846.8	1851.0	1849.3	1839.5
140°	1915.6	1936.0	1947.5	1947.5	1938.5
142.5°	2007.3	2027.7	2034.3	2036.8	2027.7
145°	2094.1	2110.4	2123.5	2126.0	2117.0
147.5°	2171.9	2192.3	2202.1	2206.2	2197.3
150°	2252.1	2266.0	2275.0	2282.3	2275.0
152.5°	2323.3	2337.2	2348.7	2357.7	2348.7
155°	2394.5	2401.0	2408.5	2419.9	2412.6
157.5°	2455.9	2460.8	2464.9	2481.3	2469.8
160°	2510.7	2515.7	2518.2	2532.0	2522.2
162.5°	2561.5	2561.5	2564.0	2579.5	2568.1
165°	2604.9	2602.4	2602.4	2618.8	2607.4
167.5°	2644.2	2636.9	2636.9	2653.2	2641.7
170°	2673.7	2667.1	2664.7	2681.0	2667.1
172.5°	2694.1	2687.6	2685.1	2701.5	2687.6
175°	2710.5	2703.9	2699.1	2715.5	2701.5
177.5°	2719.5	2713.0	2708.0	2722.0	2708.0
180°	2715.5	2715.5	2715.5	2715.5	2715.5

TEST NUMBER: P925882

CATALOG NUMBER: DFN2DIP-SQ4F0-090D090US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.24	11.06	11.21	12.04	13.33	6.20	7.02	7.17	8.00	9.29
	3H	11.92	12.65	12.90	13.64	14.95	7.39	8.12	8.37	9.11	10.42
	4H	12.53	13.23	13.53	14.22	15.54	7.84	8.53	8.83	9.53	10.84
	6H	12.95	13.59	13.96	14.59	15.92	8.16	8.80	9.17	9.80	11.13
	8H	13.08	13.69	14.10	14.71	16.03	8.25	8.86	9.26	9.87	11.20
	12H	13.15	13.72	14.16	14.73	16.08	8.29	8.87	9.31	9.88	11.23
4H	2H	10.25	10.95	11.26	11.94	13.26	6.79	7.49	7.80	8.48	9.80
	3H	12.09	12.67	13.10	13.69	15.02	8.15	8.72	9.16	9.75	11.08
	4H	12.78	13.31	13.80	14.33	15.68	8.69	9.22	9.71	10.24	11.59
	6H	13.30	13.76	14.33	14.79	16.15	9.11	9.57	10.14	10.61	11.96
	8H	13.48	13.90	14.51	14.94	16.30	9.24	9.67	10.27	10.70	12.06
	12H	13.58	13.96	14.63	15.01	16.38	9.31	9.69	10.36	10.74	12.11
8H	4H	12.75	13.17	13.78	14.21	15.57	8.98	9.40	10.01	10.43	11.80
	6H	13.32	13.67	14.38	14.74	16.11	9.50	9.84	10.55	10.92	12.28
	8H	13.54	13.85	14.60	14.91	16.29	9.69	9.99	10.75	11.05	12.44
	12H	13.68	13.95	14.75	15.01	16.43	9.81	10.08	10.87	11.13	12.56
12H	4H	12.70	13.08	13.75	14.13	15.50	8.98	9.36	10.03	10.41	11.78
	6H	13.30	13.60	14.36	14.66	16.05	9.55	9.85	10.61	10.91	12.29
	8H	13.52	13.79	14.58	14.84	16.27	9.76	10.03	10.82	11.08	12.51

END OF REPORT