

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925897

Luminaire Tested: DFN2DIP-SQ4F0-090D140US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925897
REPORT IS A COMBINATION OF REPORTS P901711 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D140US950-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21722.6 lumens
Efficiency: N/A
Efficacy: 115.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 188.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLLONL

Luminous Intensity Polar Plot

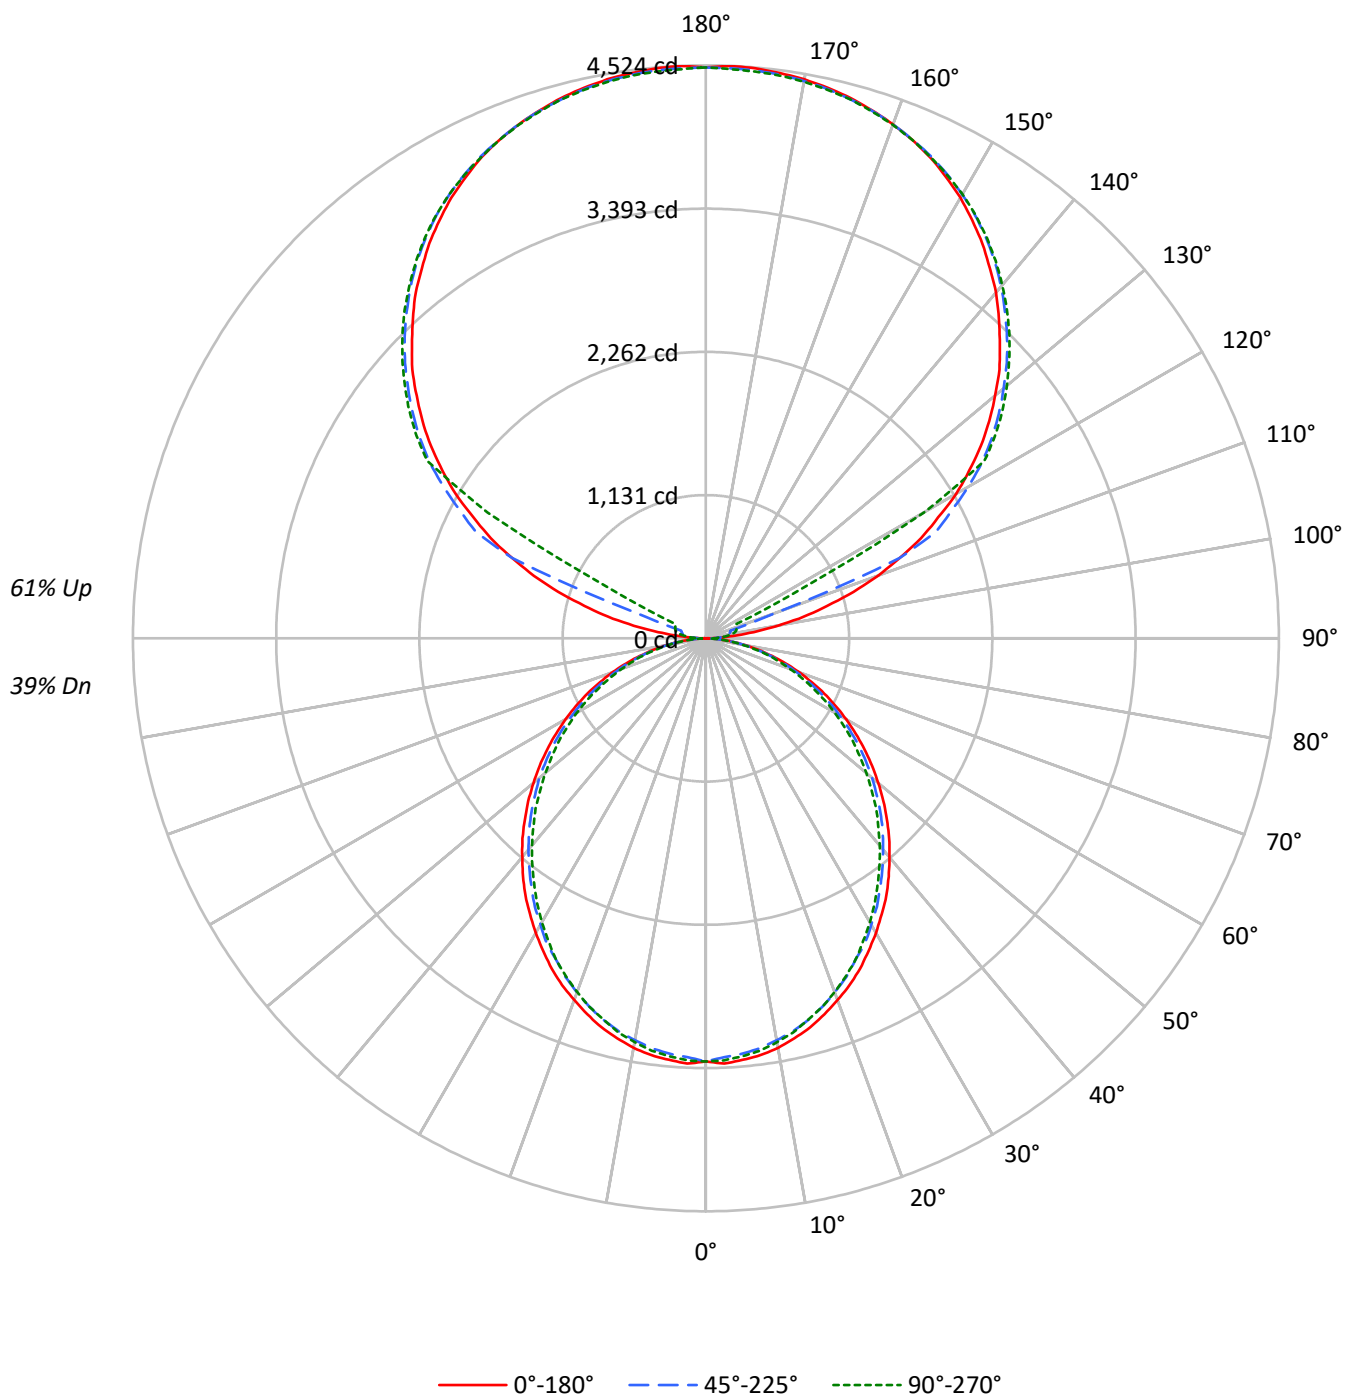

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	87	83	80	77	68	65	63	54	52	51	41	40	39
2	87	80	74	68	79	73	67	63	59	56	52	47	45	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	39	36	32	30	28
4	72	62	54	48	66	56	50	45	46	41	38	37	34	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	30	27	26	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	21	18
7	56	44	37	31	51	41	34	29	34	29	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	18	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2344	2344	2344
5°	2348	2312	2328
10°	2329	2281	2297
15°	2295	2244	2248
20°	2248	2192	2199
25°	2202	2131	2141
30°	2144	2073	2067
35°	2090	2005	1990
40°	2022	1936	1916
45°	1955	1867	1840
50°	1882	1795	1753
55°	1805	1712	1672
60°	1718	1612	1580
65°	1624	1510	1472
70°	1503	1385	1355
75°	1336	1235	1249
80°	1134	1045	1043
85°	820	715	701

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2418 cd/sqm

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	1.4
10°-20°	884.7	4.1
20°-30°	1300.2	6.0
30°-40°	1510.1	7.0
40°-50°	1508.2	6.9
50°-60°	1315.1	6.1
60°-70°	972.2	4.5
70°-80°	550.0	2.5
80°-90°	153.1	0.7
90°-100°	148.7	0.7
100°-110°	554.1	2.6
110°-120°	1469.5	6.8
120°-130°	2437.3	11.2
130°-140°	2588.9	11.9
140°-150°	2406.1	11.1
150°-160°	1934.5	8.9
160°-170°	1246.5	5.7
170°-180°	429.0	2.0
0°-30°	2499.3	11.5
0°-40°	4009.4	18.5
0°-60°	6832.8	31.5
0°-90°	8508.1	39.2
90°-120°	2172.2	10.0
90°-150°	9604.5	44.2
90°-180°	13215.0	60.8
0°-180°	21722.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	3	39	65	82	88	20
95°	212	104	127	144	140	251
105°	992	1090	199	235	248	1059
115°	1875	1931	2012	502	268	1846
125°	2652	2694	2756	2779	2789	2365
135°	3281	3334	3363	3396	3389	2535
145°	3806	3803	3858	3881	3865	2381
155°	4191	4162	4201	4220	4194	1931
165°	4416	4397	4406	4429	4406	1248
175°	4517	4494	4501	4524	4491	430
180°	4508	4508	4508	4508	4508	

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	3.1	39.1	65.1	81.8	88.0
92.5°	81.8	68.6	78.2	84.8	88.0
95°	211.9	104.2	127.1	143.7	140.2
97.5°	381.5	114.3	166.2	176.2	179.4
100°	577.5	130.5	185.9	211.9	218.5
102.5°	792.4	786.2	192.5	228.1	238.2
105°	991.5	1089.5	199.1	234.7	247.8
107.5°	1223.1	1304.4	205.7	241.3	254.4
110°	1445.0	1513.2	570.9	244.8	257.6

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1653.8	1712.2	1656.9	251.0	261.0
115°	1875.4	1930.7	2012.5	502.4	267.6
117.5°	2067.8	2132.9	2188.7	1722.0	867.6
120°	2283.2	2332.0	2390.8	2429.9	1989.6
122.5°	2465.6	2517.9	2583.3	2602.7	2606.2
125°	2651.5	2694.1	2756.1	2778.9	2788.6
127.5°	2821.2	2866.9	2916.0	2948.5	2951.7
130°	2981.1	3033.4	3069.0	3105.1	3101.9
132.5°	3144.2	3186.7	3222.4	3251.8	3248.8
135°	3281.3	3333.6	3362.6	3395.5	3388.9
137.5°	3424.6	3463.7	3496.6	3529.1	3519.5
140°	3564.8	3591.1	3626.7	3656.2	3639.9
142.5°	3682.5	3705.3	3747.6	3773.5	3757.2
145°	3806.5	3802.9	3858.4	3881.3	3864.9
147.5°	3913.8	3904.1	3959.5	3975.7	3962.9
150°	4018.3	3995.4	4047.7	4067.1	4050.9
152.5°	4106.2	4080.3	4129.1	4148.9	4126.0
155°	4191.0	4162.0	4201.1	4220.5	4194.5
157.5°	4259.6	4233.7	4263.1	4285.9	4259.6
160°	4318.5	4298.7	4318.5	4337.8	4315.0
162.5°	4370.4	4351.0	4367.3	4390.1	4360.7
165°	4416.1	4396.7	4406.4	4429.2	4406.4
167.5°	4452.1	4432.4	4442.4	4465.3	4435.8
170°	4481.5	4461.8	4468.3	4491.2	4461.8
172.5°	4500.9	4481.5	4488.1	4511.0	4481.5
175°	4517.2	4494.3	4500.9	4523.8	4491.2
177.5°	4523.8	4500.9	4504.4	4527.2	4497.8
180°	4507.5	4507.5	4507.5	4507.5	4507.5

TEST NUMBER: P925897

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.15	9.92	10.20	10.97	12.39	8.71	9.48	9.75	10.53	11.95
	3H	10.81	11.50	11.86	12.56	14.00	10.32	11.01	11.37	12.07	13.51
	4H	11.40	12.05	12.46	13.11	14.56	10.90	11.56	11.97	12.62	14.06
	6H	11.80	12.40	12.87	13.46	14.92	11.29	11.90	12.37	12.96	14.42
	8H	11.90	12.47	12.98	13.55	15.00	11.40	11.97	12.48	13.05	14.50
	12H	11.95	12.49	13.03	13.57	15.04	11.44	11.98	12.52	13.06	14.53
4H	2H	9.60	10.26	10.68	11.32	12.76	9.25	9.90	10.32	10.96	12.41
	3H	11.47	12.01	12.55	13.10	14.56	11.06	11.60	12.14	12.69	14.15
	4H	12.18	12.68	13.26	13.76	15.24	11.76	12.26	12.84	13.34	14.81
	6H	12.69	13.12	13.79	14.23	15.70	12.26	12.69	13.36	13.79	15.27
	8H	12.84	13.25	13.94	14.34	15.83	12.41	12.81	13.50	13.90	15.39
	12H	12.91	13.28	14.03	14.39	15.88	12.46	12.83	13.58	13.94	15.43
8H	4H	12.37	12.77	13.46	13.87	15.35	11.99	12.39	13.09	13.49	14.98
	6H	13.00	13.33	14.12	14.47	15.95	12.62	12.95	13.73	14.09	15.57
	8H	13.22	13.52	14.35	14.63	16.14	12.83	13.12	13.95	14.24	15.74
	12H	13.35	13.61	14.48	14.72	16.27	12.94	13.20	14.07	14.31	15.85
12H	4H	12.35	12.71	13.46	13.82	15.31	11.98	12.35	13.09	13.45	14.95
	6H	13.03	13.32	14.15	14.44	15.94	12.66	12.95	13.78	14.07	15.57
	8H	13.27	13.53	14.40	14.64	16.18	12.89	13.15	14.02	14.26	15.80

END OF REPORT