

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925899

Luminaire Tested: DFN2DIP-SQ4F0-090D140US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925899
REPORT IS A COMBINATION OF REPORTS P901712 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D140US950-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20520.6 lumens
Efficiency: N/A
Efficacy: 108.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 188.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLLONL

Luminous Intensity Polar Plot

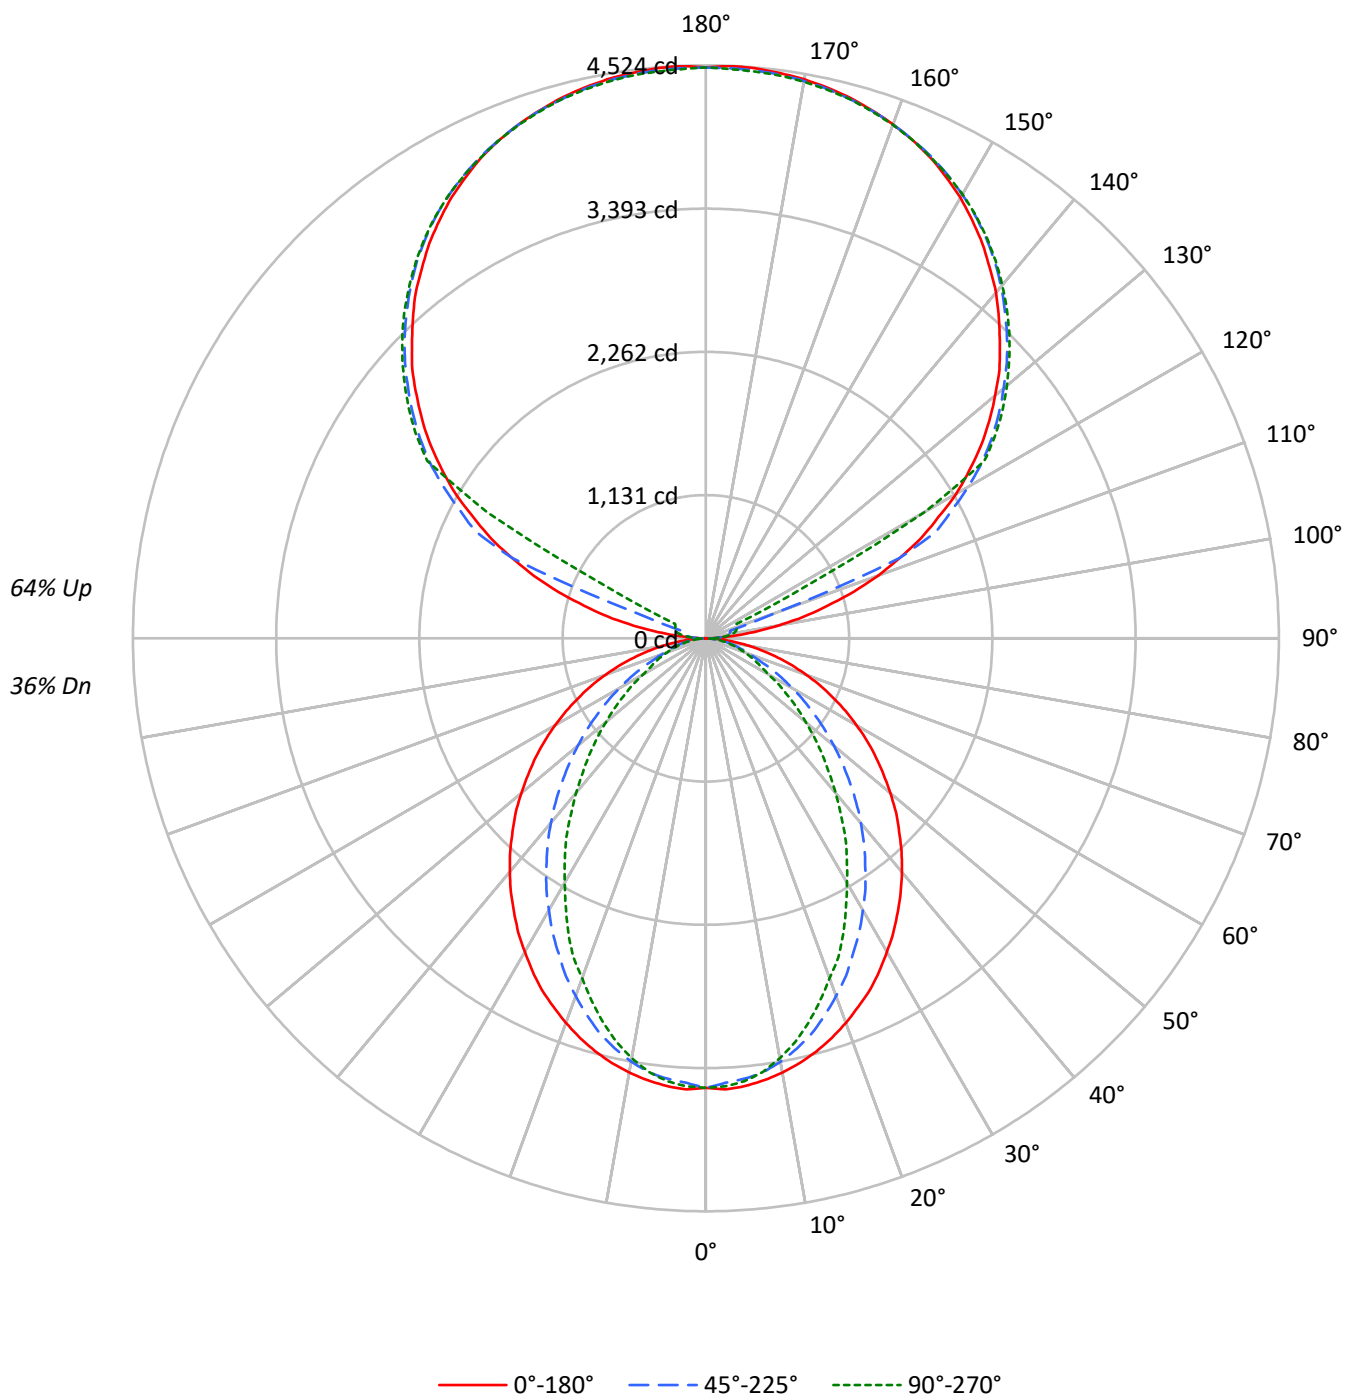

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	91	87	84	86	82	79	76	66	64	62	52	50	49	38	38	37
2	87	80	74	69	78	72	67	63	59	55	52	46	44	42	34	33	32
3	79	70	63	58	71	64	58	53	52	48	44	41	38	36	31	29	27
4	73	62	55	49	66	57	50	45	46	42	38	37	33	31	28	25	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	61	50	42	37	56	46	39	34	37	32	29	30	26	24	23	20	19
7	57	45	37	32	51	41	35	30	34	29	25	27	24	21	21	18	17
8	53	41	34	28	48	38	31	26	31	26	23	25	21	19	19	17	15
9	49	37	30	25	44	34	28	24	28	24	20	23	19	17	18	15	14
10	46	34	27	23	42	31	25	21	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2490	2490	2490
5°	2494	2451	2467
10°	2469	2403	2387
15°	2435	2324	2264
20°	2390	2215	2112
25°	2344	2093	1966
30°	2282	1968	1779
35°	2222	1833	1616
40°	2160	1693	1428
45°	2088	1538	1258
50°	2014	1381	1092
55°	1937	1214	933
60°	1847	1039	768
65°	1744	861	692
70°	1619	695	628
75°	1462	614	573
80°	1235	517	499
85°	859	348	380

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2418 cd/sqm

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.6	1.6
10°-20°	913.0	4.4
20°-30°	1281.8	6.2
30°-40°	1397.3	6.8
40°-50°	1284.2	6.3
50°-60°	1008.6	4.9
60°-70°	656.5	3.2
70°-80°	337.9	1.6
80°-90°	94.2	0.5
90°-100°	148.7	0.7
100°-110°	554.1	2.7
110°-120°	1469.5	7.2
120°-130°	2437.3	11.9
130°-140°	2588.9	12.6
140°-150°	2406.1	11.7
150°-160°	1934.5	9.4
160°-170°	1246.5	6.1
170°-180°	429.0	2.1
0°-30°	2527.4	12.3
0°-40°	3924.6	19.1
0°-60°	6217.4	30.3
0°-90°	7306.1	35.6
90°-120°	2172.2	10.6
90°-150°	9604.5	46.8
90°-180°	13215.0	64.4
0°-180°	20520.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3549	3549	3549	3549	3549	
5°	3549	3533	3491	3520	3510	336
15°	3375	3340	3231	3170	3138	951
25°	3064	2961	2749	2617	2569	1409
35°	2640	2476	2194	1991	1920	1652
45°	2158	1943	1606	1378	1300	1667
55°	1641	1390	1044	851	790	1466
65°	1108	848	559	450	440	1099
75°	591	366	257	234	231	625
85°	138	70	61	61	61	158
90°	3	39	65	82	88	19
95°	212	104	127	144	140	251
105°	992	1090	199	235	248	1059
115°	1875	1931	2012	502	268	1846
125°	2652	2694	2756	2779	2789	2365
135°	3281	3334	3363	3396	3389	2535
145°	3806	3803	3858	3881	3865	2381
155°	4191	4162	4201	4220	4194	1931
165°	4416	4397	4406	4429	4406	1248
175°	4517	4494	4501	4524	4491	430
180°	4508	4508	4508	4508	4508	

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3548.6	3548.6	3548.6	3548.6	3548.6
2.5°	3564.6	3548.6	3513.1	3545.5	3539.1
5°	3548.6	3532.6	3490.7	3519.6	3510.1
7.5°	3519.6	3500.5	3455.6	3468.2	3452.1
10°	3481.1	3458.6	3394.6	3384.7	3365.6
12.5°	3433.1	3404.2	3317.2	3298.2	3262.7
15°	3375.2	3339.8	3230.7	3169.7	3137.7
17.5°	3307.7	3256.3	3121.3	3050.8	2999.4
20°	3230.7	3166.3	3005.8	2925.7	2854.8
22.5°	3147.2	3073.3	2886.9	2777.9	2729.9
25°	3063.8	2960.8	2749.0	2617.4	2569.0
27.5°	2964.3	2854.8	2620.4	2469.5	2395.6
30°	2858.3	2736.0	2479.1	2315.5	2228.6
32.5°	2755.3	2607.5	2344.5	2151.7	2071.2
35°	2639.9	2476.0	2193.5	1991.2	1920.3
37.5°	2527.4	2350.7	2052.1	1830.3	1750.3
40°	2408.6	2216.0	1904.3	1676.4	1592.9
42.5°	2286.5	2081.2	1756.7	1519.0	1438.8
45°	2158.1	1942.8	1605.8	1377.5	1300.5
47.5°	2036.1	1808.2	1461.3	1233.0	1162.5
50°	1901.2	1673.2	1320.0	1098.1	1031.0
52.5°	1769.4	1528.5	1185.1	973.1	912.1
55°	1640.9	1390.5	1043.6	851.2	790.1
57.5°	1509.4	1252.5	918.6	738.7	687.3
60°	1374.4	1117.5	786.8	623.2	571.7
62.5°	1243.0	986.1	674.3	520.3	494.7
65°	1108.0	847.7	558.8	449.7	439.9
67.5°	979.6	719.2	449.7	394.9	385.3
70°	844.7	594.2	372.4	340.4	327.4
72.5°	716.2	478.3	311.4	285.8	279.4
75°	590.8	366.0	256.9	234.4	231.3
77.5°	465.7	260.0	202.3	189.5	183.0
80°	349.9	186.4	154.0	141.4	141.4
82.5°	243.9	125.4	106.0	99.5	99.5
85°	137.9	70.5	61.0	61.0	61.0
87.5°	51.4	25.6	25.6	22.5	22.5
90°	3.1	39.1	65.1	81.8	88.0
92.5°	81.8	68.6	78.2	84.8	88.0
95°	211.9	104.2	127.1	143.7	140.2
97.5°	381.5	114.3	166.2	176.2	179.4
100°	577.5	130.5	185.9	211.9	218.5
102.5°	792.4	786.2	192.5	228.1	238.2
105°	991.5	1089.5	199.1	234.7	247.8
107.5°	1223.1	1304.4	205.7	241.3	254.4
110°	1445.0	1513.2	570.9	244.8	257.6

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1653.8	1712.2	1656.9	251.0	261.0
115°	1875.4	1930.7	2012.5	502.4	267.6
117.5°	2067.8	2132.9	2188.7	1722.0	867.6
120°	2283.2	2332.0	2390.8	2429.9	1989.6
122.5°	2465.6	2517.9	2583.3	2602.7	2606.2
125°	2651.5	2694.1	2756.1	2778.9	2788.6
127.5°	2821.2	2866.9	2916.0	2948.5	2951.7
130°	2981.1	3033.4	3069.0	3105.1	3101.9
132.5°	3144.2	3186.7	3222.4	3251.8	3248.8
135°	3281.3	3333.6	3362.6	3395.5	3388.9
137.5°	3424.6	3463.7	3496.6	3529.1	3519.5
140°	3564.8	3591.1	3626.7	3656.2	3639.9
142.5°	3682.5	3705.3	3747.6	3773.5	3757.2
145°	3806.5	3802.9	3858.4	3881.3	3864.9
147.5°	3913.8	3904.1	3959.5	3975.7	3962.9
150°	4018.3	3995.4	4047.7	4067.1	4050.9
152.5°	4106.2	4080.3	4129.1	4148.9	4126.0
155°	4191.0	4162.0	4201.1	4220.5	4194.5
157.5°	4259.6	4233.7	4263.1	4285.9	4259.6
160°	4318.5	4298.7	4318.5	4337.8	4315.0
162.5°	4370.4	4351.0	4367.3	4390.1	4360.7
165°	4416.1	4396.7	4406.4	4429.2	4406.4
167.5°	4452.1	4432.4	4442.4	4465.3	4435.8
170°	4481.5	4461.8	4468.3	4491.2	4461.8
172.5°	4500.9	4481.5	4488.1	4511.0	4481.5
175°	4517.2	4494.3	4500.9	4523.8	4491.2
177.5°	4523.8	4500.9	4504.4	4527.2	4497.8
180°	4507.5	4507.5	4507.5	4507.5	4507.5

TEST NUMBER: P925899

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.81	9.54	9.89	10.61	12.08	4.78	5.50	5.85	6.57	8.04
	3H	10.49	11.14	11.57	12.22	13.70	5.96	6.60	7.04	7.69	9.17
	4H	11.10	11.71	12.19	12.79	14.28	6.40	7.02	7.50	8.10	9.59
	6H	11.52	12.08	12.62	13.17	14.67	6.72	7.28	7.82	8.37	9.87
	8H	11.64	12.18	12.75	13.28	14.78	6.81	7.34	7.92	8.45	9.94
	12H	11.70	12.21	12.81	13.31	14.83	6.85	7.36	7.96	8.45	9.97
4H	2H	8.82	9.43	9.92	10.52	12.01	5.36	5.97	6.46	7.06	8.55
	3H	10.64	11.16	11.75	12.27	13.77	6.70	7.21	7.81	8.32	9.83
	4H	11.34	11.80	12.45	12.91	14.43	7.25	7.72	8.36	8.82	10.34
	6H	11.85	12.25	12.97	13.38	14.89	7.66	8.06	8.78	9.19	10.70
	8H	12.03	12.40	13.15	13.52	15.05	7.79	8.16	8.91	9.28	10.81
	12H	12.12	12.46	13.26	13.59	15.12	7.85	8.19	8.99	9.32	10.85
8H	4H	11.30	11.67	12.42	12.79	14.32	7.52	7.90	8.64	9.01	10.54
	6H	11.86	12.17	13.01	13.33	14.86	8.04	8.35	9.18	9.50	11.03
	8H	12.08	12.35	13.23	13.49	15.04	8.23	8.50	9.38	9.64	11.19
	12H	12.22	12.46	13.37	13.59	15.18	8.34	8.58	9.50	9.72	11.30
12H	4H	11.24	11.58	12.38	12.71	14.25	7.52	7.86	8.66	8.99	10.53
	6H	11.84	12.11	12.99	13.25	14.79	8.09	8.36	9.24	9.50	11.04
	8H	12.06	12.29	13.21	13.43	15.01	8.29	8.53	9.45	9.67	11.25

END OF REPORT