

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925925

Luminaire Tested: DFN2DIP-SQ4F0-100D110US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925925
REPORT IS A COMBINATION OF REPORTS P901677 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D110US950-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19833.7 lumens
Efficiency: N/A
Efficacy: 113.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLLONL

Luminous Intensity Polar Plot

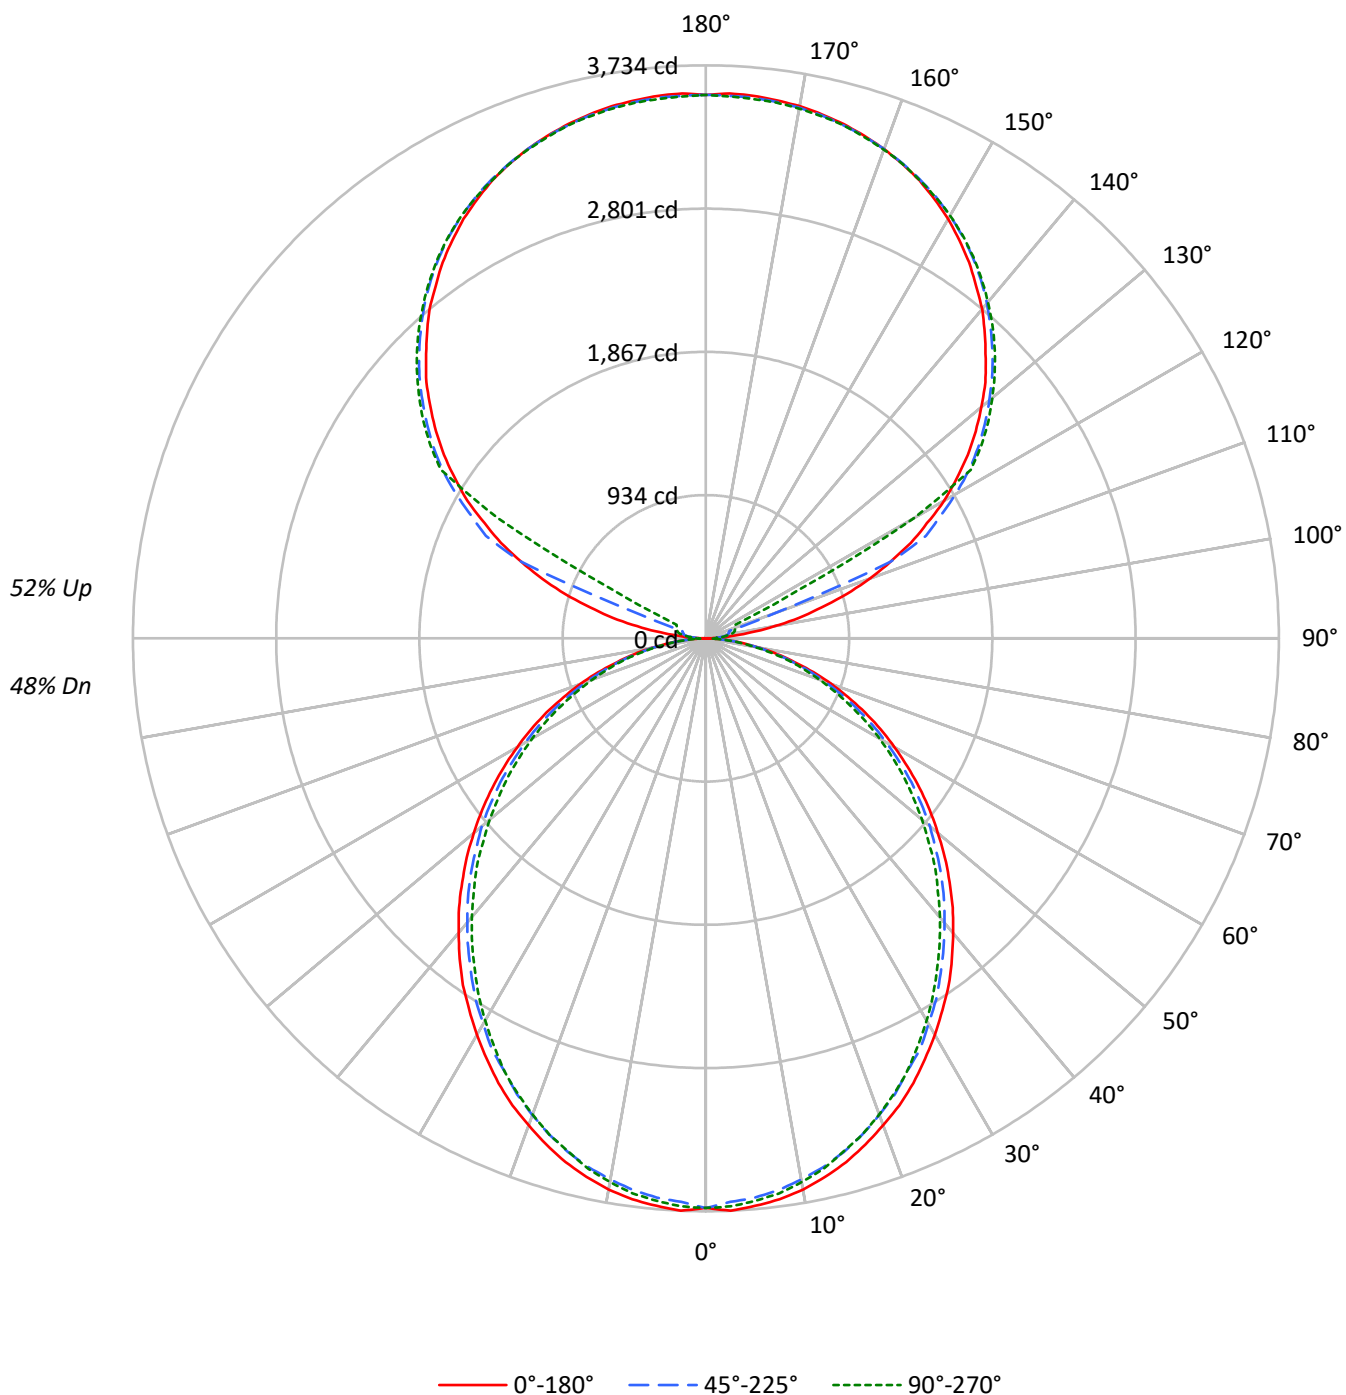

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	86	89	86	82	79	72	70	67	59	58	56	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	25
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	30	26	30	26	23	25	22	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	19	17	20	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2605	2605	2605
5°	2609	2569	2586
10°	2588	2535	2552
15°	2550	2494	2498
20°	2498	2436	2443
25°	2447	2367	2379
30°	2383	2303	2297
35°	2322	2228	2211
40°	2247	2151	2129
45°	2173	2075	2045
50°	2091	1995	1947
55°	2006	1902	1858
60°	1909	1792	1756
65°	1804	1678	1635
70°	1670	1539	1506
75°	1484	1373	1387
80°	1260	1161	1159
85°	911	794	779

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2173 cd/sqm

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	349.4	1.8
10°-20°	983.0	5.0
20°-30°	1444.7	7.3
30°-40°	1677.9	8.5
40°-50°	1675.8	8.4
50°-60°	1461.2	7.4
60°-70°	1080.2	5.4
70°-80°	611.1	3.1
80°-90°	167.6	0.8
90°-100°	116.8	0.6
100°-110°	435.4	2.2
110°-120°	1154.6	5.8
120°-130°	1915.0	9.7
130°-140°	2034.2	10.3
140°-150°	1890.5	9.5
150°-160°	1519.9	7.7
160°-170°	979.4	4.9
170°-180°	337.1	1.7
0°-30°	2777.1	14.0
0°-40°	4454.9	22.5
0°-60°	7592.0	38.3
0°-90°	9450.8	47.7
90°-120°	1706.7	8.6
90°-150°	7546.4	38.0
90°-180°	10383.0	52.4
0°-180°	19833.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3712	3712	3712	3712	3712	
5°	3712	3698	3659	3687	3680	352
15°	3534	3512	3466	3480	3462	995
25°	3198	3170	3109	3116	3109	1472
35°	2759	2724	2666	2645	2627	1723
45°	2245	2220	2166	2128	2113	1733
55°	1699	1678	1635	1592	1574	1519
65°	1146	1124	1089	1057	1039	1133
75°	600	593	574	553	560	640
85°	146	143	139	128	125	163
90°	2	31	51	64	69	18
95°	166	82	100	113	110	197
105°	779	856	156	184	195	832
115°	1474	1517	1581	395	210	1451
125°	2083	2117	2166	2183	2191	1858
135°	2578	2619	2642	2668	2663	1992
145°	2991	2988	3032	3050	3037	1871
155°	3293	3270	3301	3316	3296	1517
165°	3470	3454	3462	3480	3462	980
175°	3549	3531	3536	3554	3529	338
180°	3542	3542	3542	3542	3542	

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3712.1	3712.1	3712.1	3712.1	3712.1
2.5°	3733.7	3715.8	3676.4	3712.1	3705.2
5°	3712.1	3698.1	3658.7	3687.1	3680.2
7.5°	3687.1	3665.8	3626.4	3655.3	3648.1
10°	3648.1	3623.1	3580.3	3608.7	3598.1
12.5°	3594.3	3573.1	3530.3	3548.1	3540.9
15°	3533.7	3512.5	3465.9	3480.3	3462.5
17.5°	3458.7	3437.5	3390.9	3408.7	3390.9
20°	3376.5	3355.3	3305.3	3315.9	3301.9
22.5°	3294.7	3262.6	3215.9	3215.9	3208.8
25°	3198.2	3169.8	3109.2	3116.0	3109.2
27.5°	3091.0	3066.0	3019.8	3009.2	2991.4
30°	2984.2	2955.4	2902.0	2891.4	2877.0
32.5°	2869.8	2848.6	2791.4	2769.8	2755.4
35°	2759.3	2723.7	2666.4	2644.9	2627.0
37.5°	2634.3	2602.0	2544.9	2519.9	2502.1
40°	2505.9	2477.1	2419.9	2388.1	2373.7
42.5°	2380.9	2352.1	2295.3	2259.4	2238.2
45°	2245.3	2220.3	2166.5	2127.5	2113.2
47.5°	2113.2	2088.2	2031.0	1991.6	1970.4
50°	1973.8	1956.0	1906.0	1856.0	1838.3
52.5°	1838.3	1813.3	1767.0	1727.7	1702.7
55°	1699.3	1677.7	1634.9	1592.0	1574.3
57.5°	1559.9	1542.0	1495.5	1452.8	1438.3
60°	1420.5	1406.5	1356.5	1317.1	1306.5
62.5°	1284.9	1259.9	1224.4	1188.8	1174.4
65°	1145.9	1124.4	1088.8	1056.6	1038.8
67.5°	1003.2	985.0	953.2	928.2	913.8
70°	871.0	856.6	824.4	799.5	785.4
72.5°	735.4	721.0	703.3	678.3	667.6
75°	599.5	592.7	574.5	553.3	560.5
77.5°	478.3	463.9	456.7	446.1	435.5
80°	357.1	353.4	346.1	335.5	328.4
82.5°	242.8	242.8	239.4	225.0	225.0
85°	146.2	142.8	139.4	128.4	125.0
87.5°	64.4	57.1	50.0	39.4	35.6
90°	2.5	30.7	51.1	64.2	69.1
92.5°	64.2	53.9	61.4	66.7	69.1
95°	166.5	81.9	99.8	112.9	110.2
97.5°	299.7	89.8	130.5	138.4	140.9
100°	453.7	102.6	146.1	166.5	171.6
102.5°	622.6	617.7	151.2	179.3	187.2
105°	779.0	856.0	156.5	184.4	194.8
107.5°	961.1	1024.9	161.6	189.6	200.0
110°	1135.4	1189.0	448.6	192.3	202.3

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1299.4	1345.3	1301.8	197.2	205.1
115°	1473.5	1517.0	1581.3	394.7	210.3
117.5°	1624.8	1675.9	1719.7	1353.0	681.6
120°	1793.9	1832.3	1878.5	1909.2	1563.2
122.5°	1937.3	1978.3	2029.7	2045.0	2047.8
125°	2083.3	2116.8	2165.5	2183.4	2191.1
127.5°	2216.6	2252.5	2291.1	2316.7	2319.2
130°	2342.3	2383.4	2411.3	2439.7	2437.3
132.5°	2470.4	2503.9	2531.9	2555.0	2552.6
135°	2578.2	2619.2	2642.0	2668.0	2662.7
137.5°	2690.8	2721.5	2747.3	2772.9	2765.3
140°	2800.9	2821.6	2849.6	2872.7	2859.9
142.5°	2893.4	2911.3	2944.5	2964.9	2952.2
145°	2990.8	2988.0	3031.5	3049.6	3036.8
147.5°	3075.1	3067.5	3111.0	3123.8	3113.8
150°	3157.3	3139.3	3180.3	3195.6	3182.8
152.5°	3226.3	3205.9	3244.3	3259.8	3241.9
155°	3293.0	3270.1	3300.8	3316.1	3295.7
157.5°	3346.8	3326.4	3349.6	3367.5	3346.8
160°	3393.1	3377.5	3393.1	3408.3	3390.3
162.5°	3433.8	3418.7	3431.4	3449.4	3426.3
165°	3469.8	3454.5	3462.2	3480.1	3462.2
167.5°	3498.0	3482.6	3490.5	3508.4	3485.3
170°	3521.2	3505.7	3510.8	3528.8	3505.7
172.5°	3536.4	3521.2	3526.4	3544.3	3521.2
175°	3549.2	3531.2	3536.4	3554.4	3528.8
177.5°	3554.4	3536.4	3539.1	3557.1	3534.0
180°	3541.6	3541.6	3541.6	3541.6	3541.6

TEST NUMBER: P925925

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.39	11.23	11.37	12.22	13.52	9.94	10.79	10.92	11.78	13.08
	3H	12.05	12.81	13.04	13.81	15.13	11.56	12.32	12.55	13.32	14.64
	4H	12.64	13.36	13.64	14.36	15.69	12.15	12.86	13.15	13.86	15.20
	6H	13.04	13.70	14.06	14.71	16.06	12.54	13.20	13.56	14.21	15.56
	8H	13.15	13.78	14.17	14.80	16.14	12.65	13.27	13.67	14.30	15.64
	12H	13.20	13.79	14.22	14.81	16.18	12.69	13.29	13.71	14.30	15.67
4H	2H	10.85	11.56	11.86	12.56	13.90	10.49	11.21	11.50	12.21	13.54
	3H	12.72	13.31	13.73	14.34	15.69	12.31	12.91	13.33	13.94	15.28
	4H	13.43	13.98	14.46	15.00	16.37	13.01	13.56	14.03	14.58	15.95
	6H	13.95	14.42	14.99	15.47	16.84	13.52	13.99	14.55	15.04	16.40
	8H	14.10	14.54	15.14	15.58	16.96	13.67	14.10	14.70	15.14	16.53
	12H	14.18	14.57	15.23	15.63	17.02	13.73	14.12	14.78	15.18	16.57
8H	4H	13.63	14.07	14.66	15.11	16.49	13.25	13.69	14.29	14.73	16.11
	6H	14.26	14.63	15.32	15.71	17.09	13.88	14.24	14.94	15.33	16.70
	8H	14.49	14.81	15.55	15.87	17.27	14.10	14.41	15.16	15.48	16.88
	12H	14.62	14.90	15.69	15.96	17.40	14.21	14.49	15.28	15.55	16.99
12H	4H	13.61	14.01	14.67	15.06	16.45	13.25	13.64	14.30	14.70	16.08
	6H	14.29	14.61	15.36	15.68	17.08	13.92	14.24	14.99	15.31	16.71
	8H	14.54	14.82	15.61	15.88	17.32	14.16	14.44	15.23	15.50	16.94

END OF REPORT