

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925926

Luminaire Tested: DFN2DIP-SQ4F0-100D110US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925926
REPORT IS A COMBINATION OF REPORTS P900158 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D110US950-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17396.2 lumens
Efficiency: N/A
Efficacy: 99.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLFLL

Luminous Intensity Polar Plot

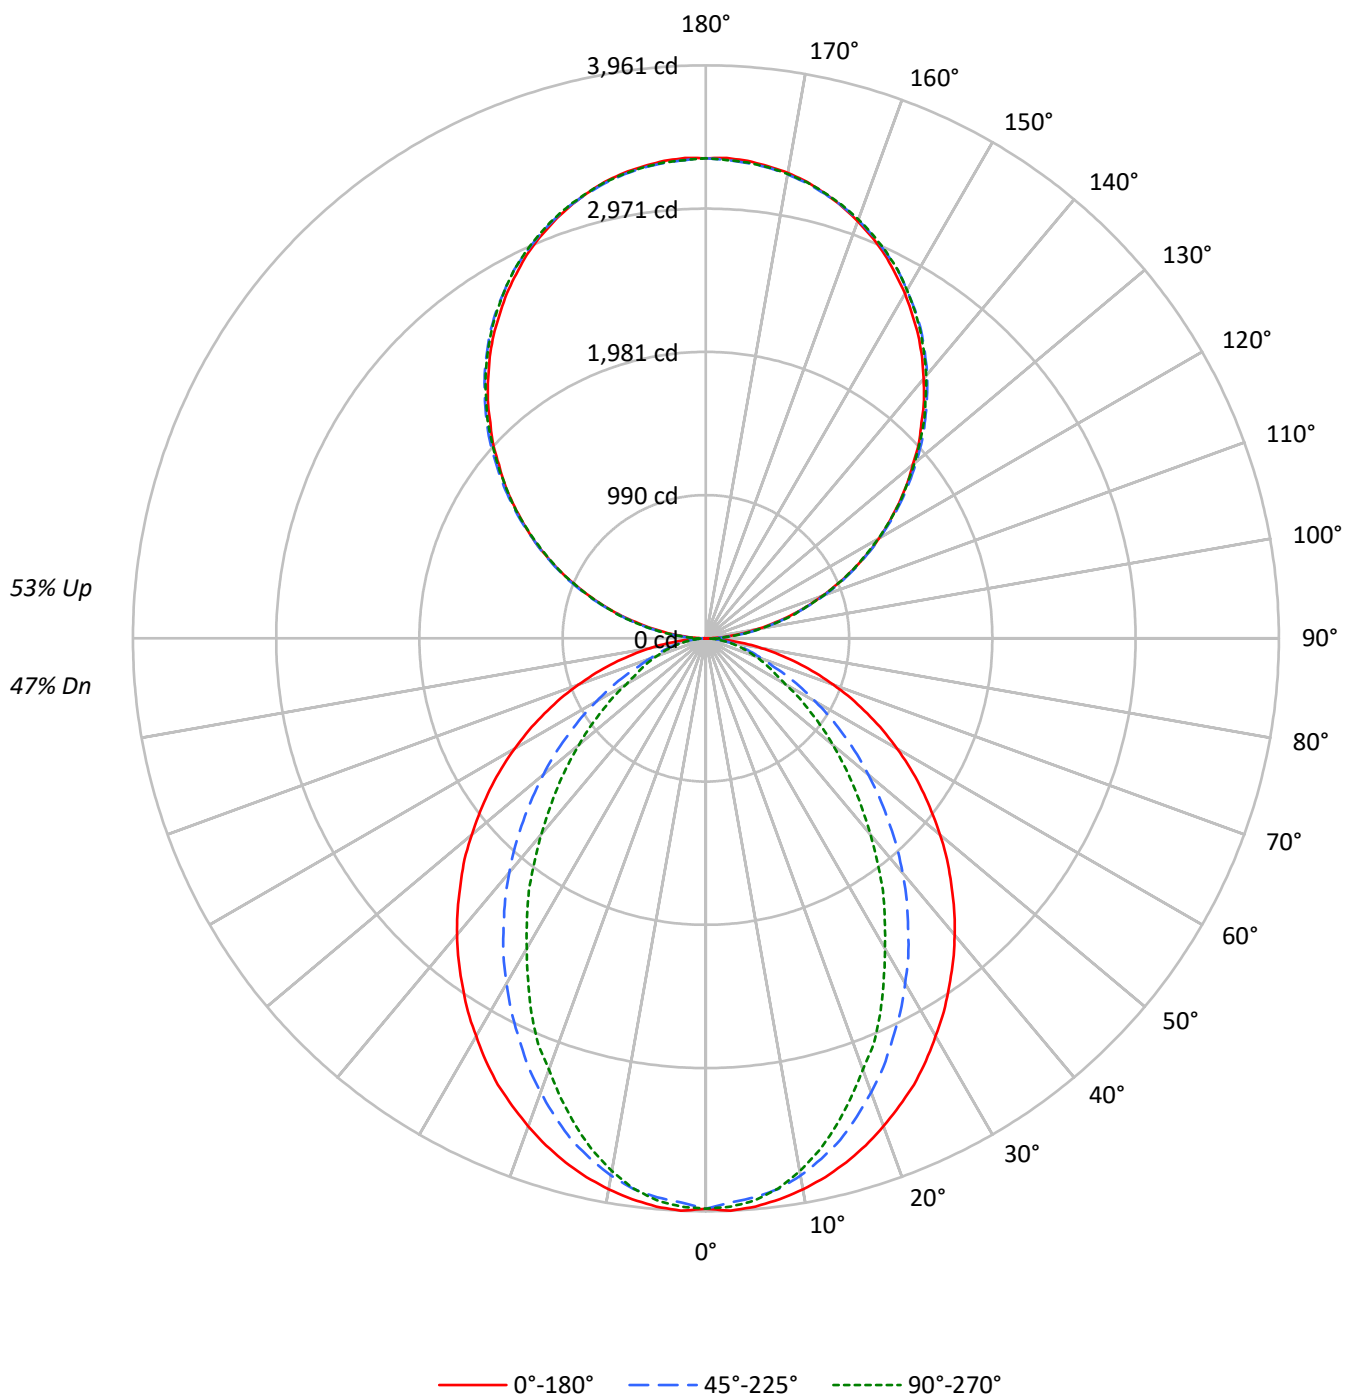

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	67	67	67	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	48	47	46
2	89	82	76	71	82	76	71	66	64	60	57	53	50	48	42	41	39
3	82	72	65	60	75	67	61	56	57	52	48	47	44	41	38	36	34
4	75	64	57	51	69	60	53	48	51	46	42	42	38	35	34	32	30
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	64	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	32	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	23	27	23	20	22	19	17
10	48	36	29	24	44	34	27	23	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2767	2767	2767
5°	2771	2723	2741
10°	2744	2670	2653
15°	2706	2583	2515
20°	2656	2462	2347
25°	2605	2326	2184
30°	2536	2186	1977
35°	2468	2036	1796
40°	2400	1881	1587
45°	2320	1709	1398
50°	2238	1535	1214
55°	2152	1349	1036
60°	2052	1155	854
65°	1938	957	769
70°	1799	772	698
75°	1625	682	636
80°	1372	574	555
85°	955	386	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2611 cd/sqm

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.5	2.1
10°-20°	1014.4	5.8
20°-30°	1424.2	8.2
30°-40°	1552.5	8.9
40°-50°	1426.9	8.2
50°-60°	1120.6	6.4
60°-70°	729.4	4.2
70°-80°	375.5	2.2
80°-90°	105.3	0.6
90°-100°	205.4	1.2
100°-110°	652.5	3.8
110°-120°	1116.7	6.4
120°-130°	1468.6	8.4
130°-140°	1648.4	9.5
140°-150°	1616.5	9.3
150°-160°	1356.0	7.8
160°-170°	899.3	5.2
170°-180°	314.3	1.8
0°-30°	2808.2	16.1
0°-40°	4360.7	25.1
0°-60°	6908.2	39.7
0°-90°	8118.4	46.7
90°-120°	1974.6	11.4
90°-150°	6708.2	38.6
90°-180°	9278.0	53.3
0°-180°	17396.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3943	3943	3943	3943	3943	
5°	3943	3925	3878	3911	3900	374
15°	3750	3711	3590	3522	3486	1057
25°	3404	3290	3054	2908	2854	1566
35°	2933	2751	2437	2212	2134	1836
45°	2398	2159	1784	1531	1445	1852
55°	1823	1545	1160	946	878	1629
65°	1231	942	621	500	489	1221
75°	656	407	285	260	257	694
85°	153	78	68	68	68	176
90°	3	36	98	92	95	17
95°	146	174	179	179	174	163
105°	602	610	616	621	621	636
115°	1121	1137	1132	1129	1121	1108
125°	1630	1655	1647	1638	1635	1457
135°	2108	2139	2145	2142	2134	1630
145°	2559	2579	2596	2598	2587	1599
155°	2927	2935	2944	2958	2949	1347
165°	3184	3181	3181	3201	3187	898
175°	3313	3305	3299	3319	3302	315
180°	3319	3319	3319	3319	3319	

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3942.9	3942.9	3942.9	3942.9	3942.9
2.5°	3960.6	3942.9	3903.5	3939.4	3932.3
5°	3942.9	3925.0	3878.5	3910.7	3900.0
7.5°	3910.7	3889.5	3839.5	3853.5	3835.7
10°	3867.9	3842.9	3771.7	3760.8	3739.6
12.5°	3814.6	3782.3	3685.8	3664.6	3625.2
15°	3750.2	3710.8	3589.6	3521.9	3486.3
17.5°	3675.2	3618.0	3468.2	3389.8	3332.6
20°	3589.6	3518.1	3339.8	3250.9	3172.0
22.5°	3496.9	3414.7	3207.6	3086.6	3033.1
25°	3404.2	3289.9	3054.3	2908.2	2854.5
27.5°	3293.6	3172.0	2911.6	2743.9	2661.8
30°	3175.9	3039.9	2754.5	2572.8	2476.3
32.5°	3061.6	2897.2	2605.0	2390.7	2301.3
35°	2933.2	2751.1	2437.3	2212.4	2133.6
37.5°	2808.3	2611.8	2280.2	2033.7	1944.7
40°	2676.2	2462.3	2115.9	1862.6	1769.9
42.5°	2540.6	2312.3	1952.0	1687.7	1598.7
45°	2397.9	2158.6	1784.3	1530.6	1445.0
47.5°	2262.4	2009.1	1623.7	1370.0	1291.7
50°	2112.4	1859.2	1466.6	1220.2	1145.6
52.5°	1965.9	1698.3	1316.7	1081.2	1013.4
55°	1823.2	1545.0	1159.6	945.7	877.9
57.5°	1677.1	1391.6	1020.7	820.7	763.6
60°	1527.2	1241.7	874.2	692.4	635.3
62.5°	1381.0	1095.6	749.2	578.1	549.7
65°	1231.1	941.9	620.9	499.7	488.7
67.5°	1088.4	799.2	499.7	438.7	428.2
70°	938.4	660.3	413.7	378.2	363.9
72.5°	795.7	531.5	346.0	317.6	310.4
75°	656.4	406.6	285.4	260.4	257.0
77.5°	517.5	288.9	224.9	210.5	203.3
80°	388.8	207.1	171.1	157.1	157.1
82.5°	271.0	139.3	117.7	110.6	110.6
85°	153.3	78.3	67.7	67.7	67.7
87.5°	57.1	28.4	28.4	25.0	25.0
90°	3.0	36.1	98.1	92.1	95.0
92.5°	62.0	84.0	87.0	90.1	90.1
95°	146.1	174.1	179.1	179.1	174.1
97.5°	243.2	269.1	280.2	280.2	280.2
100°	355.2	378.2	386.2	386.2	383.2
102.5°	473.3	490.3	501.3	504.3	501.3
105°	602.4	610.4	616.4	621.3	621.3
107.5°	730.4	742.4	742.4	744.4	730.4
110°	854.5	870.5	870.5	870.5	862.5

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	988.5	1005.5	1002.6	994.5	988.5
115°	1120.7	1136.6	1131.6	1128.7	1120.7
117.5°	1251.7	1273.7	1259.7	1251.7	1243.7
120°	1383.8	1405.8	1383.8	1383.8	1374.8
122.5°	1503.9	1531.8	1517.8	1509.8	1503.9
125°	1629.9	1654.9	1646.9	1637.9	1634.9
127.5°	1753.0	1784.0	1773.0	1761.0	1753.0
130°	1868.0	1904.1	1899.0	1893.0	1882.1
132.5°	1997.1	2025.2	2027.2	2013.1	2005.1
135°	2108.1	2139.2	2145.2	2142.2	2134.2
137.5°	2232.3	2257.3	2262.2	2260.2	2248.3
140°	2341.3	2366.3	2380.3	2380.3	2369.4
142.5°	2453.4	2478.4	2486.4	2489.4	2478.4
145°	2559.4	2579.4	2595.5	2598.4	2587.4
147.5°	2654.5	2679.5	2691.5	2696.5	2685.5
150°	2752.6	2769.6	2780.5	2789.6	2780.5
152.5°	2839.6	2856.6	2870.6	2881.7	2870.6
155°	2926.7	2934.6	2943.7	2957.7	2948.6
157.5°	3001.7	3007.7	3012.6	3032.7	3018.6
160°	3068.7	3074.7	3077.7	3094.8	3082.8
162.5°	3130.7	3130.7	3133.8	3152.8	3138.8
165°	3183.8	3180.7	3180.7	3200.8	3186.7
167.5°	3231.8	3222.8	3222.8	3242.8	3228.8
170°	3267.8	3259.8	3256.9	3276.8	3259.8
172.5°	3292.8	3284.8	3281.9	3301.9	3284.8
175°	3312.9	3304.8	3298.8	3318.9	3301.9
177.5°	3323.8	3315.8	3309.8	3326.9	3309.8
180°	3318.9	3318.9	3318.9	3318.9	3318.9

TEST NUMBER: P925926

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.37	11.18	11.37	12.18	13.50	6.33	7.14	7.33	8.14	9.46
	3H	12.05	12.77	13.06	13.78	15.12	7.52	8.24	8.52	9.25	10.59
	4H	12.66	13.34	13.68	14.35	15.70	7.97	8.65	8.99	9.66	11.01
	6H	13.09	13.71	14.11	14.73	16.09	8.29	8.92	9.32	9.93	11.29
	8H	13.22	13.81	14.25	14.84	16.20	8.38	8.98	9.41	10.01	11.37
	12H	13.28	13.84	14.31	14.87	16.25	8.42	8.99	9.46	10.02	11.40
4H	2H	10.39	11.07	11.41	12.08	13.43	6.93	7.61	7.95	8.62	9.97
	3H	12.22	12.79	13.25	13.83	15.19	8.28	8.84	9.31	9.88	11.25
	4H	12.91	13.43	13.95	14.46	15.85	8.82	9.34	9.86	10.37	11.76
	6H	13.43	13.88	14.48	14.93	16.31	9.24	9.69	10.29	10.74	12.12
	8H	13.61	14.02	14.66	15.07	16.47	9.37	9.79	10.42	10.83	12.23
	12H	13.71	14.08	14.77	15.14	16.54	9.44	9.81	10.50	10.87	12.28
8H	4H	12.88	13.29	13.93	14.34	15.74	9.11	9.52	10.15	10.57	11.96
	6H	13.45	13.79	14.52	14.88	16.28	9.62	9.97	10.70	11.06	12.45
	8H	13.67	13.97	14.75	15.04	16.46	9.82	10.12	10.89	11.19	12.60
	12H	13.81	14.07	14.89	15.14	16.60	9.94	10.20	11.02	11.27	12.72
12H	4H	12.83	13.21	13.90	14.27	15.67	9.11	9.48	10.18	10.55	11.95
	6H	13.43	13.73	14.50	14.80	16.21	9.67	9.98	10.75	11.05	12.46
	8H	13.65	13.91	14.73	14.98	16.44	9.89	10.15	10.97	11.22	12.67

END OF REPORT