

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925927

Luminaire Tested: DFN2DIP-SQ4F0-100D110US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925927
REPORT IS A COMBINATION OF REPORTS P901678 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D110US950-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18498.0 lumens
Efficiency: N/A
Efficacy: 105.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLONL

Luminous Intensity Polar Plot

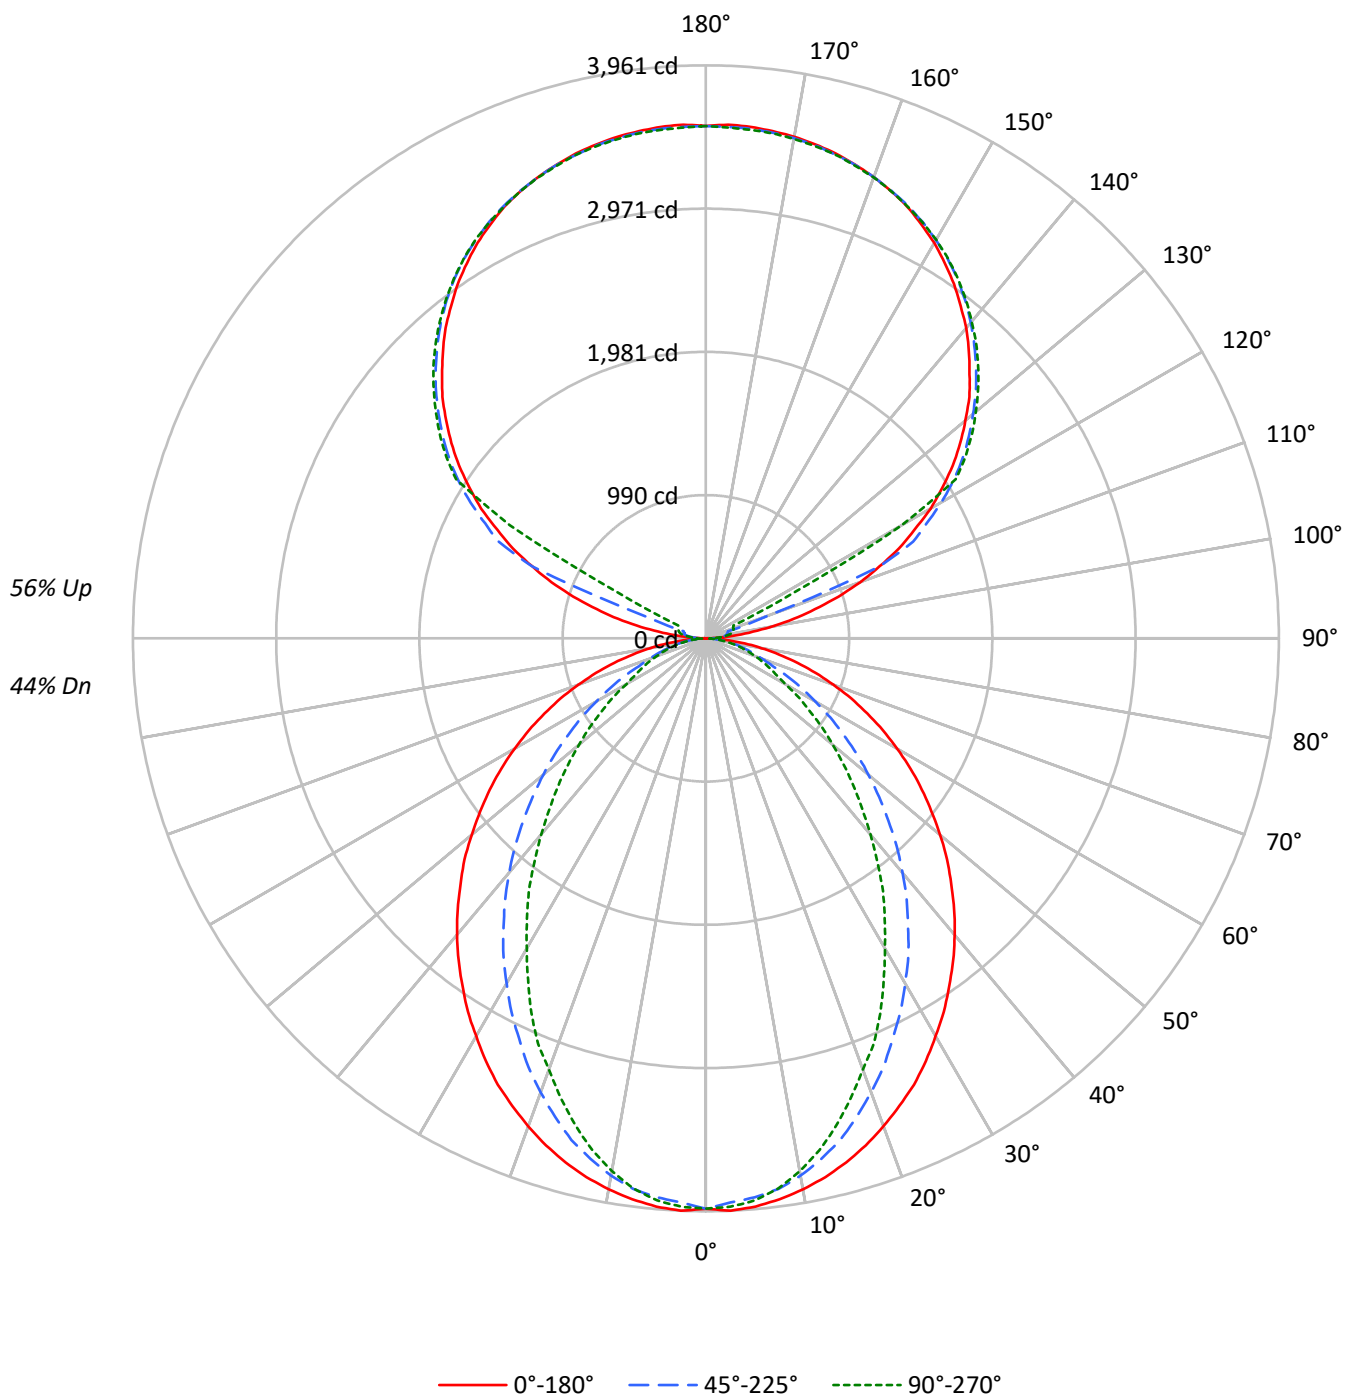

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	50	50	50
1	97	93	89	86	89	85	82	79	71	68	66	57	56	55	45	44	43
2	89	81	76	71	81	75	70	66	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	40	36	34	32
4	74	64	56	51	68	59	52	47	49	45	41	41	37	34	33	30	28
5	68	57	49	44	62	53	46	41	44	39	35	37	33	30	30	27	25
6	63	51	44	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	37	31	27	30	26	24	25	22	20
8	54	42	35	30	50	39	33	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2767	2767	2767
5°	2771	2723	2741
10°	2744	2670	2653
15°	2706	2583	2515
20°	2656	2462	2347
25°	2605	2326	2184
30°	2536	2186	1977
35°	2468	2036	1796
40°	2400	1881	1587
45°	2320	1709	1398
50°	2238	1535	1214
55°	2152	1349	1036
60°	2052	1155	854
65°	1938	957	769
70°	1799	772	698
75°	1625	682	636
80°	1372	574	555
85°	955	386	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2320 cd/sqm

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.5	2.0
10°-20°	1014.4	5.5
20°-30°	1424.2	7.7
30°-40°	1552.5	8.4
40°-50°	1426.9	7.7
50°-60°	1120.6	6.1
60°-70°	729.4	3.9
70°-80°	375.5	2.0
80°-90°	102.1	0.6
90°-100°	116.8	0.6
100°-110°	435.4	2.4
110°-120°	1154.6	6.2
120°-130°	1915.0	10.4
130°-140°	2034.2	11.0
140°-150°	1890.5	10.2
150°-160°	1519.9	8.2
160°-170°	979.4	5.3
170°-180°	337.1	1.8
0°-30°	2808.2	15.2
0°-40°	4360.7	23.6
0°-60°	6908.2	37.3
0°-90°	8115.2	43.9
90°-120°	1706.7	9.2
90°-150°	7546.4	40.8
90°-180°	10383.0	56.1
0°-180°	18498.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3943	3943	3943	3943	3943	
5°	3943	3925	3878	3911	3900	374
15°	3750	3711	3590	3522	3486	1057
25°	3404	3290	3054	2908	2854	1566
35°	2933	2751	2437	2212	2134	1836
45°	2398	2159	1784	1531	1445	1852
55°	1823	1545	1160	946	878	1629
65°	1231	942	621	500	489	1221
75°	656	407	285	260	257	694
85°	153	78	68	68	68	176
90°	2	31	51	64	69	17
95°	166	82	100	113	110	197
105°	779	856	156	184	195	832
115°	1474	1517	1581	395	210	1451
125°	2083	2117	2166	2183	2191	1858
135°	2578	2619	2642	2668	2663	1992
145°	2991	2988	3032	3050	3037	1871
155°	3293	3270	3301	3316	3296	1517
165°	3470	3454	3462	3480	3462	980
175°	3549	3531	3536	3554	3529	338
180°	3542	3542	3542	3542	3542	

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3942.9	3942.9	3942.9	3942.9	3942.9
2.5°	3960.6	3942.9	3903.5	3939.4	3932.3
5°	3942.9	3925.0	3878.5	3910.7	3900.0
7.5°	3910.7	3889.5	3839.5	3853.5	3835.7
10°	3867.9	3842.9	3771.7	3760.8	3739.6
12.5°	3814.6	3782.3	3685.8	3664.6	3625.2
15°	3750.2	3710.8	3589.6	3521.9	3486.3
17.5°	3675.2	3618.0	3468.2	3389.8	3332.6
20°	3589.6	3518.1	3339.8	3250.9	3172.0
22.5°	3496.9	3414.7	3207.6	3086.6	3033.1
25°	3404.2	3289.9	3054.3	2908.2	2854.5
27.5°	3293.6	3172.0	2911.6	2743.9	2661.8
30°	3175.9	3039.9	2754.5	2572.8	2476.3
32.5°	3061.6	2897.2	2605.0	2390.7	2301.3
35°	2933.2	2751.1	2437.3	2212.4	2133.6
37.5°	2808.3	2611.8	2280.2	2033.7	1944.7
40°	2676.2	2462.3	2115.9	1862.6	1769.9
42.5°	2540.6	2312.3	1952.0	1687.7	1598.7
45°	2397.9	2158.6	1784.3	1530.6	1445.0
47.5°	2262.4	2009.1	1623.7	1370.0	1291.7
50°	2112.4	1859.2	1466.6	1220.2	1145.6
52.5°	1965.9	1698.3	1316.7	1081.2	1013.4
55°	1823.2	1545.0	1159.6	945.7	877.9
57.5°	1677.1	1391.6	1020.7	820.7	763.6
60°	1527.2	1241.7	874.2	692.4	635.3
62.5°	1381.0	1095.6	749.2	578.1	549.7
65°	1231.1	941.9	620.9	499.7	488.7
67.5°	1088.4	799.2	499.7	438.7	428.2
70°	938.4	660.3	413.7	378.2	363.9
72.5°	795.7	531.5	346.0	317.6	310.4
75°	656.4	406.6	285.4	260.4	257.0
77.5°	517.5	288.9	224.9	210.5	203.3
80°	388.8	207.1	171.1	157.1	157.1
82.5°	271.0	139.3	117.7	110.6	110.6
85°	153.3	78.3	67.7	67.7	67.7
87.5°	57.1	28.4	28.4	25.0	25.0
90°	2.5	30.7	51.1	64.2	69.1
92.5°	64.2	53.9	61.4	66.7	69.1
95°	166.5	81.9	99.8	112.9	110.2
97.5°	299.7	89.8	130.5	138.4	140.9
100°	453.7	102.6	146.1	166.5	171.6
102.5°	622.6	617.7	151.2	179.3	187.2
105°	779.0	856.0	156.5	184.4	194.8
107.5°	961.1	1024.9	161.6	189.6	200.0
110°	1135.4	1189.0	448.6	192.3	202.3

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1299.4	1345.3	1301.8	197.2	205.1
115°	1473.5	1517.0	1581.3	394.7	210.3
117.5°	1624.8	1675.9	1719.7	1353.0	681.6
120°	1793.9	1832.3	1878.5	1909.2	1563.2
122.5°	1937.3	1978.3	2029.7	2045.0	2047.8
125°	2083.3	2116.8	2165.5	2183.4	2191.1
127.5°	2216.6	2252.5	2291.1	2316.7	2319.2
130°	2342.3	2383.4	2411.3	2439.7	2437.3
132.5°	2470.4	2503.9	2531.9	2555.0	2552.6
135°	2578.2	2619.2	2642.0	2668.0	2662.7
137.5°	2690.8	2721.5	2747.3	2772.9	2765.3
140°	2800.9	2821.6	2849.6	2872.7	2859.9
142.5°	2893.4	2911.3	2944.5	2964.9	2952.2
145°	2990.8	2988.0	3031.5	3049.6	3036.8
147.5°	3075.1	3067.5	3111.0	3123.8	3113.8
150°	3157.3	3139.3	3180.3	3195.6	3182.8
152.5°	3226.3	3205.9	3244.3	3259.8	3241.9
155°	3293.0	3270.1	3300.8	3316.1	3295.7
157.5°	3346.8	3326.4	3349.6	3367.5	3346.8
160°	3393.1	3377.5	3393.1	3408.3	3390.3
162.5°	3433.8	3418.7	3431.4	3449.4	3426.3
165°	3469.8	3454.5	3462.2	3480.1	3462.2
167.5°	3498.0	3482.6	3490.5	3508.4	3485.3
170°	3521.2	3505.7	3510.8	3528.8	3505.7
172.5°	3536.4	3521.2	3526.4	3544.3	3521.2
175°	3549.2	3531.2	3536.4	3554.4	3528.8
177.5°	3554.4	3536.4	3539.1	3557.1	3534.0
180°	3541.6	3541.6	3541.6	3541.6	3541.6

TEST NUMBER: P925927

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.09	10.88	11.11	11.90	13.26	6.05	6.84	7.07	7.86	9.22
	3H	11.77	12.47	12.80	13.50	14.88	7.24	7.94	8.27	8.97	10.35
	4H	12.38	13.04	13.42	14.08	15.46	7.69	8.35	8.73	9.38	10.77
	6H	12.81	13.41	13.85	14.45	15.85	8.01	8.62	9.06	9.65	11.05
	8H	12.93	13.51	13.98	14.56	15.96	8.10	8.68	9.15	9.73	11.12
	12H	12.99	13.54	14.05	14.59	16.01	8.14	8.69	9.20	9.74	11.15
4H	2H	10.11	10.77	11.15	11.80	13.19	6.65	7.31	7.69	8.34	9.73
	3H	11.94	12.49	12.99	13.55	14.95	7.99	8.54	9.05	9.60	11.00
	4H	12.63	13.13	13.69	14.18	15.61	8.54	9.04	9.60	10.10	11.52
	6H	13.15	13.58	14.21	14.65	16.07	8.96	9.39	10.03	10.46	11.88
	8H	13.32	13.73	14.39	14.79	16.23	9.09	9.49	10.15	10.56	11.99
	12H	13.42	13.78	14.50	14.86	16.30	9.15	9.51	10.23	10.59	12.03
8H	4H	12.59	13.00	13.66	14.06	15.50	8.82	9.22	9.89	10.29	11.72
	6H	13.16	13.50	14.25	14.61	16.03	9.34	9.67	10.43	10.78	12.21
	8H	13.38	13.68	14.48	14.77	16.22	9.53	9.82	10.63	10.91	12.36
	12H	13.52	13.78	14.62	14.87	16.35	9.65	9.90	10.75	10.99	12.48
12H	4H	12.54	12.91	13.63	13.99	15.43	8.82	9.19	9.91	10.27	11.70
	6H	13.14	13.43	14.24	14.52	15.97	9.39	9.68	10.49	10.77	12.22
	8H	13.36	13.62	14.46	14.70	16.19	9.60	9.85	10.70	10.94	12.43

END OF REPORT