

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925931

Luminaire Tested: DFN2DIP-SQ4F0-100D120US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925931
REPORT IS A COMBINATION OF REPORTS P901696 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D120US950-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19442.5 lumens
Efficiency: N/A
Efficacy: 106.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 182.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLLONL

Luminous Intensity Polar Plot

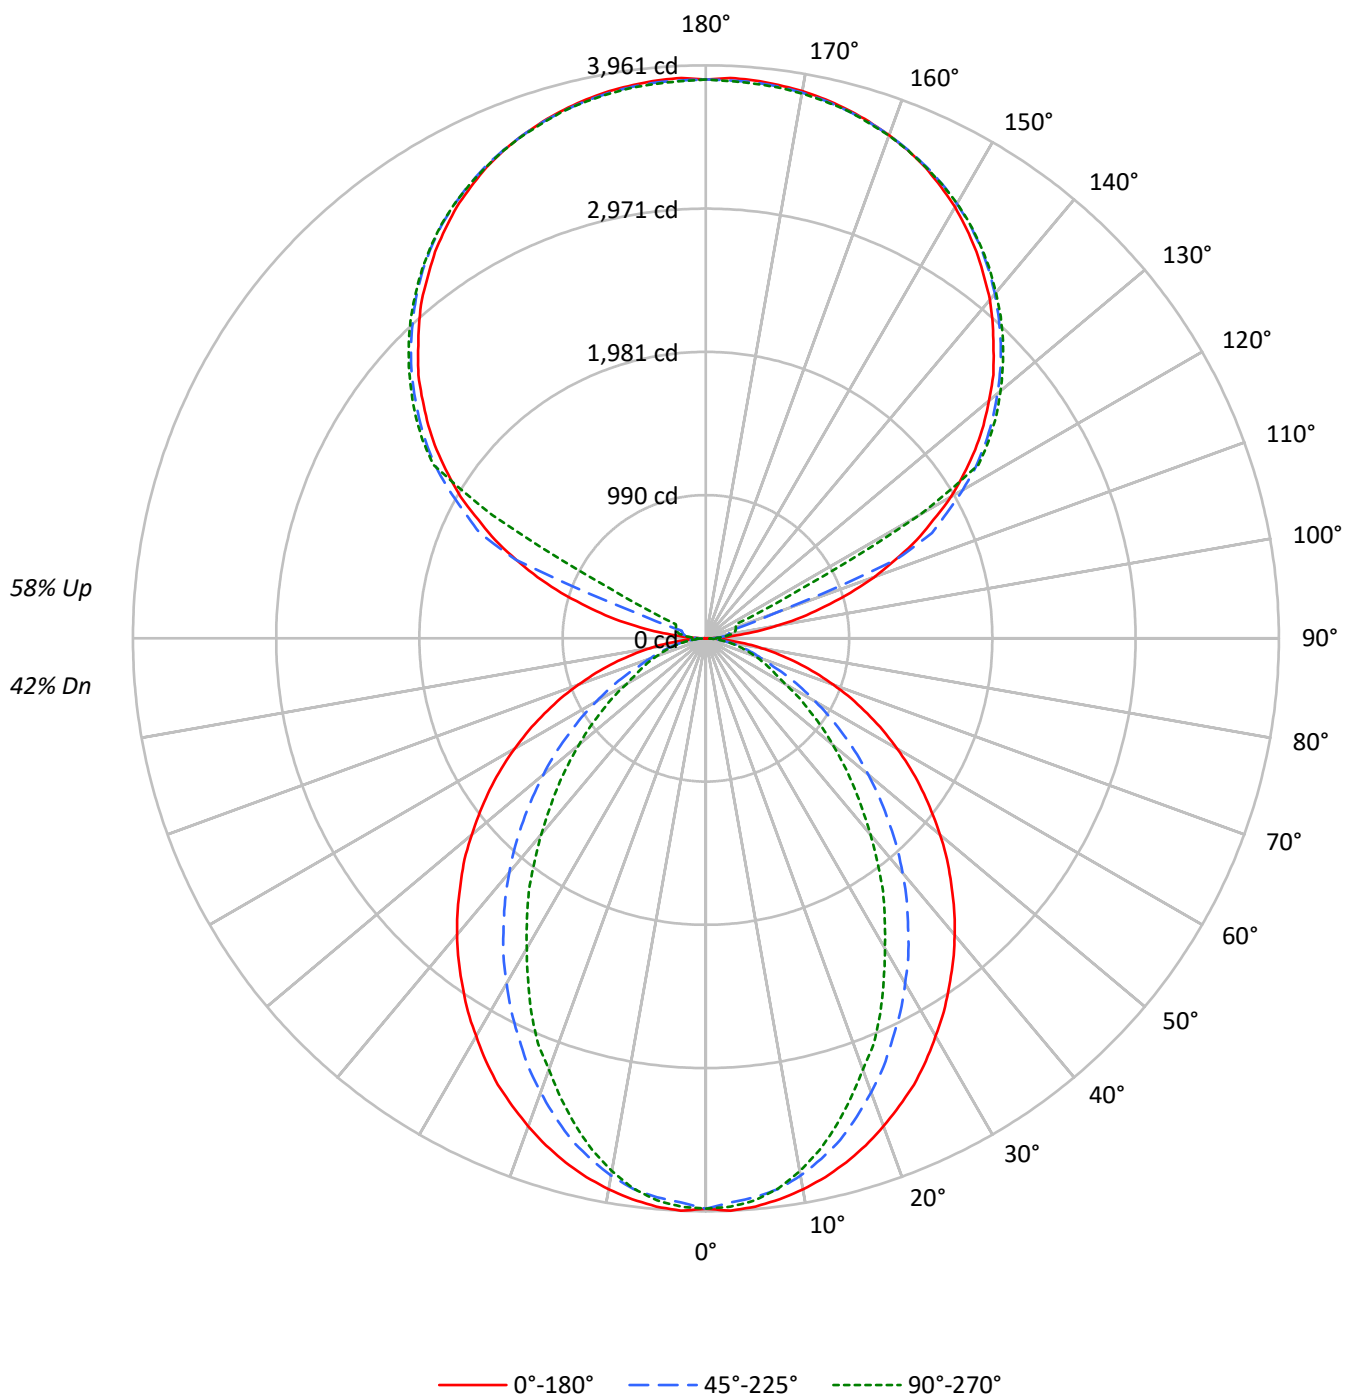

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2767	2767	2767
5°	2771	2723	2741
10°	2744	2670	2653
15°	2706	2583	2515
20°	2656	2462	2347
25°	2605	2326	2184
30°	2536	2186	1977
35°	2468	2036	1796
40°	2400	1881	1587
45°	2320	1709	1398
50°	2238	1535	1214
55°	2152	1349	1036
60°	2052	1155	854
65°	1938	957	769
70°	1799	772	698
75°	1625	682	636
80°	1372	574	555
85°	955	386	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2320 cd/sqm

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	369.5	1.9
10°-20°	1014.4	5.2
20°-30°	1424.2	7.3
30°-40°	1552.5	8.0
40°-50°	1426.9	7.3
50°-60°	1120.6	5.8
60°-70°	729.4	3.8
70°-80°	375.5	1.9
80°-90°	102.6	0.5
90°-100°	127.4	0.7
100°-110°	474.9	2.4
110°-120°	1259.5	6.5
120°-130°	2089.1	10.7
130°-140°	2219.1	11.4
140°-150°	2062.4	10.6
150°-160°	1658.1	8.5
160°-170°	1068.4	5.5
170°-180°	367.7	1.9
0°-30°	2808.2	14.4
0°-40°	4360.7	22.4
0°-60°	6908.2	35.5
0°-90°	8115.8	41.7
90°-120°	1861.9	9.6
90°-150°	8232.4	42.3
90°-180°	11327.0	58.3
0°-180°	19442.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3943	3943	3943	3943	3943	
5°	3943	3925	3878	3911	3900	374
15°	3750	3711	3590	3522	3486	1057
25°	3404	3290	3054	2908	2854	1566
35°	2933	2751	2437	2212	2134	1836
45°	2398	2159	1784	1531	1445	1852
55°	1823	1545	1160	946	878	1629
65°	1231	942	621	500	489	1221
75°	656	407	285	260	257	694
85°	153	78	68	68	68	176
90°	3	34	56	70	75	18
95°	182	89	109	123	120	215
105°	850	934	171	201	212	908
115°	1607	1655	1725	430	229	1582
125°	2273	2309	2362	2382	2390	2027
135°	2812	2857	2882	2910	2905	2173
145°	3263	3260	3307	3327	3313	2041
155°	3592	3567	3601	3618	3595	1655
165°	3785	3769	3777	3796	3777	1069
175°	3872	3852	3858	3878	3850	368
180°	3864	3864	3864	3864	3864	

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3942.9	3942.9	3942.9	3942.9	3942.9
2.5°	3960.6	3942.9	3903.5	3939.4	3932.3
5°	3942.9	3925.0	3878.5	3910.7	3900.0
7.5°	3910.7	3889.5	3839.5	3853.5	3835.7
10°	3867.9	3842.9	3771.7	3760.8	3739.6
12.5°	3814.6	3782.3	3685.8	3664.6	3625.2
15°	3750.2	3710.8	3589.6	3521.9	3486.3
17.5°	3675.2	3618.0	3468.2	3389.8	3332.6
20°	3589.6	3518.1	3339.8	3250.9	3172.0
22.5°	3496.9	3414.7	3207.6	3086.6	3033.1
25°	3404.2	3289.9	3054.3	2908.2	2854.5
27.5°	3293.6	3172.0	2911.6	2743.9	2661.8
30°	3175.9	3039.9	2754.5	2572.8	2476.3
32.5°	3061.6	2897.2	2605.0	2390.7	2301.3
35°	2933.2	2751.1	2437.3	2212.4	2133.6
37.5°	2808.3	2611.8	2280.2	2033.7	1944.7
40°	2676.2	2462.3	2115.9	1862.6	1769.9
42.5°	2540.6	2312.3	1952.0	1687.7	1598.7
45°	2397.9	2158.6	1784.3	1530.6	1445.0
47.5°	2262.4	2009.1	1623.7	1370.0	1291.7
50°	2112.4	1859.2	1466.6	1220.2	1145.6
52.5°	1965.9	1698.3	1316.7	1081.2	1013.4
55°	1823.2	1545.0	1159.6	945.7	877.9
57.5°	1677.1	1391.6	1020.7	820.7	763.6
60°	1527.2	1241.7	874.2	692.4	635.3
62.5°	1381.0	1095.6	749.2	578.1	549.7
65°	1231.1	941.9	620.9	499.7	488.7
67.5°	1088.4	799.2	499.7	438.7	428.2
70°	938.4	660.3	413.7	378.2	363.9
72.5°	795.7	531.5	346.0	317.6	310.4
75°	656.4	406.6	285.4	260.4	257.0
77.5°	517.5	288.9	224.9	210.5	203.3
80°	388.8	207.1	171.1	157.1	157.1
82.5°	271.0	139.3	117.7	110.6	110.6
85°	153.3	78.3	67.7	67.7	67.7
87.5°	57.1	28.4	28.4	25.0	25.0
90°	2.7	33.5	55.8	70.0	75.4
92.5°	70.0	58.8	67.1	72.7	75.4
95°	181.5	89.3	108.9	123.2	120.2
97.5°	327.0	98.0	142.4	151.0	153.7
100°	494.9	111.9	159.3	181.5	187.3
102.5°	679.2	673.9	164.9	195.6	204.2
105°	849.8	933.9	170.7	201.2	212.5
107.5°	1048.4	1118.1	176.3	206.8	218.1
110°	1238.6	1297.1	489.3	209.8	220.8

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1417.5	1467.6	1420.2	215.1	223.7
115°	1607.4	1654.9	1724.9	430.5	229.4
117.5°	1772.4	1828.2	1876.0	1475.9	743.6
120°	1957.0	1998.8	2049.3	2082.9	1705.4
122.5°	2113.4	2158.2	2214.3	2230.9	2233.9
125°	2272.7	2309.3	2362.4	2381.9	2390.2
127.5°	2418.1	2457.3	2499.5	2527.3	2530.0
130°	2555.2	2600.0	2630.6	2661.5	2658.8
132.5°	2695.0	2731.5	2762.0	2787.3	2784.6
135°	2812.5	2857.3	2882.2	2910.5	2904.8
137.5°	2935.4	2968.8	2997.1	3024.9	3016.6
140°	3055.6	3078.1	3108.6	3133.9	3120.0
142.5°	3156.4	3176.1	3212.2	3234.4	3220.5
145°	3262.7	3259.7	3307.1	3326.8	3312.8
147.5°	3354.6	3346.3	3393.9	3407.8	3396.8
150°	3444.2	3424.7	3469.5	3486.1	3472.2
152.5°	3519.6	3497.4	3539.2	3556.1	3536.6
155°	3592.3	3567.4	3601.0	3617.6	3595.3
157.5°	3651.1	3628.8	3654.1	3673.7	3651.1
160°	3701.5	3684.6	3701.5	3718.1	3698.6
162.5°	3746.1	3729.5	3743.4	3763.0	3737.8
165°	3785.2	3768.6	3776.9	3796.5	3776.9
167.5°	3816.1	3799.1	3807.8	3827.4	3802.2
170°	3841.3	3824.4	3830.0	3849.6	3824.4
172.5°	3857.9	3841.3	3847.0	3866.6	3841.3
175°	3871.8	3852.3	3857.9	3877.5	3849.6
177.5°	3877.5	3857.9	3860.9	3880.5	3855.3
180°	3863.6	3863.6	3863.6	3863.6	3863.6

TEST NUMBER: P925931

CATALOG NUMBER: DFN2DIP-SQ4F0-100D120US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.87	10.64	10.90	11.67	13.06	5.83	6.60	6.86	7.63	9.02
	3H	11.55	12.24	12.59	13.28	14.68	7.02	7.70	8.06	8.75	10.15
	4H	12.16	12.81	13.21	13.85	15.27	7.47	8.11	8.52	9.16	10.57
	6H	12.58	13.18	13.64	14.23	15.65	7.78	8.38	8.85	9.43	10.86
	8H	12.71	13.27	13.77	14.34	15.76	7.87	8.44	8.94	9.51	10.93
	12H	12.77	13.31	13.84	14.37	15.81	7.91	8.45	8.99	9.51	10.96
4H	2H	9.88	10.53	10.94	11.58	12.99	6.42	7.07	7.48	8.12	9.53
	3H	11.71	12.25	12.78	13.32	14.75	7.77	8.31	8.84	9.38	10.81
	4H	12.40	12.90	13.48	13.96	15.41	8.31	8.81	9.39	9.87	11.32
	6H	12.92	13.34	14.00	14.43	15.87	8.73	9.16	9.81	10.24	11.69
	8H	13.10	13.49	14.18	14.57	16.03	8.86	9.26	9.94	10.33	11.79
	12H	13.19	13.55	14.29	14.64	16.11	8.92	9.28	10.02	10.37	11.84
8H	4H	12.37	12.76	13.45	13.84	15.30	8.59	8.99	9.67	10.07	11.53
	6H	12.94	13.26	14.04	14.38	15.84	9.11	9.44	10.21	10.56	12.01
	8H	13.16	13.44	14.27	14.55	16.02	9.30	9.59	10.41	10.69	12.17
	12H	13.29	13.55	14.41	14.65	16.16	9.42	9.67	10.53	10.77	12.28
12H	4H	12.32	12.67	13.42	13.77	15.23	8.60	8.95	9.69	10.05	11.51
	6H	12.91	13.20	14.02	14.30	15.78	9.16	9.45	10.27	10.55	12.03
	8H	13.13	13.38	14.25	14.48	16.00	9.37	9.62	10.48	10.72	12.23