

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925932

Luminaire Tested: DFN2DIP-SQ4F0-100D140US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925932
REPORT IS A COMBINATION OF REPORTS P900193 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D140US950-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21264.7 lumens
Efficiency: N/A
Efficacy: 107.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 198.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFLL

Luminous Intensity Polar Plot

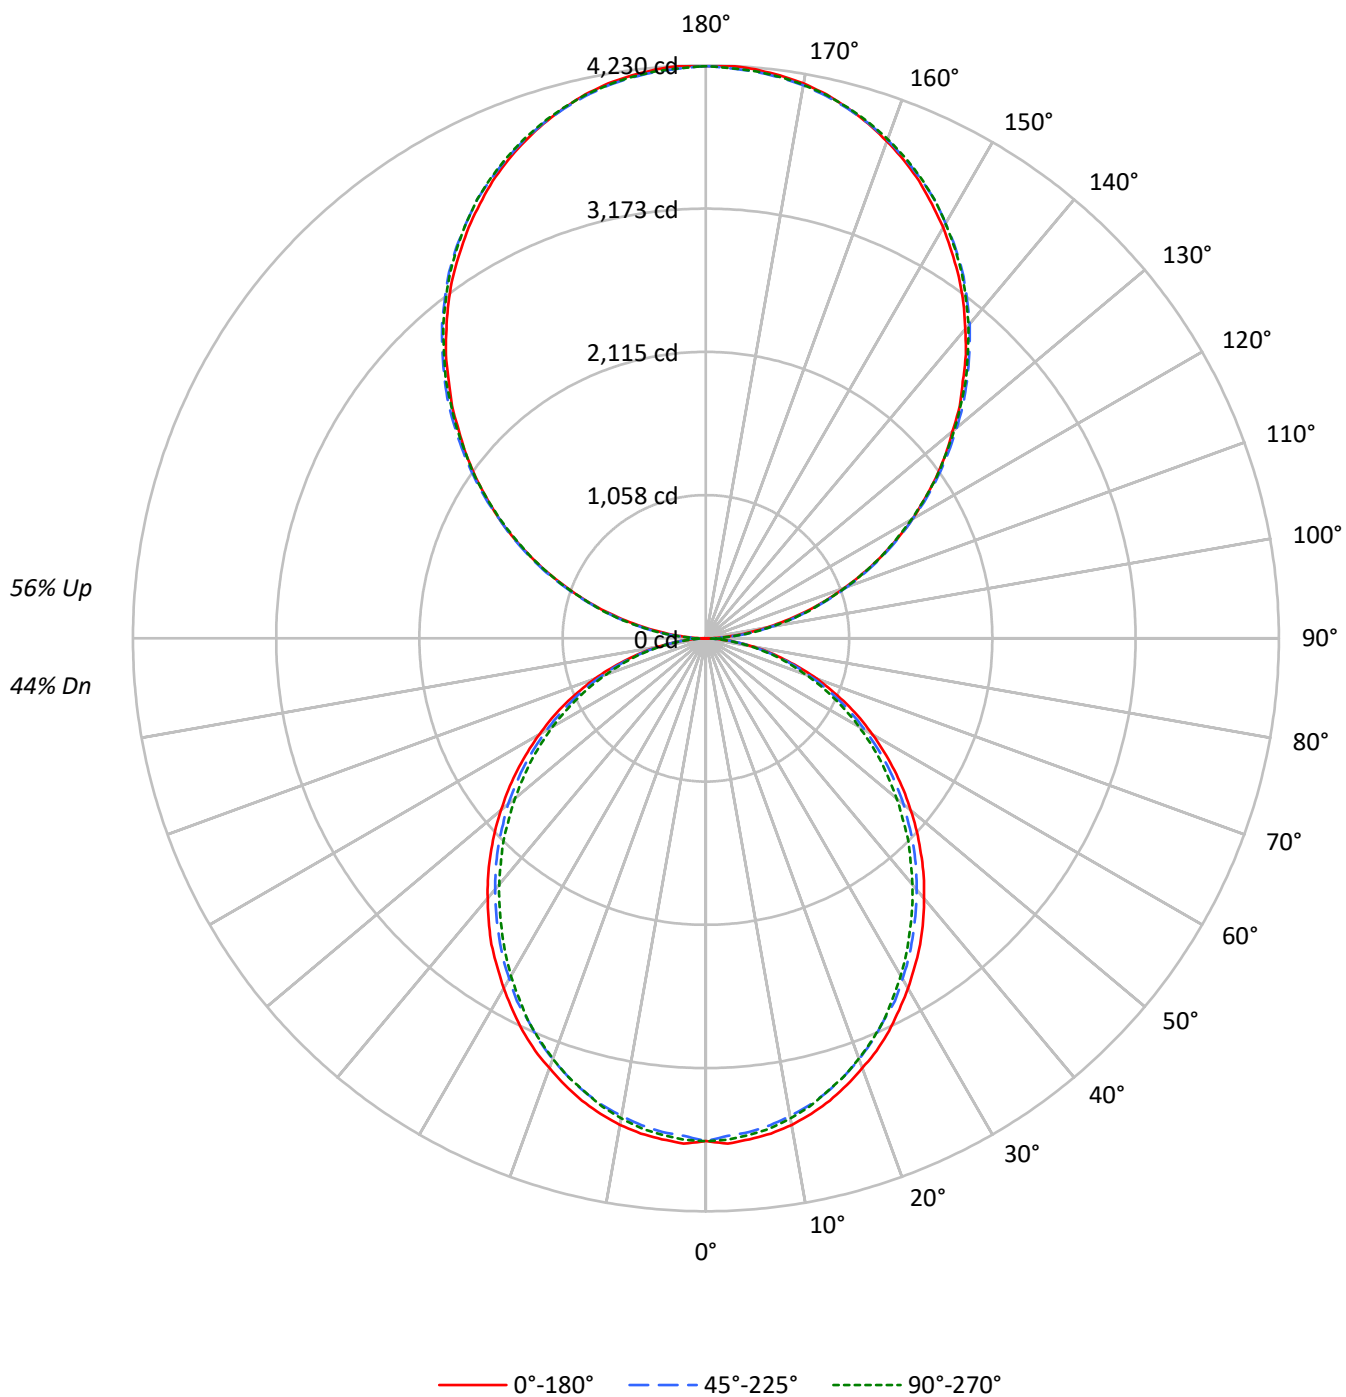

TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	45	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	24	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2605	2605	2605
5°	2609	2569	2586
10°	2588	2535	2552
15°	2550	2494	2498
20°	2498	2436	2443
25°	2447	2367	2379
30°	2383	2303	2297
35°	2322	2228	2211
40°	2247	2151	2129
45°	2173	2075	2045
50°	2091	1995	1947
55°	2006	1902	1858
60°	1909	1792	1756
65°	1804	1678	1635
70°	1670	1539	1506
75°	1484	1373	1387
80°	1260	1161	1159
85°	911	794	779

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3325 cd/sqm

TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	349.4	1.6
10°-20°	983.0	4.6
20°-30°	1444.7	6.8
30°-40°	1677.9	7.9
40°-50°	1675.8	7.9
50°-60°	1461.2	6.9
60°-70°	1080.2	5.1
70°-80°	611.1	2.9
80°-90°	173.3	0.8
90°-100°	261.4	1.2
100°-110°	830.5	3.9
110°-120°	1421.2	6.7
120°-130°	1869.1	8.8
130°-140°	2098.0	9.9
140°-150°	2057.4	9.7
150°-160°	1725.8	8.1
160°-170°	1144.5	5.4
170°-180°	400.0	1.9
0°-30°	2777.1	13.1
0°-40°	4454.9	20.9
0°-60°	7592.0	35.7
0°-90°	9456.6	44.5
90°-120°	2513.1	11.8
90°-150°	8537.6	40.1
90°-180°	11808.0	55.5
0°-180°	21264.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3712	3712	3712	3712	3712	
5°	3712	3698	3659	3687	3680	352
15°	3534	3512	3466	3480	3462	995
25°	3198	3170	3109	3116	3109	1472
35°	2759	2724	2666	2645	2627	1723
45°	2245	2220	2166	2128	2113	1733
55°	1699	1678	1635	1592	1574	1519
65°	1146	1124	1089	1057	1039	1133
75°	600	593	574	553	560	640
85°	146	143	139	128	125	163
90°	4	46	125	117	121	21
95°	186	222	228	228	222	207
105°	767	777	784	791	791	809
115°	1426	1447	1440	1436	1426	1411
125°	2074	2106	2096	2085	2081	1854
135°	2683	2723	2730	2726	2716	2074
145°	3257	3283	3303	3307	3293	2035
155°	3725	3735	3746	3764	3753	1714
165°	4052	4048	4048	4074	4056	1143
175°	4216	4206	4199	4224	4202	401
180°	4224	4224	4224	4224	4224	

TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3712.1	3712.1	3712.1	3712.1	3712.1
2.5°	3733.7	3715.8	3676.4	3712.1	3705.2
5°	3712.1	3698.1	3658.7	3687.1	3680.2
7.5°	3687.1	3665.8	3626.4	3655.3	3648.1
10°	3648.1	3623.1	3580.3	3608.7	3598.1
12.5°	3594.3	3573.1	3530.3	3548.1	3540.9
15°	3533.7	3512.5	3465.9	3480.3	3462.5
17.5°	3458.7	3437.5	3390.9	3408.7	3390.9
20°	3376.5	3355.3	3305.3	3315.9	3301.9
22.5°	3294.7	3262.6	3215.9	3215.9	3208.8
25°	3198.2	3169.8	3109.2	3116.0	3109.2
27.5°	3091.0	3066.0	3019.8	3009.2	2991.4
30°	2984.2	2955.4	2902.0	2891.4	2877.0
32.5°	2869.8	2848.6	2791.4	2769.8	2755.4
35°	2759.3	2723.7	2666.4	2644.9	2627.0
37.5°	2634.3	2602.0	2544.9	2519.9	2502.1
40°	2505.9	2477.1	2419.9	2388.1	2373.7
42.5°	2380.9	2352.1	2295.3	2259.4	2238.2
45°	2245.3	2220.3	2166.5	2127.5	2113.2
47.5°	2113.2	2088.2	2031.0	1991.6	1970.4
50°	1973.8	1956.0	1906.0	1856.0	1838.3
52.5°	1838.3	1813.3	1767.0	1727.7	1702.7
55°	1699.3	1677.7	1634.9	1592.0	1574.3
57.5°	1559.9	1542.0	1495.5	1452.8	1438.3
60°	1420.5	1406.5	1356.5	1317.1	1306.5
62.5°	1284.9	1259.9	1224.4	1188.8	1174.4
65°	1145.9	1124.4	1088.8	1056.6	1038.8
67.5°	1003.2	985.0	953.2	928.2	913.8
70°	871.0	856.6	824.4	799.5	785.4
72.5°	735.4	721.0	703.3	678.3	667.6
75°	599.5	592.7	574.5	553.3	560.5
77.5°	478.3	463.9	456.7	446.1	435.5
80°	357.1	353.4	346.1	335.5	328.4
82.5°	242.8	242.8	239.4	225.0	225.0
85°	146.2	142.8	139.4	128.4	125.0
87.5°	64.4	57.1	50.0	39.4	35.6
90°	3.8	45.9	124.8	117.2	121.0
92.5°	79.0	106.9	110.8	114.6	114.6
95°	185.9	221.6	227.9	227.9	221.6
97.5°	309.5	342.6	356.6	356.6	356.6
100°	452.1	481.4	491.5	491.5	487.7
102.5°	602.4	624.0	638.0	641.9	638.0
105°	766.6	776.8	784.5	790.8	790.8
107.5°	929.6	944.9	944.9	947.4	929.6
110°	1087.6	1107.9	1107.9	1107.9	1097.7

TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1258.1	1279.8	1276.0	1265.8	1258.1
115°	1426.2	1446.6	1440.3	1436.4	1426.2
117.5°	1593.1	1621.1	1603.3	1593.1	1582.9
120°	1761.2	1789.2	1761.2	1761.2	1749.7
122.5°	1914.0	1949.6	1931.8	1921.6	1914.0
125°	2074.5	2106.2	2096.0	2084.6	2080.8
127.5°	2231.0	2270.5	2256.5	2241.2	2231.0
130°	2377.5	2423.4	2417.0	2409.3	2395.3
132.5°	2541.7	2577.4	2580.0	2562.2	2552.0
135°	2683.1	2722.6	2730.3	2726.4	2716.2
137.5°	2841.0	2872.9	2879.3	2876.7	2861.4
140°	2979.8	3011.7	3029.5	3029.5	3015.5
142.5°	3122.4	3154.3	3164.5	3168.3	3154.3
145°	3257.4	3282.9	3303.3	3307.1	3293.1
147.5°	3378.4	3410.3	3425.5	3431.9	3417.9
150°	3503.2	3524.8	3538.9	3550.3	3538.9
152.5°	3614.0	3635.7	3653.5	3667.5	3653.5
155°	3724.8	3735.0	3746.5	3764.3	3752.8
157.5°	3820.3	3827.9	3834.3	3859.8	3841.9
160°	3905.7	3913.3	3917.1	3938.8	3923.4
162.5°	3984.6	3984.6	3988.4	4012.6	3994.8
165°	4052.1	4048.3	4048.3	4073.8	4055.9
167.5°	4113.2	4101.7	4101.7	4127.2	4109.4
170°	4159.1	4148.9	4145.0	4170.5	4148.9
172.5°	4190.9	4180.7	4176.9	4202.4	4180.7
175°	4216.4	4206.2	4198.6	4224.0	4202.4
177.5°	4230.3	4220.2	4212.6	4234.1	4212.6
180°	4224.0	4224.0	4224.0	4224.0	4224.0



TEST NUMBER: P925932

CATALOG NUMBER: DFN2DIP-SQ4F0-100D140US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.07	10.89	11.08	11.90	13.25	9.63	10.44	10.63	11.46	12.81
	3H	11.74	12.47	12.75	13.49	14.86	11.25	11.98	12.26	13.00	14.37
	4H	12.32	13.02	13.35	14.04	15.42	11.83	12.52	12.86	13.55	14.92
	6H	12.73	13.36	13.76	14.39	15.78	12.22	12.86	13.26	13.89	15.28
	8H	12.83	13.44	13.87	14.48	15.87	12.33	12.93	13.37	13.98	15.37
	12H	12.88	13.46	13.93	14.50	15.90	12.37	12.95	13.42	13.99	15.39
4H	2H	10.53	11.22	11.56	12.25	13.62	10.18	10.87	11.21	11.89	13.27
	3H	12.40	12.97	13.44	14.03	15.42	11.99	12.57	13.03	13.62	15.01
	4H	13.11	13.64	14.16	14.69	16.10	12.69	13.22	13.74	14.26	15.67
	6H	13.63	14.08	14.69	15.15	16.56	13.20	13.65	14.25	14.72	16.13
	8H	13.78	14.20	14.84	15.27	16.69	13.34	13.77	14.40	14.83	16.25
	12H	13.85	14.24	14.93	15.31	16.74	13.40	13.79	14.48	14.86	16.29
8H	4H	13.31	13.73	14.36	14.79	16.21	12.93	13.35	13.99	14.41	15.84
	6H	13.94	14.29	15.02	15.39	16.81	13.56	13.91	14.64	15.01	16.43
	8H	14.16	14.47	15.25	15.56	17.00	13.77	14.08	14.86	15.17	16.60
	12H	14.30	14.57	15.39	15.65	17.13	13.88	14.16	14.98	15.24	16.72
12H	4H	13.29	13.67	14.37	14.75	16.18	12.92	13.31	14.00	14.38	15.81
	6H	13.97	14.28	15.06	15.36	16.80	13.60	13.91	14.69	14.99	16.43
	8H	14.21	14.48	15.31	15.57	17.04	13.83	14.10	14.93	15.19	16.66