

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926033

Luminaire Tested: DFN2DIP-SQ4F0-140D110US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926033
REPORT IS A COMBINATION OF REPORTS P901683 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D110US950-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 23611.5 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 226.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLLONL

Luminous Intensity Polar Plot

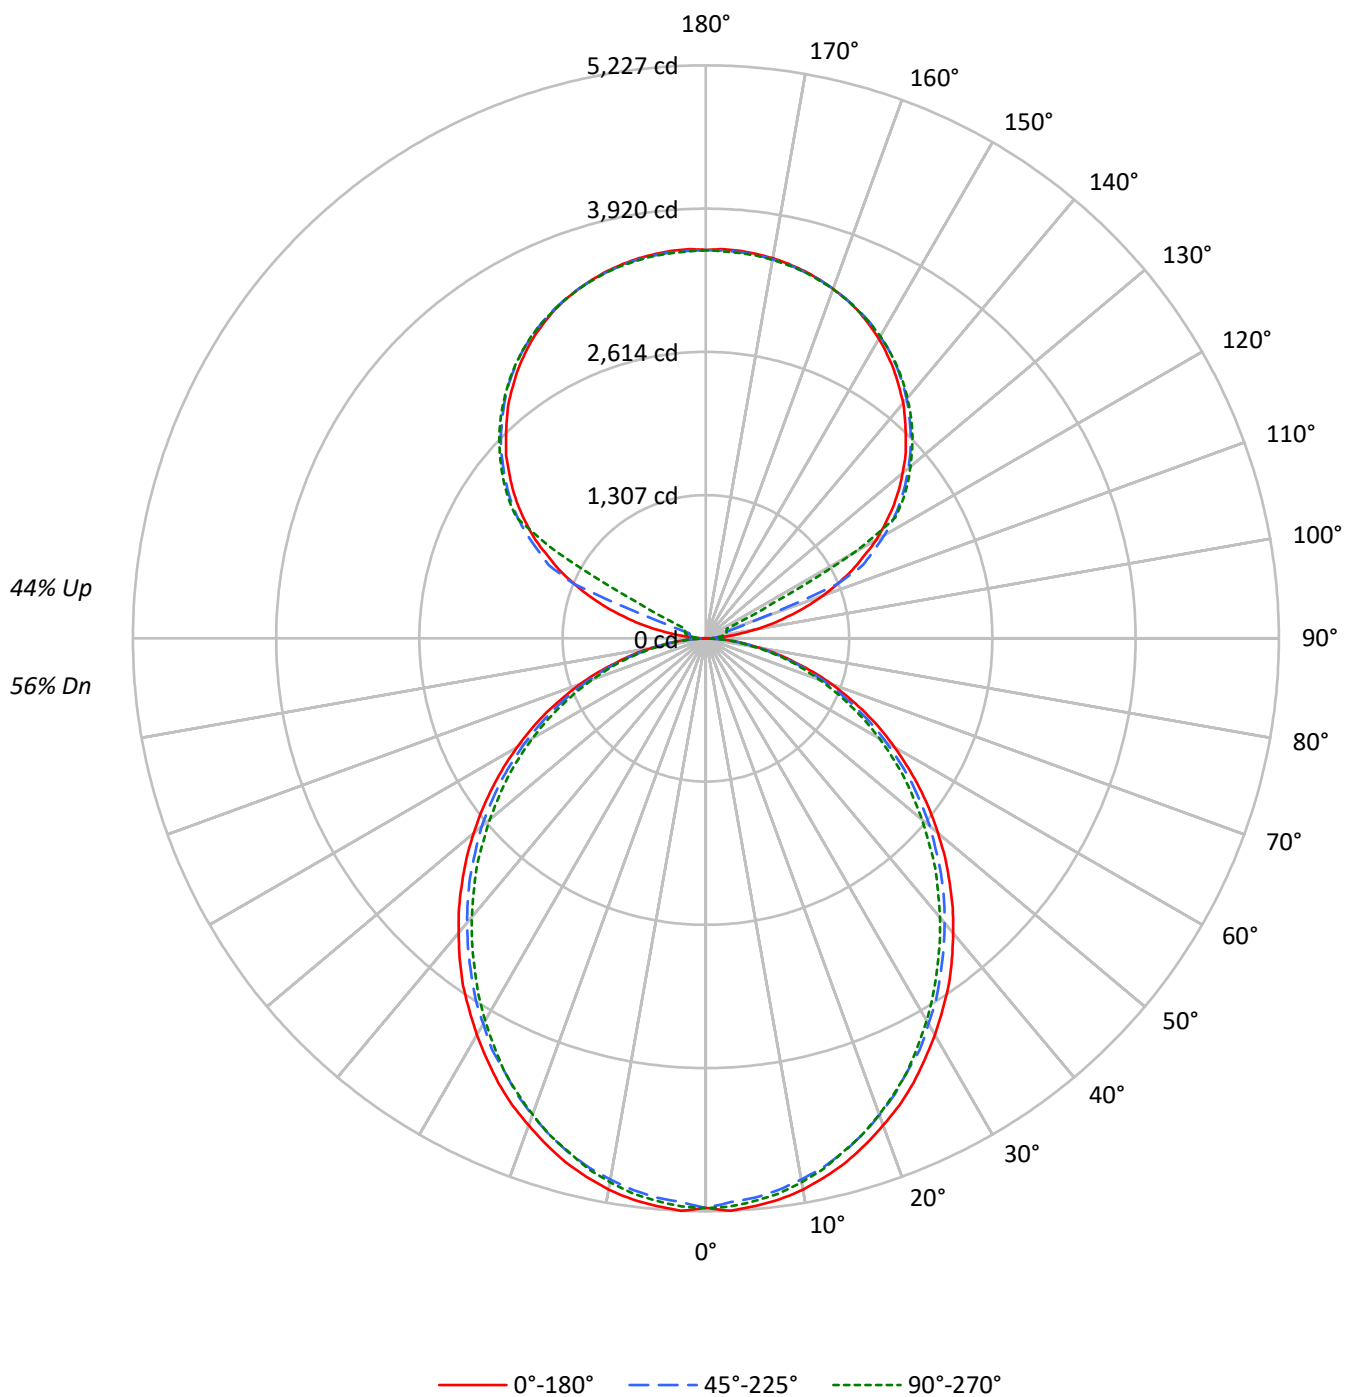

TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	71	65	63	61	55	53	52
2	90	83	77	71	84	77	72	67	67	63	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	47	43	43	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	37	40	36	32	34	31	28
6	64	52	43	38	59	48	41	36	42	36	32	36	32	28	31	28	25
7	59	47	39	33	55	44	36	31	38	32	28	33	29	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	30	25	32	26	22	28	23	20	24	21	18
10	48	36	28	23	44	34	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3647	3647	3647
5°	3652	3596	3621
10°	3623	3549	3573
15°	3569	3491	3497
20°	3497	3411	3420
25°	3426	3314	3330
30°	3336	3225	3216
35°	3251	3119	3095
40°	3146	3012	2980
45°	3042	2905	2863
50°	2927	2793	2726
55°	2808	2663	2601
60°	2673	2508	2458
65°	2525	2349	2289
70°	2338	2154	2108
75°	2077	1922	1942
80°	1765	1625	1622
85°	1275	1112	1091

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3042 cd/sqm

TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	489.1	2.1
10°-20°	1376.2	5.8
20°-30°	2022.5	8.6
30°-40°	2349.0	9.9
40°-50°	2346.1	9.9
50°-60°	2045.7	8.7
60°-70°	1512.2	6.4
70°-80°	855.6	3.6
80°-90°	232.0	1.0
90°-100°	116.8	0.5
100°-110°	435.4	1.8
110°-120°	1154.6	4.9
120°-130°	1915.0	8.1
130°-140°	2034.2	8.6
140°-150°	1890.5	8.0
150°-160°	1519.9	6.4
160°-170°	979.4	4.1
170°-180°	337.1	1.4
0°-30°	3887.9	16.5
0°-40°	6236.9	26.4
0°-60°	10628.8	45.0
0°-90°	13228.6	56.0
90°-120°	1706.7	7.2
90°-150°	7546.4	32.0
90°-180°	10383.0	44.0
0°-180°	23611.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5197	5197	5197	5197	5197	
5°	5197	5177	5122	5162	5152	493
15°	4947	4918	4852	4872	4848	1393
25°	4477	4438	4353	4362	4353	2060
35°	3863	3813	3733	3703	3678	2412
45°	3143	3108	3033	2979	2958	2426
55°	2379	2349	2289	2229	2204	2127
65°	1604	1574	1524	1479	1454	1586
75°	839	830	804	775	785	896
85°	205	200	195	180	175	228
90°	2	31	51	64	69	22
95°	166	82	100	113	110	197
105°	779	856	156	184	195	832
115°	1474	1517	1581	395	210	1451
125°	2083	2117	2166	2183	2191	1858
135°	2578	2619	2642	2668	2663	1992
145°	2991	2988	3032	3050	3037	1871
155°	3293	3270	3301	3316	3296	1517
165°	3470	3454	3462	3480	3462	980
175°	3549	3531	3536	3554	3529	338
180°	3542	3542	3542	3542	3542	



TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5196.9	5196.9	5196.9	5196.9	5196.9
2.5°	5227.1	5202.2	5147.0	5196.9	5187.4
5°	5196.9	5177.3	5122.1	5161.9	5152.4
7.5°	5161.9	5132.2	5077.1	5117.4	5107.2
10°	5107.2	5072.3	5012.4	5052.2	5037.3
12.5°	5032.0	5002.3	4942.4	4967.3	4957.3
15°	4947.2	4917.5	4852.2	4872.5	4847.5
17.5°	4842.2	4812.5	4747.3	4772.2	4747.3
20°	4727.2	4697.5	4627.5	4642.4	4622.7
22.5°	4612.6	4567.6	4502.3	4502.3	4492.3
25°	4477.4	4437.6	4352.8	4362.4	4352.8
27.5°	4327.3	4292.4	4227.7	4212.9	4188.0
30°	4177.9	4137.6	4062.8	4048.0	4027.8
32.5°	4017.8	3988.1	3908.0	3877.8	3857.6
35°	3862.9	3813.1	3733.0	3702.9	3677.9
37.5°	3688.0	3642.9	3562.8	3527.9	3502.9
40°	3508.2	3468.0	3387.8	3343.4	3323.2
42.5°	3333.3	3293.0	3213.5	3163.1	3133.4
45°	3143.4	3108.5	3033.2	2978.6	2958.4
47.5°	2958.4	2923.4	2843.4	2788.3	2758.6
50°	2763.4	2738.5	2668.4	2598.4	2573.5
52.5°	2573.5	2538.5	2473.8	2418.7	2383.8
55°	2379.0	2348.7	2288.8	2228.9	2204.0
57.5°	2183.8	2158.9	2093.7	2033.8	2013.6
60°	1988.7	1969.2	1899.1	1844.0	1829.1
62.5°	1799.0	1763.9	1714.1	1664.3	1644.1
65°	1604.3	1574.1	1524.3	1479.2	1454.3
67.5°	1404.5	1379.0	1334.5	1299.4	1279.3
70°	1219.4	1199.3	1154.2	1119.2	1099.6
72.5°	1029.7	1009.4	984.5	949.6	934.7
75°	839.3	829.8	804.3	774.6	784.7
77.5°	669.6	649.5	639.4	624.6	609.7
80°	500.0	494.6	484.6	469.7	459.6
82.5°	339.8	339.8	335.0	314.9	314.9
85°	204.6	199.9	195.1	179.7	175.0
87.5°	90.2	80.0	70.0	55.1	49.8
90°	2.5	30.7	51.1	64.2	69.1
92.5°	64.2	53.9	61.4	66.7	69.1
95°	166.5	81.9	99.8	112.9	110.2
97.5°	299.7	89.8	130.5	138.4	140.9
100°	453.7	102.6	146.1	166.5	171.6
102.5°	622.6	617.7	151.2	179.3	187.2
105°	779.0	856.0	156.5	184.4	194.8
107.5°	961.1	1024.9	161.6	189.6	200.0
110°	1135.4	1189.0	448.6	192.3	202.3



TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1299.4	1345.3	1301.8	197.2	205.1
115°	1473.5	1517.0	1581.3	394.7	210.3
117.5°	1624.8	1675.9	1719.7	1353.0	681.6
120°	1793.9	1832.3	1878.5	1909.2	1563.2
122.5°	1937.3	1978.3	2029.7	2045.0	2047.8
125°	2083.3	2116.8	2165.5	2183.4	2191.1
127.5°	2216.6	2252.5	2291.1	2316.7	2319.2
130°	2342.3	2383.4	2411.3	2439.7	2437.3
132.5°	2470.4	2503.9	2531.9	2555.0	2552.6
135°	2578.2	2619.2	2642.0	2668.0	2662.7
137.5°	2690.8	2721.5	2747.3	2772.9	2765.3
140°	2800.9	2821.6	2849.6	2872.7	2859.9
142.5°	2893.4	2911.3	2944.5	2964.9	2952.2
145°	2990.8	2988.0	3031.5	3049.6	3036.8
147.5°	3075.1	3067.5	3111.0	3123.8	3113.8
150°	3157.3	3139.3	3180.3	3195.6	3182.8
152.5°	3226.3	3205.9	3244.3	3259.8	3241.9
155°	3293.0	3270.1	3300.8	3316.1	3295.7
157.5°	3346.8	3326.4	3349.6	3367.5	3346.8
160°	3393.1	3377.5	3393.1	3408.3	3390.3
162.5°	3433.8	3418.7	3431.4	3449.4	3426.3
165°	3469.8	3454.5	3462.2	3480.1	3462.2
167.5°	3498.0	3482.6	3490.5	3508.4	3485.3
170°	3521.2	3505.7	3510.8	3528.8	3505.7
172.5°	3536.4	3521.2	3526.4	3544.3	3521.2
175°	3549.2	3531.2	3536.4	3554.4	3528.8
177.5°	3554.4	3536.4	3539.1	3557.1	3534.0
180°	3541.6	3541.6	3541.6	3541.6	3541.6

TEST NUMBER: P926033

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.32	13.24	13.22	14.16	15.34	11.87	12.79	12.78	13.72	14.90
	3H	13.99	14.81	14.90	15.74	16.95	13.50	14.32	14.41	15.25	16.46
	4H	14.58	15.36	15.51	16.30	17.51	14.09	14.87	15.02	15.80	17.02
	6H	14.99	15.71	15.93	16.65	17.88	14.49	15.20	15.43	16.15	17.38
	8H	15.10	15.78	16.04	16.74	17.97	14.59	15.28	15.54	16.24	17.47
	12H	15.15	15.80	16.10	16.75	18.01	14.64	15.29	15.59	16.24	17.50
4H	2H	12.79	13.57	13.72	14.50	15.72	12.43	13.21	13.37	14.15	15.37
	3H	14.66	15.31	15.61	16.28	17.51	14.25	14.91	15.20	15.87	17.10
	4H	15.38	15.98	16.34	16.94	18.19	14.96	15.55	15.91	16.52	17.77
	6H	15.91	16.42	16.87	17.40	18.66	15.47	15.99	16.44	16.97	18.23
	8H	16.06	16.54	17.03	17.52	18.79	15.62	16.10	16.59	17.08	18.35
	12H	16.14	16.57	17.13	17.56	18.84	15.69	16.12	16.68	17.12	18.39
8H	4H	15.58	16.06	16.56	17.04	18.31	15.21	15.69	16.18	16.67	17.93
	6H	16.22	16.62	17.22	17.64	18.91	15.84	16.24	16.84	17.26	18.52
	8H	16.45	16.80	17.45	17.81	19.09	16.05	16.40	17.06	17.41	18.70
	12H	16.58	16.89	17.59	17.89	19.23	16.17	16.48	17.18	17.48	18.82
12H	4H	15.57	16.00	16.56	17.00	18.28	15.20	15.64	16.19	16.63	17.91
	6H	16.25	16.60	17.26	17.61	18.90	15.88	16.23	16.89	17.24	18.53
	8H	16.50	16.81	17.51	17.81	19.14	16.12	16.43	17.13	17.43	18.76

END OF REPORT