

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926041

Luminaire Tested: DFN2DIP-SQ4F0-140D140US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926041
REPORT IS A COMBINATION OF REPORTS P901719 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D140US950-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 26444.9 lumens
Efficiency: N/A
Efficacy: 105.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 249.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLLONL

Luminous Intensity Polar Plot

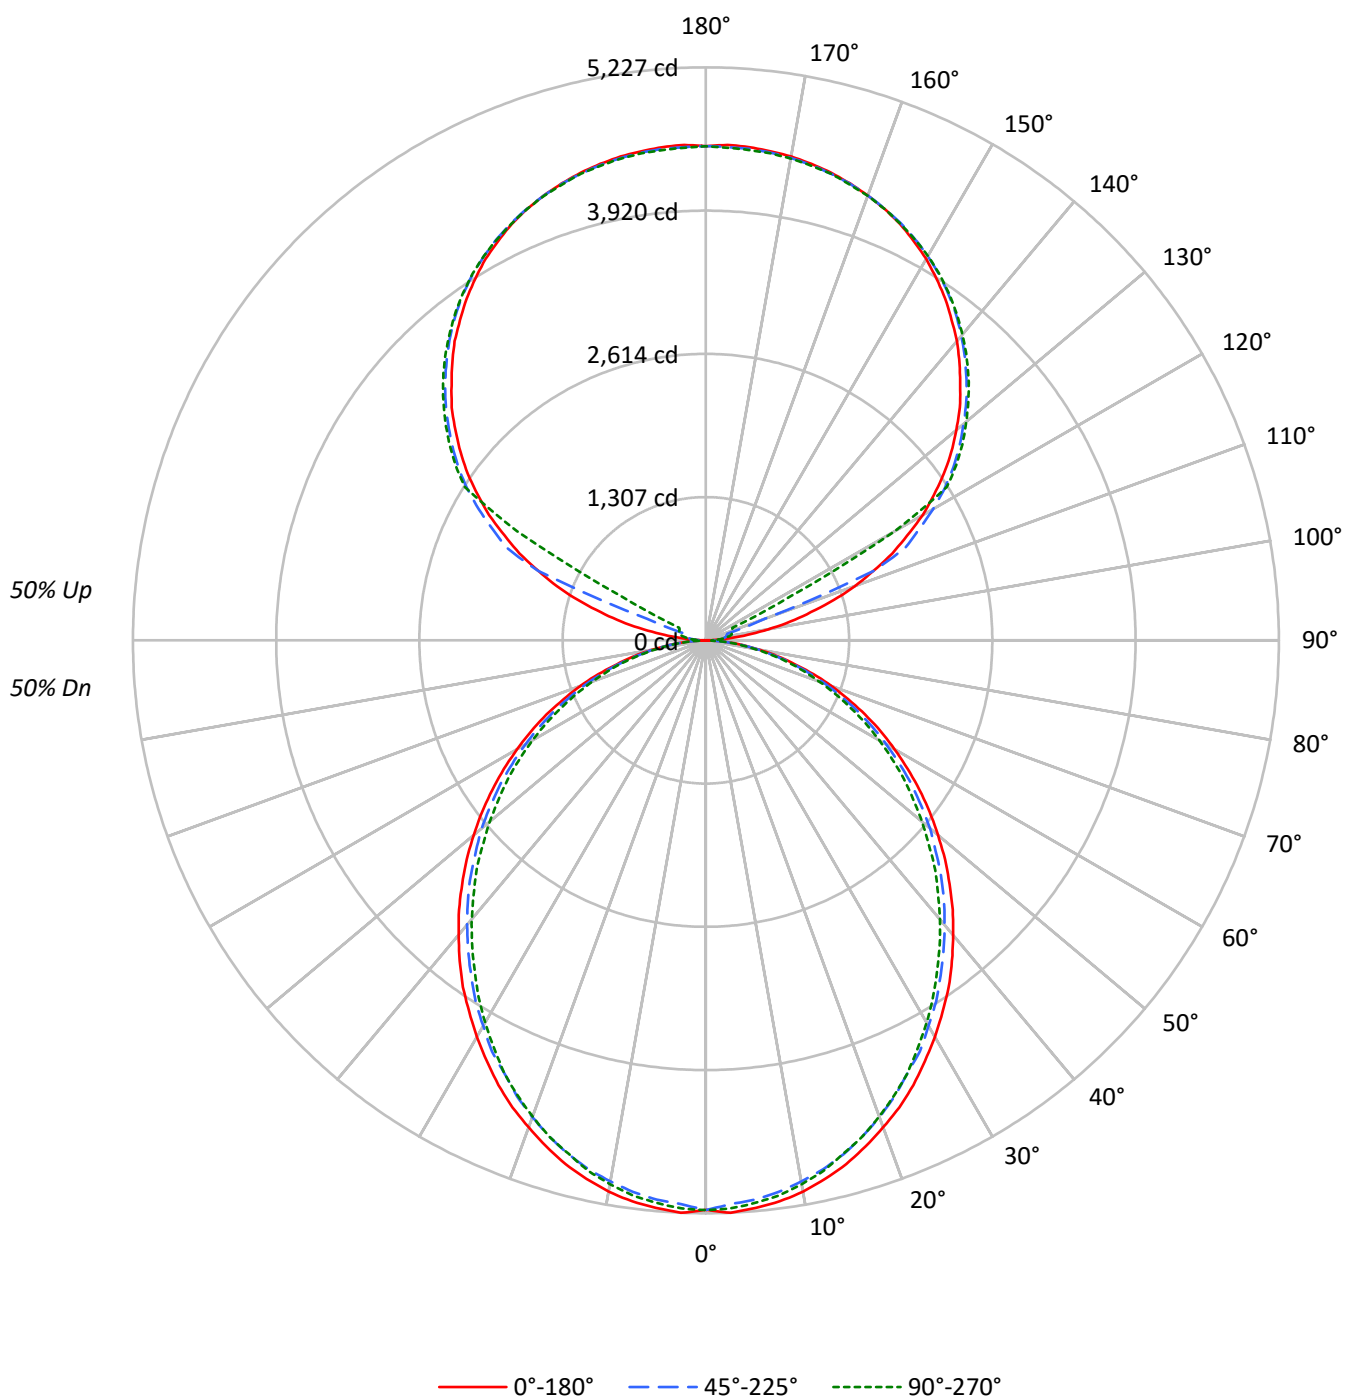

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3647	3647	3647
5°	3652	3596	3621
10°	3623	3549	3573
15°	3569	3491	3497
20°	3497	3411	3420
25°	3426	3314	3330
30°	3336	3225	3216
35°	3251	3119	3095
40°	3146	3012	2980
45°	3042	2905	2863
50°	2927	2793	2726
55°	2808	2663	2601
60°	2673	2508	2458
65°	2525	2349	2289
70°	2338	2154	2108
75°	2077	1922	1942
80°	1765	1625	1622
85°	1275	1112	1091

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3042 cd/sqm

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	489.1	1.8
10°-20°	1376.2	5.2
20°-30°	2022.5	7.6
30°-40°	2349.0	8.9
40°-50°	2346.1	8.9
50°-60°	2045.7	7.7
60°-70°	1512.2	5.7
70°-80°	855.6	3.2
80°-90°	233.7	0.9
90°-100°	148.7	0.6
100°-110°	554.1	2.1
110°-120°	1469.5	5.6
120°-130°	2437.3	9.2
130°-140°	2588.9	9.8
140°-150°	2406.1	9.1
150°-160°	1934.5	7.3
160°-170°	1246.5	4.7
170°-180°	429.0	1.6
0°-30°	3887.9	14.7
0°-40°	6236.9	23.6
0°-60°	10628.8	40.2
0°-90°	13230.3	50.0
90°-120°	2172.2	8.2
90°-150°	9604.5	36.3
90°-180°	13215.0	50.0
0°-180°	26444.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5197	5197	5197	5197	5197	
5°	5197	5177	5122	5162	5152	493
15°	4947	4918	4852	4872	4848	1393
25°	4477	4438	4353	4362	4353	2060
35°	3863	3813	3733	3703	3678	2412
45°	3143	3108	3033	2979	2958	2426
55°	2379	2349	2289	2229	2204	2127
65°	1604	1574	1524	1479	1454	1586
75°	839	830	804	775	785	896
85°	205	200	195	180	175	228
90°	3	39	65	82	88	24
95°	212	104	127	144	140	251
105°	992	1090	199	235	248	1059
115°	1875	1931	2012	502	268	1846
125°	2652	2694	2756	2779	2789	2365
135°	3281	3334	3363	3396	3389	2535
145°	3806	3803	3858	3881	3865	2381
155°	4191	4162	4201	4220	4194	1931
165°	4416	4397	4406	4429	4406	1248
175°	4517	4494	4501	4524	4491	430
180°	4508	4508	4508	4508	4508	

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5196.9	5196.9	5196.9	5196.9	5196.9
2.5°	5227.1	5202.2	5147.0	5196.9	5187.4
5°	5196.9	5177.3	5122.1	5161.9	5152.4
7.5°	5161.9	5132.2	5077.1	5117.4	5107.2
10°	5107.2	5072.3	5012.4	5052.2	5037.3
12.5°	5032.0	5002.3	4942.4	4967.3	4957.3
15°	4947.2	4917.5	4852.2	4872.5	4847.5
17.5°	4842.2	4812.5	4747.3	4772.2	4747.3
20°	4727.2	4697.5	4627.5	4642.4	4622.7
22.5°	4612.6	4567.6	4502.3	4502.3	4492.3
25°	4477.4	4437.6	4352.8	4362.4	4352.8
27.5°	4327.3	4292.4	4227.7	4212.9	4188.0
30°	4177.9	4137.6	4062.8	4048.0	4027.8
32.5°	4017.8	3988.1	3908.0	3877.8	3857.6
35°	3862.9	3813.1	3733.0	3702.9	3677.9
37.5°	3688.0	3642.9	3562.8	3527.9	3502.9
40°	3508.2	3468.0	3387.8	3343.4	3323.2
42.5°	3333.3	3293.0	3213.5	3163.1	3133.4
45°	3143.4	3108.5	3033.2	2978.6	2958.4
47.5°	2958.4	2923.4	2843.4	2788.3	2758.6
50°	2763.4	2738.5	2668.4	2598.4	2573.5
52.5°	2573.5	2538.5	2473.8	2418.7	2383.8
55°	2379.0	2348.7	2288.8	2228.9	2204.0
57.5°	2183.8	2158.9	2093.7	2033.8	2013.6
60°	1988.7	1969.2	1899.1	1844.0	1829.1
62.5°	1799.0	1763.9	1714.1	1664.3	1644.1
65°	1604.3	1574.1	1524.3	1479.2	1454.3
67.5°	1404.5	1379.0	1334.5	1299.4	1279.3
70°	1219.4	1199.3	1154.2	1119.2	1099.6
72.5°	1029.7	1009.4	984.5	949.6	934.7
75°	839.3	829.8	804.3	774.6	784.7
77.5°	669.6	649.5	639.4	624.6	609.7
80°	500.0	494.6	484.6	469.7	459.6
82.5°	339.8	339.8	335.0	314.9	314.9
85°	204.6	199.9	195.1	179.7	175.0
87.5°	90.2	80.0	70.0	55.1	49.8
90°	3.1	39.1	65.1	81.8	88.0
92.5°	81.8	68.6	78.2	84.8	88.0
95°	211.9	104.2	127.1	143.7	140.2
97.5°	381.5	114.3	166.2	176.2	179.4
100°	577.5	130.5	185.9	211.9	218.5
102.5°	792.4	786.2	192.5	228.1	238.2
105°	991.5	1089.5	199.1	234.7	247.8
107.5°	1223.1	1304.4	205.7	241.3	254.4
110°	1445.0	1513.2	570.9	244.8	257.6

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1653.8	1712.2	1656.9	251.0	261.0
115°	1875.4	1930.7	2012.5	502.4	267.6
117.5°	2067.8	2132.9	2188.7	1722.0	867.6
120°	2283.2	2332.0	2390.8	2429.9	1989.6
122.5°	2465.6	2517.9	2583.3	2602.7	2606.2
125°	2651.5	2694.1	2756.1	2778.9	2788.6
127.5°	2821.2	2866.9	2916.0	2948.5	2951.7
130°	2981.1	3033.4	3069.0	3105.1	3101.9
132.5°	3144.2	3186.7	3222.4	3251.8	3248.8
135°	3281.3	3333.6	3362.6	3395.5	3388.9
137.5°	3424.6	3463.7	3496.6	3529.1	3519.5
140°	3564.8	3591.1	3626.7	3656.2	3639.9
142.5°	3682.5	3705.3	3747.6	3773.5	3757.2
145°	3806.5	3802.9	3858.4	3881.3	3864.9
147.5°	3913.8	3904.1	3959.5	3975.7	3962.9
150°	4018.3	3995.4	4047.7	4067.1	4050.9
152.5°	4106.2	4080.3	4129.1	4148.9	4126.0
155°	4191.0	4162.0	4201.1	4220.5	4194.5
157.5°	4259.6	4233.7	4263.1	4285.9	4259.6
160°	4318.5	4298.7	4318.5	4337.8	4315.0
162.5°	4370.4	4351.0	4367.3	4390.1	4360.7
165°	4416.1	4396.7	4406.4	4429.2	4406.4
167.5°	4452.1	4432.4	4442.4	4465.3	4435.8
170°	4481.5	4461.8	4468.3	4491.2	4461.8
172.5°	4500.9	4481.5	4488.1	4511.0	4481.5
175°	4517.2	4494.3	4500.9	4523.8	4491.2
177.5°	4523.8	4500.9	4504.4	4527.2	4497.8
180°	4507.5	4507.5	4507.5	4507.5	4507.5

TEST NUMBER: P926041

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.78	12.64	12.74	13.62	14.89	11.34	12.20	12.29	13.17	14.44
	3H	13.45	14.22	14.42	15.20	16.49	12.96	13.73	13.92	14.71	16.00
	4H	14.04	14.77	15.02	15.75	17.06	13.54	14.27	14.53	15.26	16.56
	6H	14.44	15.12	15.43	16.11	17.42	13.94	14.61	14.93	15.60	16.92
	8H	14.55	15.19	15.55	16.20	17.51	14.05	14.69	15.04	15.69	17.01
	12H	14.60	15.21	15.60	16.21	17.55	14.09	14.70	15.09	15.70	17.04
4H	2H	12.24	12.98	13.23	13.96	15.26	11.89	12.62	12.88	13.61	14.91
	3H	14.11	14.73	15.11	15.74	17.06	13.71	14.32	14.70	15.33	16.65
	4H	14.83	15.39	15.84	16.40	17.74	14.41	14.97	15.41	15.97	17.31
	6H	15.35	15.83	16.37	16.86	18.20	14.92	15.40	15.94	16.43	17.77
	8H	15.50	15.95	16.52	16.98	18.33	15.07	15.52	16.08	16.54	17.89
	12H	15.58	15.98	16.62	17.02	18.38	15.13	15.54	16.17	16.57	17.93
8H	4H	15.03	15.48	16.05	16.50	17.85	14.65	15.10	15.67	16.13	17.48
	6H	15.67	16.04	16.71	17.10	18.45	15.28	15.65	16.32	16.72	18.07
	8H	15.89	16.22	16.94	17.27	18.63	15.50	15.82	16.55	16.87	18.24
	12H	16.02	16.31	17.08	17.36	18.77	15.61	15.90	16.67	16.95	18.36
12H	4H	15.02	15.42	16.05	16.46	17.82	14.65	15.05	15.68	16.09	17.45
	6H	15.70	16.02	16.75	17.07	18.44	15.32	15.65	16.37	16.70	18.07
	8H	15.94	16.23	16.99	17.27	18.68	15.56	15.85	16.61	16.89	18.30