

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904285

Luminaire Tested: DFN2DIP-TR2F0-030D030US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904285
REPORT IS A COMBINATION OF REPORTS P901753 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D030US830-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5301.8 lumens
Efficiency: N/A
Efficacy: 112.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 47
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLLONL

Luminous Intensity Polar Plot

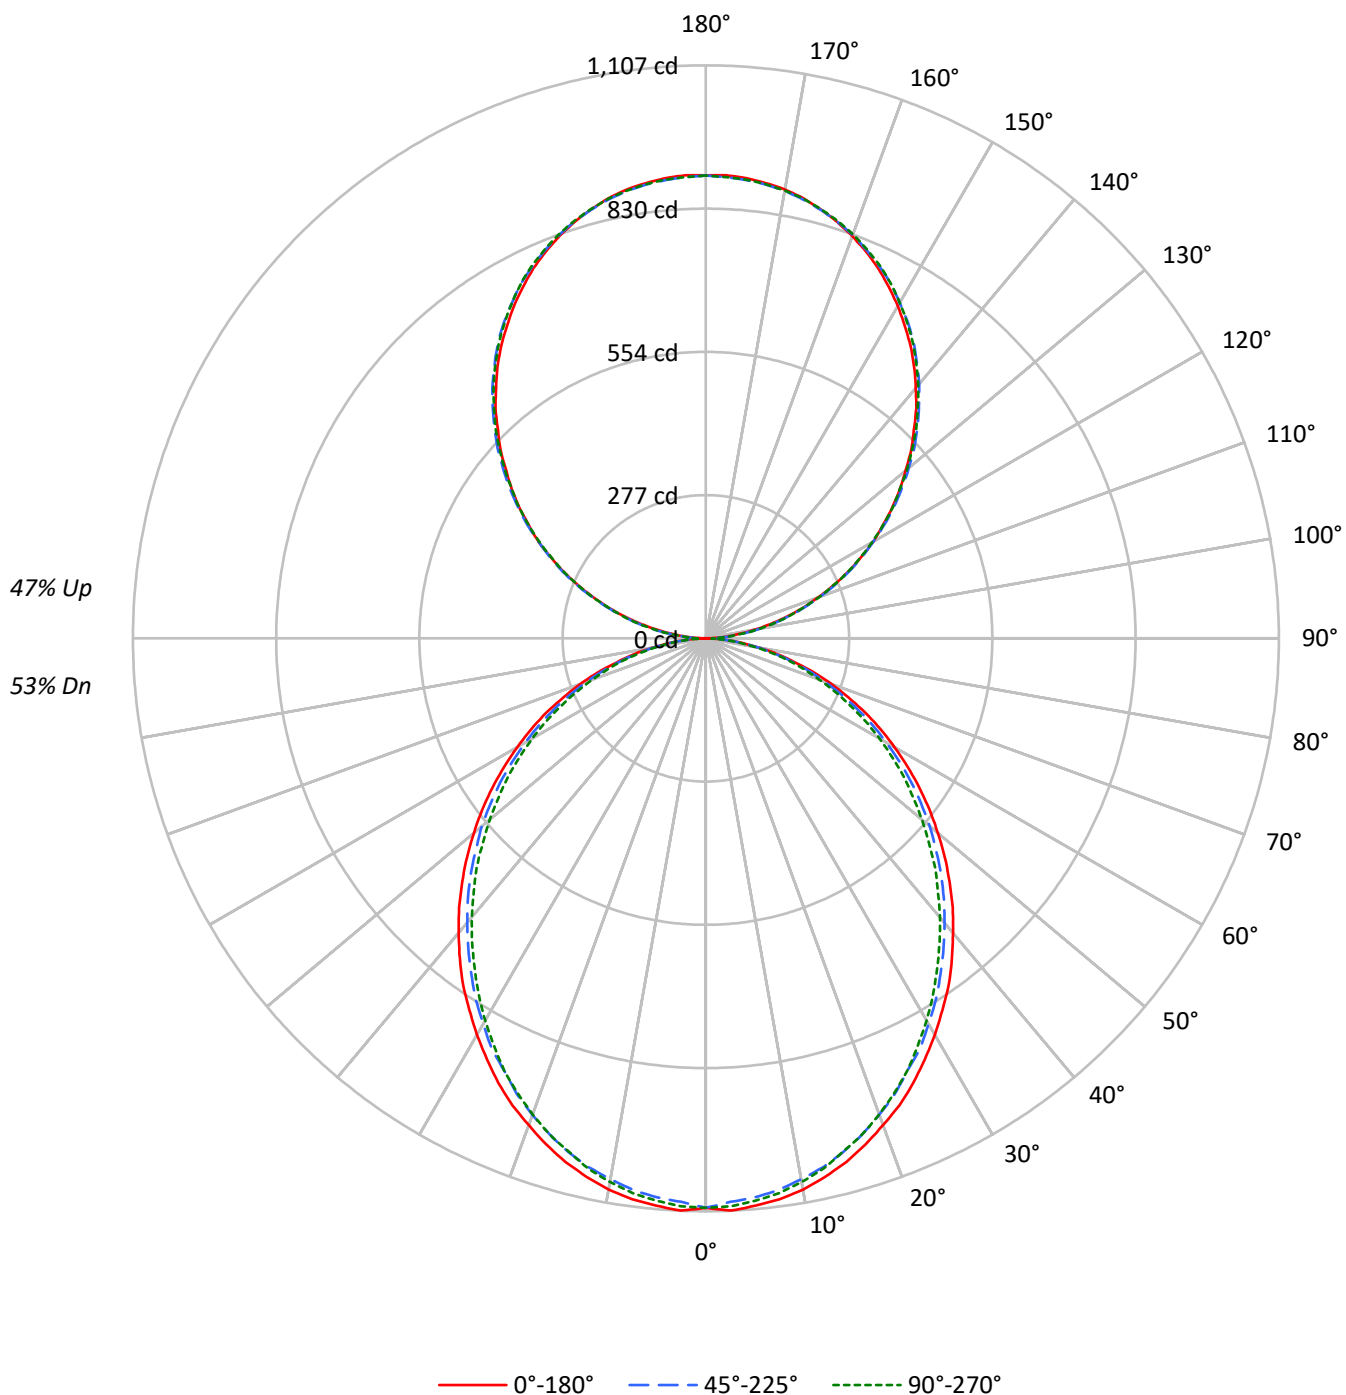

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85		71	71	71		59
1	98	94	90	87	91	87	84	81	74	72	70		63	61	59		52
2	90	82	76	71	83	76	71	66	65	61	58		55	52	50		46
3	82	72	65	59	75	67	61	55	58	53	49		49	45	42		41
4	75	64	56	50	69	60	52	47	51	46	41		43	39	36		36
5	69	57	49	43	63	53	46	40	46	40	36		39	35	31		33
6	63	51	43	37	58	48	40	35	41	36	31		35	31	27		30
7	59	46	38	33	54	43	36	31	37	32	28		32	28	24		27
8	54	42	34	29	50	39	32	27	34	29	24		29	25	22		25
9	51	38	31	26	47	36	29	24	31	26	22		27	23	19		23
10	47	35	28	23	44	33	26	22	29	23	20		25	21	18		21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2454	2454	2454
5°	2454	2414	2432
10°	2431	2376	2395
15°	2391	2332	2339
20°	2339	2272	2282
25°	2288	2202	2217
30°	2224	2136	2136
35°	2163	2059	2050
40°	2088	1981	1968
45°	2014	1903	1883
50°	1932	1820	1787
55°	1847	1725	1696
60°	1750	1613	1593
65°	1644	1496	1471
70°	1508	1354	1338
75°	1322	1183	1211
80°	1096	964	979
85°	748	608	607

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2014 cd/sqm

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	2.0
10°-20°	291.4	5.5
20°-30°	428.2	8.1
30°-40°	497.3	9.4
40°-50°	496.7	9.4
50°-60°	433.1	8.2
60°-70°	320.2	6.0
70°-80°	181.1	3.4
80°-90°	50.3	0.9
90°-100°	55.3	1.0
100°-110°	175.8	3.3
110°-120°	300.9	5.7
120°-130°	395.7	7.5
130°-140°	444.2	8.4
140°-150°	435.6	8.2
150°-160°	365.4	6.9
160°-170°	242.3	4.6
170°-180°	84.7	1.6
0°-30°	823.1	15.5
0°-40°	1320.4	24.9
0°-60°	2250.3	42.4
0°-90°	2801.9	52.8
90°-120°	532.1	10.0
90°-150°	1807.5	34.1
90°-180°	2500.0	47.2
0°-180°	5301.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1100	1100	1100	1100	1100	
5°	1100	1096	1084	1093	1091	104
15°	1047	1041	1027	1032	1026	295
25°	948	940	922	924	922	436
35°	818	807	790	784	779	511
45°	666	658	642	631	626	514
55°	504	497	485	472	467	450
65°	340	333	323	313	308	336
75°	178	176	170	164	166	190
85°	43	42	41	38	37	48
90°	1	10	26	25	26	5
95°	39	47	48	48	47	44
105°	162	164	166	167	167	171
115°	302	306	305	304	302	299
125°	439	446	444	441	440	392
135°	568	576	578	577	575	439
145°	690	695	699	700	697	431
155°	789	791	793	797	795	363
165°	858	857	857	862	859	242
175°	893	890	889	894	890	85
180°	894	894	894	894	894	

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1100.2	1100.2	1100.2	1100.2	1100.2
2.5°	1106.6	1101.4	1089.7	1100.2	1098.3
5°	1100.2	1096.1	1084.4	1092.9	1090.8
7.5°	1092.9	1086.6	1074.9	1083.5	1081.3
10°	1081.3	1073.8	1061.2	1069.6	1066.5
12.5°	1065.4	1059.0	1046.4	1051.6	1049.5
15°	1047.4	1041.1	1027.3	1031.5	1026.2
17.5°	1025.1	1018.9	1005.0	1010.3	1005.0
20°	1000.8	994.5	979.7	982.8	978.6
22.5°	976.6	967.0	953.2	953.2	951.0
25°	947.9	939.5	921.5	923.6	921.5
27.5°	916.2	908.7	895.0	891.9	886.6
30°	884.5	876.0	860.2	857.0	852.7
32.5°	850.6	844.3	827.4	821.0	816.7
35°	817.8	807.3	790.3	783.9	778.6
37.5°	780.8	771.3	754.3	746.9	741.6
40°	742.7	734.2	717.3	707.8	703.6
42.5°	705.7	697.2	680.3	669.7	663.4
45°	665.5	658.1	642.2	630.6	626.3
47.5°	626.3	619.0	602.0	590.3	584.0
50°	585.0	579.8	565.0	550.2	544.9
52.5°	544.9	537.4	523.8	512.1	504.6
55°	503.7	497.3	484.6	471.9	466.7
57.5°	462.3	457.0	443.3	430.6	426.3
60°	421.0	416.9	402.1	390.4	387.3
62.5°	380.9	373.4	362.9	352.3	348.1
65°	339.7	333.3	322.7	313.2	307.9
67.5°	297.4	292.0	282.5	275.1	270.9
70°	258.2	253.9	244.4	237.0	232.8
72.5°	218.0	213.7	208.4	201.0	197.9
75°	177.7	175.7	170.3	164.0	166.2
77.5°	141.8	137.5	135.3	132.2	129.1
80°	105.8	104.7	102.5	99.4	97.4
82.5°	71.9	71.9	71.0	66.6	66.6
85°	43.4	42.3	41.3	38.1	37.0
87.5°	19.0	17.0	14.8	11.7	10.6
90°	0.8	9.7	26.4	24.8	25.6
92.5°	16.7	22.6	23.5	24.2	24.2
95°	39.4	46.9	48.3	48.3	46.9
97.5°	65.5	72.5	75.5	75.5	75.5
100°	95.7	101.9	104.1	104.1	103.3
102.5°	127.5	132.1	135.1	135.9	135.1
105°	162.3	164.5	166.1	167.4	167.4
107.5°	196.8	200.0	200.0	200.6	196.8
110°	230.3	234.6	234.6	234.6	232.4

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	266.4	271.0	270.1	268.0	266.4
115°	302.0	306.2	304.9	304.2	302.0
117.5°	337.2	343.2	339.4	337.2	335.1
120°	372.9	378.8	372.9	372.9	370.4
122.5°	405.2	412.7	409.0	406.8	405.2
125°	439.2	445.9	443.7	441.3	440.5
127.5°	472.3	480.7	477.8	474.5	472.3
130°	503.3	513.0	511.7	510.1	507.1
132.5°	538.1	545.6	546.2	542.4	540.3
135°	568.1	576.4	578.1	577.2	575.0
137.5°	601.4	608.2	609.5	609.1	605.8
140°	630.8	637.6	641.4	641.4	638.4
142.5°	661.1	667.8	670.0	670.8	667.8
145°	689.7	695.0	699.4	700.1	697.2
147.5°	715.3	722.0	725.2	726.6	723.6
150°	741.7	746.3	749.2	751.7	749.2
152.5°	765.2	769.7	773.5	776.5	773.5
155°	788.6	790.7	793.1	796.9	794.6
157.5°	808.8	810.4	811.8	817.2	813.4
160°	826.9	828.5	829.3	833.9	830.7
162.5°	843.6	843.6	844.4	849.5	845.7
165°	857.9	857.1	857.1	862.4	858.7
167.5°	870.8	868.4	868.4	873.7	870.0
170°	880.5	878.4	877.6	883.0	878.4
172.5°	887.2	885.1	884.3	889.7	885.1
175°	892.7	890.5	888.9	894.3	889.7
177.5°	895.6	893.4	891.8	896.5	891.8
180°	894.3	894.3	894.3	894.3	894.3

TEST NUMBER: P904285

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.52	11.41	11.45	12.36	13.59	10.10	10.99	11.03	11.93	13.16
	3H	12.16	12.96	13.10	13.91	15.17	11.70	12.49	12.64	13.45	14.71
	4H	12.73	13.49	13.69	14.45	15.71	12.27	13.03	13.23	13.99	15.25
	6H	13.12	13.81	14.08	14.78	16.05	12.66	13.35	13.63	14.32	15.59
	8H	13.21	13.87	14.19	14.86	16.13	12.75	13.41	13.73	14.40	15.67
	12H	13.25	13.88	14.23	14.86	16.16	12.79	13.42	13.77	14.40	15.70
4H	2H	10.98	11.73	11.94	12.69	13.95	10.64	11.39	11.60	12.35	13.62
	3H	12.82	13.45	13.79	14.44	15.72	12.43	13.06	13.41	14.06	15.33
	4H	13.51	14.09	14.50	15.08	16.38	13.12	13.69	14.10	14.68	15.98
	6H	14.01	14.50	15.00	15.51	16.81	13.61	14.11	14.61	15.12	16.42
	8H	14.15	14.61	15.14	15.61	16.93	13.75	14.21	14.75	15.22	16.53
	12H	14.21	14.63	15.23	15.65	16.97	13.80	14.22	14.82	15.24	16.56
8H	4H	13.70	14.16	14.70	15.17	16.48	13.35	13.81	14.35	14.82	16.13
	6H	14.31	14.69	15.33	15.73	17.05	13.95	14.34	14.98	15.38	16.69
	8H	14.51	14.85	15.54	15.88	17.21	14.16	14.49	15.18	15.52	16.85
	12H	14.63	14.93	15.66	15.95	17.33	14.26	14.56	15.29	15.58	16.96
12H	4H	13.69	14.10	14.70	15.12	16.44	13.34	13.76	14.36	14.78	16.10
	6H	14.33	14.67	15.36	15.70	17.03	13.99	14.33	15.02	15.36	16.69
	8H	14.56	14.85	15.59	15.88	17.25	14.21	14.51	15.24	15.54	16.91

END OF REPORT