

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904317

Luminaire Tested: DFN2DIP-TR2F0-040D060US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904317
REPORT IS A COMBINATION OF REPORTS P901785 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-040D060US830-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8737.4 lumens
Efficiency: N/A
Efficacy: 103.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 84.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLLONL

Luminous Intensity Polar Plot

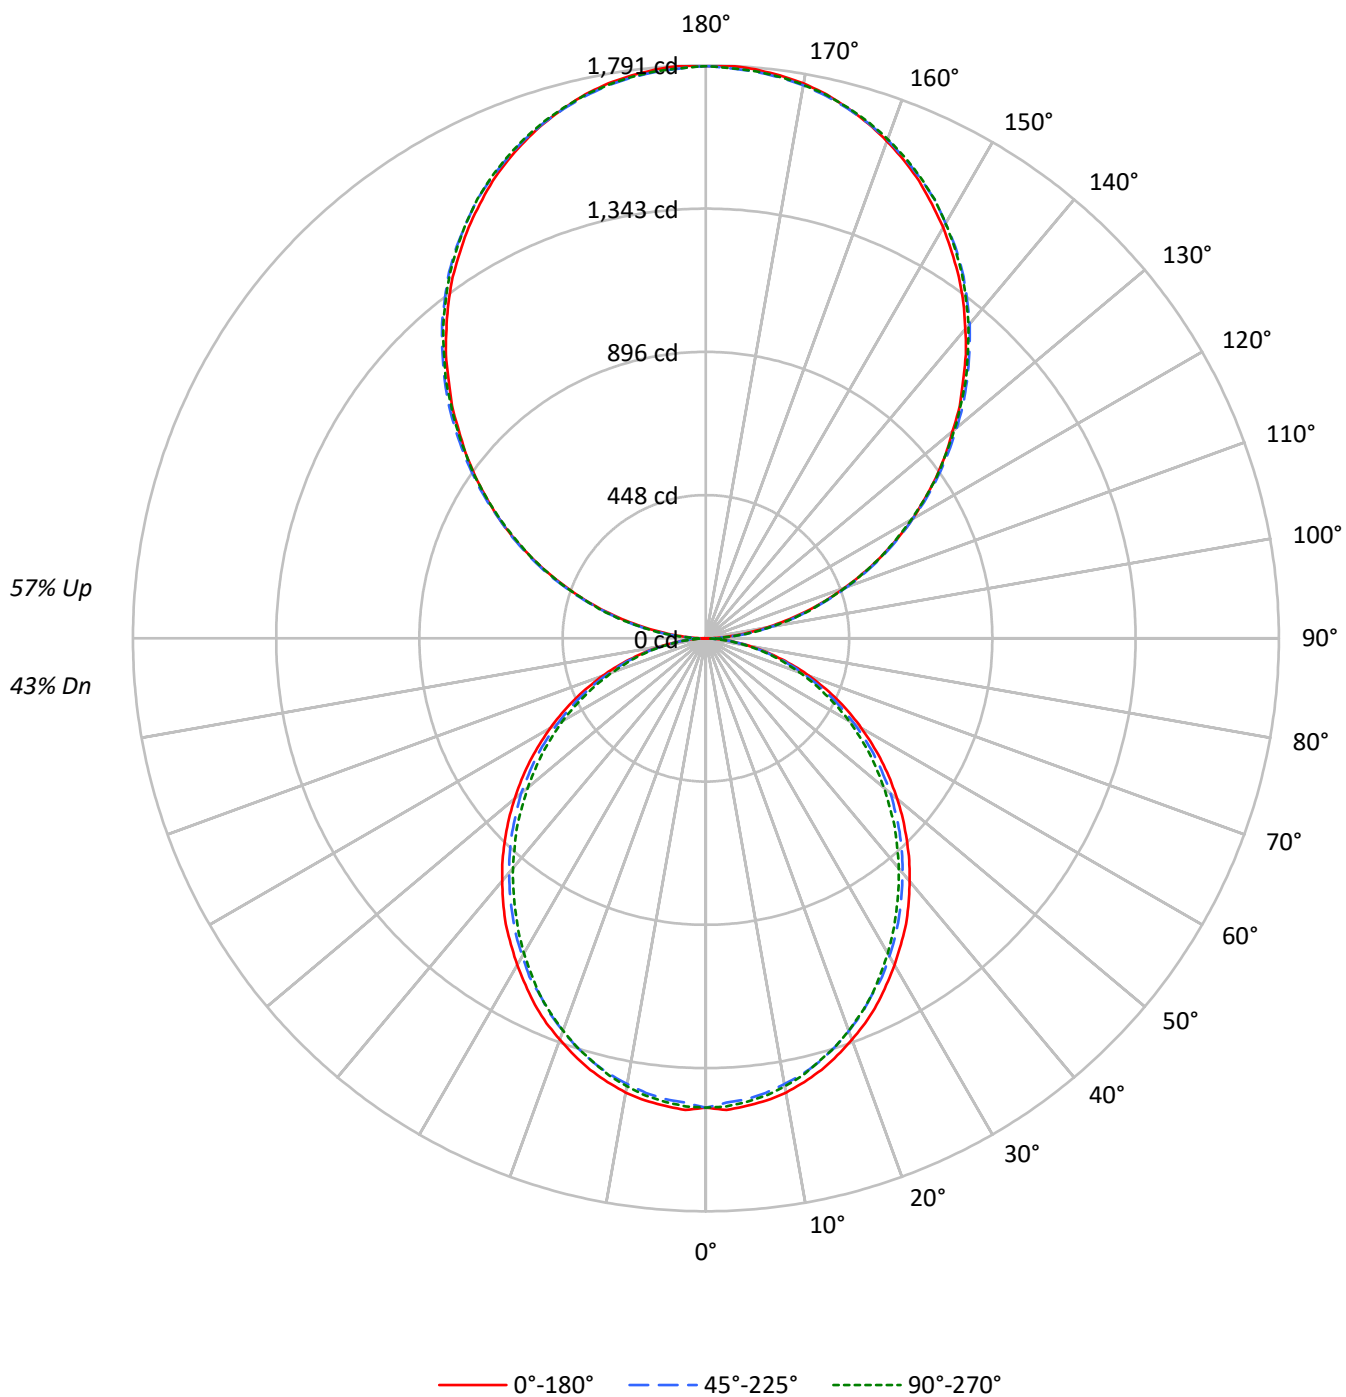

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3272	3272	3272
5°	3272	3219	3242
10°	3241	3168	3193
15°	3188	3109	3119
20°	3119	3029	3043
25°	3050	2935	2956
30°	2965	2848	2848
35°	2883	2745	2733
40°	2784	2641	2624
45°	2685	2537	2511
50°	2576	2427	2382
55°	2463	2300	2262
60°	2333	2151	2123
65°	2191	1995	1961
70°	2011	1805	1784
75°	1764	1577	1614
80°	1461	1286	1305
85°	997	810	811

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2685 cd/sqm

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.6
10°-20°	388.5	4.4
20°-30°	570.9	6.5
30°-40°	663.1	7.6
40°-50°	662.3	7.6
50°-60°	577.5	6.6
60°-70°	426.9	4.9
70°-80°	241.5	2.8
80°-90°	68.8	0.8
90°-100°	110.7	1.3
100°-110°	351.6	4.0
110°-120°	601.8	6.9
120°-130°	791.4	9.1
130°-140°	888.4	10.2
140°-150°	871.1	10.0
150°-160°	730.8	8.4
160°-170°	484.6	5.5
170°-180°	169.4	1.9
0°-30°	1097.5	12.6
0°-40°	1760.6	20.1
0°-60°	3000.3	34.3
0°-90°	3737.5	42.8
90°-120°	1064.1	12.2
90°-150°	3615.0	41.4
90°-180°	5000.0	57.2
0°-180°	8737.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	2	19	53	50	51	9
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P904317

CATALOG NUMBER: DFN2DIP-TR2F0-040D060US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.55	11.35	11.57	12.38	13.75	10.13	10.93	11.15	11.96	13.33
	3H	12.19	12.90	13.21	13.94	15.33	11.72	12.44	12.75	13.48	14.87
	4H	12.75	13.43	13.79	14.47	15.87	12.29	12.97	13.33	14.01	15.41
	6H	13.13	13.76	14.18	14.80	16.21	12.67	13.30	13.72	14.34	15.75
	8H	13.23	13.82	14.28	14.88	16.29	12.77	13.36	13.82	14.42	15.83
	12H	13.26	13.83	14.32	14.88	16.31	12.80	13.37	13.86	14.42	15.85
4H	2H	11.00	11.68	12.04	12.71	14.11	10.66	11.34	11.70	12.38	13.77
	3H	12.83	13.40	13.88	14.46	15.87	12.45	13.01	13.50	14.08	15.49
	4H	13.52	14.04	14.58	15.10	16.53	13.13	13.65	14.19	14.71	16.14
	6H	14.01	14.46	15.08	15.54	16.97	13.62	14.06	14.69	15.14	16.57
	8H	14.15	14.57	15.22	15.64	17.08	13.75	14.17	14.82	15.24	16.69
	12H	14.21	14.59	15.30	15.67	17.12	13.80	14.18	14.89	15.27	16.72
8H	4H	13.71	14.12	14.78	15.19	16.64	13.35	13.77	14.42	14.84	16.29
	6H	14.31	14.65	15.40	15.77	17.21	13.95	14.30	15.05	15.41	16.85
	8H	14.51	14.81	15.61	15.91	17.37	14.15	14.46	15.25	15.55	17.01
	12H	14.62	14.89	15.73	15.98	17.48	14.25	14.52	15.36	15.61	17.11
12H	4H	13.69	14.06	14.77	15.15	16.60	13.34	13.72	14.43	14.81	16.25
	6H	14.33	14.63	15.43	15.73	17.19	13.99	14.29	15.09	15.39	16.85
	8H	14.55	14.82	15.66	15.91	17.41	14.21	14.47	15.31	15.57	17.07