

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904334

Luminaire Tested: DFN2DIP-TR2F0-050D050US830-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904334
REPORT IS A COMBINATION OF REPORTS P900258 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D050US830-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8176.6 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

Luminous Intensity Polar Plot

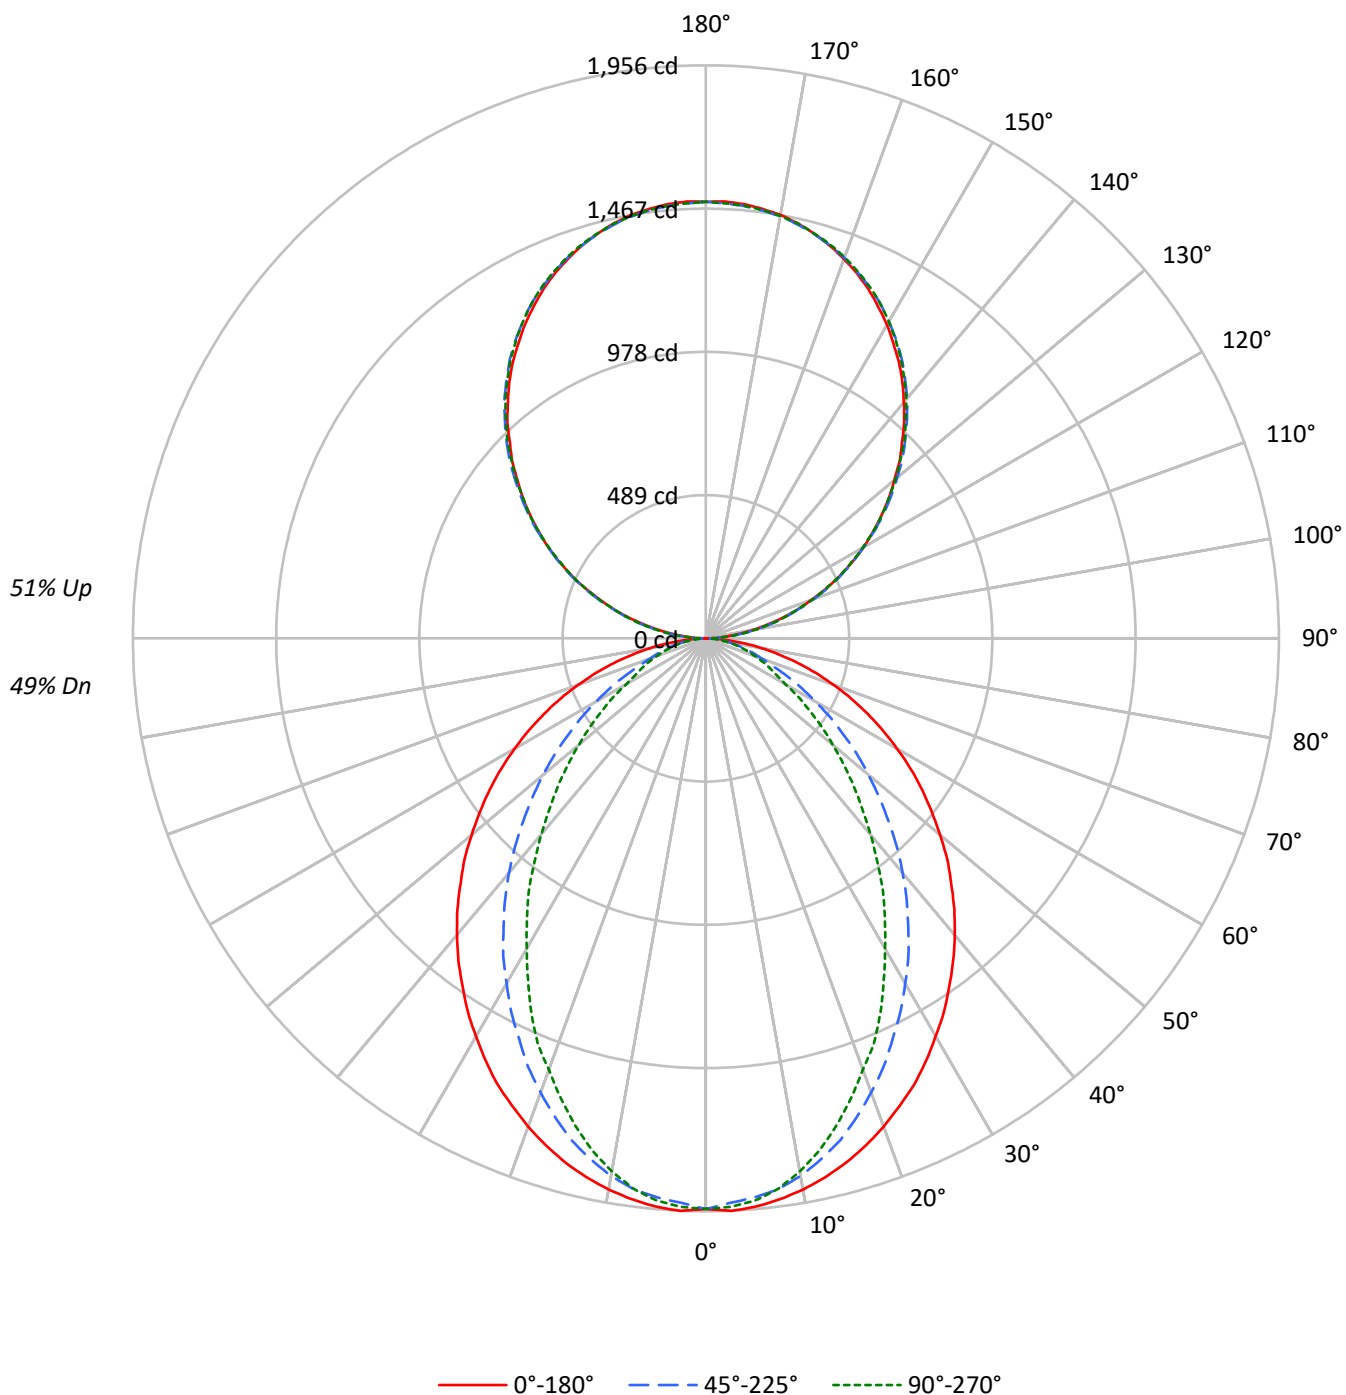

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4344	4344	4344
5°	4345	4266	4295
10°	4295	4172	4148
15°	4230	4025	3925
20°	4145	3826	3654
25°	4058	3605	3393
30°	3944	3379	3064
35°	3832	3137	2775
40°	3717	2887	2445
45°	3585	2612	2147
50°	3447	2334	1855
55°	3303	2039	1576
60°	3135	1733	1290
65°	2942	1422	1154
70°	2708	1132	1033
75°	2413	979	925
80°	1990	795	780
85°	1307	493	550

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3585 cd/sqm

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	2.2
10°-20°	501.1	6.1
20°-30°	703.6	8.6
30°-40°	766.9	9.4
40°-50°	704.9	8.6
50°-60°	553.6	6.8
60°-70°	360.3	4.4
70°-80°	185.5	2.3
80°-90°	51.6	0.6
90°-100°	92.2	1.1
100°-110°	293.0	3.6
110°-120°	501.5	6.1
120°-130°	659.5	8.1
130°-140°	740.3	9.1
140°-150°	725.9	8.9
150°-160°	609.0	7.4
160°-170°	403.9	4.9
170°-180°	141.2	1.7
0°-30°	1387.2	17.0
0°-40°	2154.2	26.3
0°-60°	3412.7	41.7
0°-90°	4010.1	49.0
90°-120°	886.7	10.8
90°-150°	3012.5	36.8
90°-180°	4167.0	51.0
0°-180°	8176.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	1	16	44	41	43	8
95°	66	78	80	80	78	73
105°	270	274	277	279	279	285
115°	503	510	508	507	503	498
125°	732	743	740	736	734	654
135°	947	961	963	962	958	732
145°	1149	1158	1166	1167	1162	718
155°	1314	1318	1322	1328	1324	605
165°	1430	1428	1428	1438	1431	403
175°	1488	1484	1482	1490	1483	141
180°	1490	1490	1490	1490	1490	

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	1.3	16.2	44.0	41.4	42.7
92.5°	27.9	37.7	39.1	40.4	40.4
95°	65.6	78.2	80.4	80.4	78.2
97.5°	109.1	120.8	125.8	125.8	125.8
100°	159.5	169.8	173.4	173.4	172.1
102.5°	212.5	220.2	225.1	226.5	225.1
105°	270.5	274.1	276.8	279.0	279.0
107.5°	328.0	333.4	333.4	334.3	328.0
110°	383.7	391.0	391.0	391.0	387.3

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.9	451.6	450.3	446.7	443.9
115°	503.2	510.5	508.2	506.9	503.2
117.5°	562.1	572.0	565.7	562.1	558.6
120°	621.4	631.3	621.4	621.4	617.4
122.5°	675.3	688.0	681.6	678.1	675.3
125°	732.0	743.2	739.6	735.6	734.2
127.5°	787.2	801.2	796.3	790.8	787.2
130°	839.0	855.1	852.8	850.2	845.2
132.5°	896.9	909.5	910.4	904.1	900.5
135°	946.8	960.6	963.4	962.1	958.5
137.5°	1002.5	1013.7	1016.0	1015.0	1009.7
140°	1051.4	1062.7	1068.9	1068.9	1064.0
142.5°	1101.7	1113.0	1116.6	1117.9	1113.0
145°	1149.4	1158.4	1165.5	1167.0	1162.0
147.5°	1192.1	1203.3	1208.7	1211.0	1206.0
150°	1236.1	1243.8	1248.7	1252.7	1248.7
152.5°	1275.3	1282.9	1289.1	1294.1	1289.1
155°	1314.3	1317.9	1321.9	1328.2	1324.2
157.5°	1348.0	1350.7	1352.9	1362.0	1355.7
160°	1378.1	1380.8	1382.1	1389.8	1384.4
162.5°	1406.0	1406.0	1407.3	1415.9	1409.6
165°	1429.8	1428.4	1428.4	1437.5	1431.2
167.5°	1451.3	1447.3	1447.3	1456.3	1450.0
170°	1467.5	1464.0	1462.6	1471.6	1464.0
172.5°	1478.8	1475.2	1473.9	1482.8	1475.2
175°	1487.8	1484.1	1481.5	1490.4	1482.8
177.5°	1492.7	1489.1	1486.4	1494.0	1486.4
180°	1490.4	1490.4	1490.4	1490.4	1490.4

TEST NUMBER: P904334

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.03	12.85	13.00	13.83	15.12	8.01	8.83	8.98	9.82	11.10
	3H	13.68	14.42	14.67	15.41	16.72	9.18	9.92	10.17	10.91	12.22
	4H	14.28	14.97	15.27	15.96	17.28	9.62	10.32	10.62	11.31	12.63
	6H	14.68	15.32	15.68	16.32	17.65	9.93	10.57	10.94	11.57	12.90
	8H	14.79	15.40	15.81	16.42	17.74	10.01	10.62	11.03	11.64	12.96
	12H	14.85	15.42	15.86	16.43	17.78	10.05	10.63	11.07	11.64	12.99
4H	2H	12.04	12.74	13.05	13.73	15.05	8.59	9.29	9.60	10.28	11.60
	3H	13.85	14.42	14.86	15.45	16.78	9.92	10.50	10.94	11.53	12.86
	4H	14.52	15.05	15.54	16.06	17.42	10.46	10.99	11.48	12.00	13.36
	6H	15.01	15.46	16.04	16.50	17.86	10.86	11.31	11.89	12.35	13.70
	8H	15.17	15.60	16.20	16.63	17.99	10.98	11.40	12.01	12.44	13.80
	12H	15.25	15.64	16.30	16.68	18.05	11.04	11.42	12.08	12.46	13.84
8H	4H	14.48	14.91	15.51	15.94	17.30	10.72	11.15	11.75	12.18	13.55
	6H	15.02	15.37	16.08	16.45	17.81	11.22	11.57	12.27	12.64	14.01
	8H	15.22	15.53	16.29	16.59	17.97	11.40	11.71	12.46	12.77	14.15
	12H	15.35	15.62	16.41	16.67	18.09	11.50	11.77	12.57	12.83	14.25
12H	4H	14.43	14.82	15.48	15.86	17.23	10.72	11.11	11.77	12.15	13.53
	6H	15.00	15.30	16.06	16.36	17.75	11.26	11.57	12.33	12.63	14.01
	8H	15.20	15.47	16.26	16.52	17.95	11.46	11.73	12.52	12.78	14.21