

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906990

Luminaire Tested: DFN2DIP-TR2F0-020D020US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906990
REPORT IS A COMBINATION OF REPORTS P900222 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-020D020US835-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3470.0 lumens
Efficiency: N/A
Efficacy: 113.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 30.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

Luminous Intensity Polar Plot

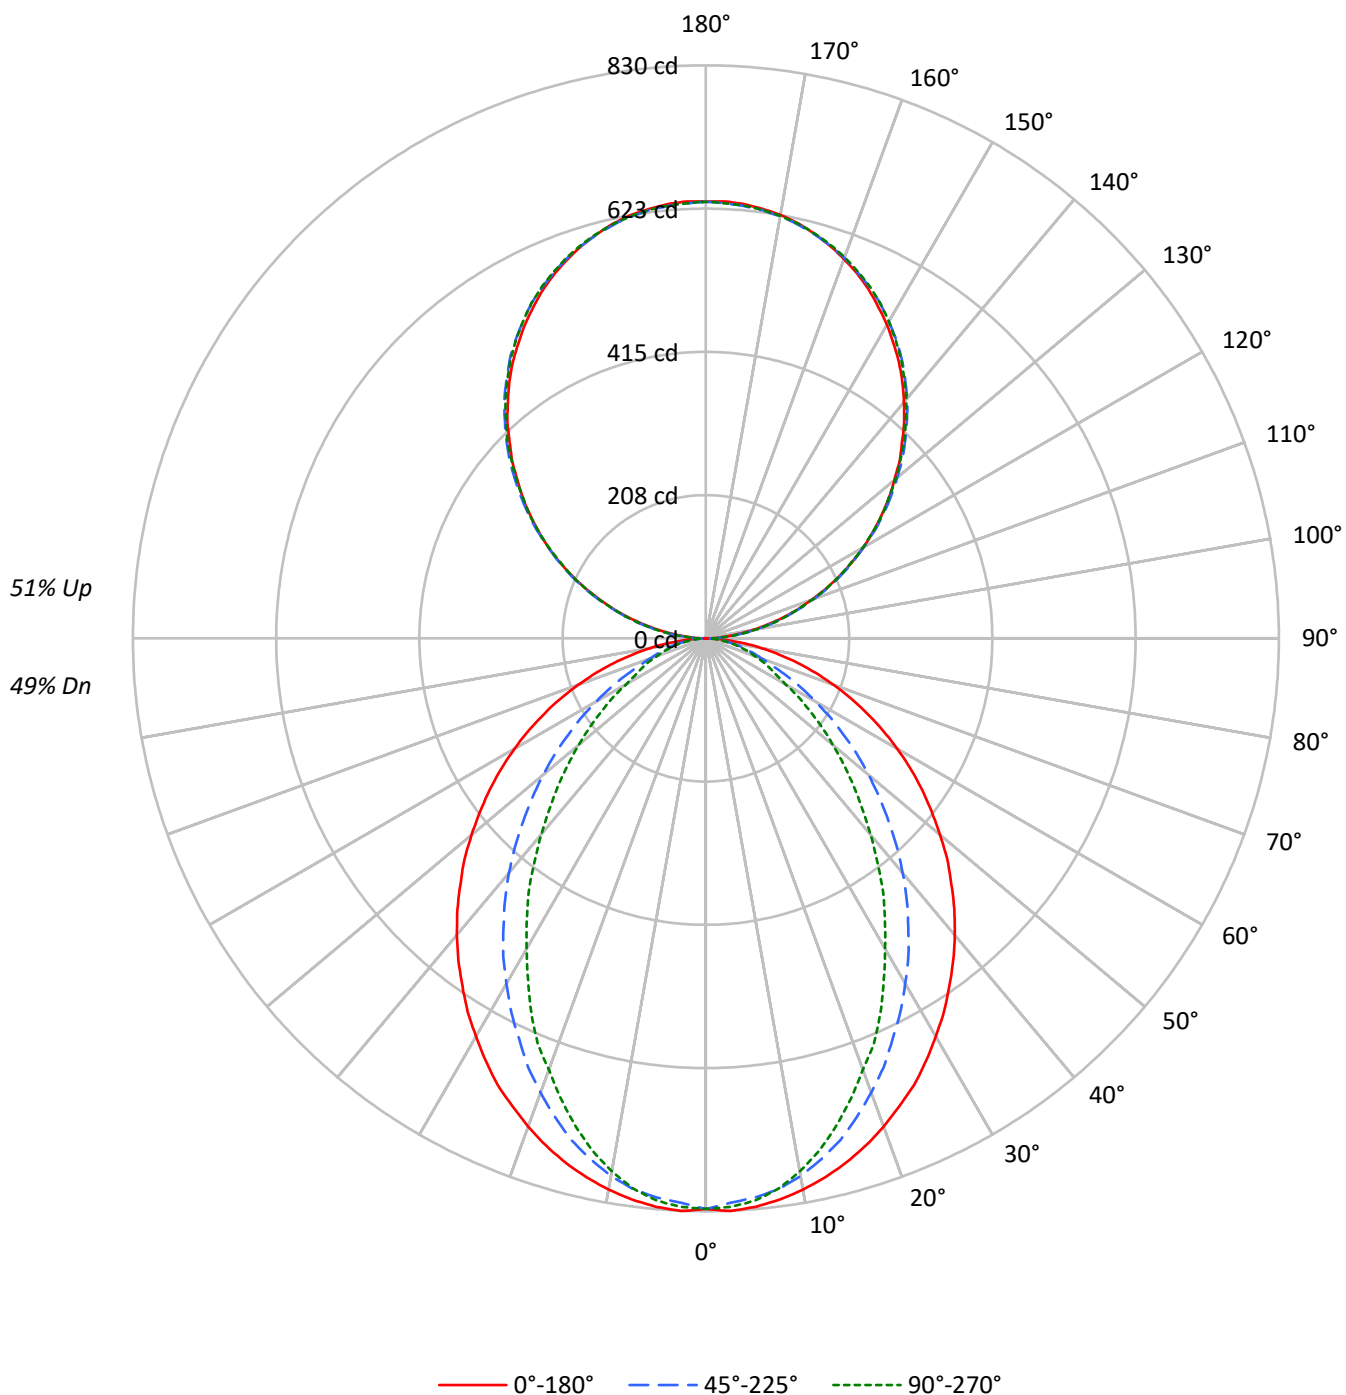

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1844	1844	1844
5°	1844	1810	1823
10°	1823	1771	1760
15°	1795	1708	1666
20°	1759	1624	1551
25°	1722	1530	1440
30°	1674	1434	1300
35°	1626	1331	1178
40°	1577	1225	1038
45°	1521	1108	911
50°	1463	991	788
55°	1401	866	669
60°	1331	735	548
65°	1249	604	490
70°	1149	480	439
75°	1024	415	393
80°	844	338	331
85°	554	209	233

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1521 cd/sqm

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	77.5	2.2
10°-20°	212.7	6.1
20°-30°	298.6	8.6
30°-40°	325.5	9.4
40°-50°	299.1	8.6
50°-60°	234.9	6.8
60°-70°	152.9	4.4
70°-80°	78.7	2.3
80°-90°	21.9	0.6
90°-100°	39.1	1.1
100°-110°	124.4	3.6
110°-120°	212.8	6.1
120°-130°	279.9	8.1
130°-140°	314.2	9.1
140°-150°	308.1	8.9
150°-160°	258.4	7.4
160°-170°	171.4	4.9
170°-180°	59.9	1.7
0°-30°	588.7	17.0
0°-40°	914.2	26.3
0°-60°	1448.3	41.7
0°-90°	1701.8	49.0
90°-120°	376.3	10.8
90°-150°	1278.5	36.8
90°-180°	1768.0	51.0
0°-180°	3470.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	827	827	827	827	827	
5°	827	823	813	820	818	78
15°	786	778	752	738	731	222
25°	714	690	640	610	598	328
35°	615	577	511	464	447	385
45°	503	452	374	321	303	388
55°	382	324	243	198	184	342
65°	258	198	130	105	102	256
75°	138	85	60	55	54	146
85°	32	16	14	14	14	37
90°	1	7	19	18	18	3
95°	28	33	34	34	33	31
105°	115	116	118	118	118	121
115°	214	217	216	215	214	211
125°	311	315	314	312	312	278
135°	402	408	409	408	407	311
145°	488	492	495	495	493	305
155°	558	559	561	564	562	257
165°	607	606	606	610	607	171
175°	631	630	629	632	629	60
180°	632	632	632	632	632	

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	826.6	826.6	826.6	826.6	826.6
2.5°	830.3	826.6	818.3	825.9	824.4
5°	826.6	822.9	813.1	819.9	817.6
7.5°	819.9	815.4	804.9	807.9	804.1
10°	810.9	805.6	790.7	788.4	784.0
12.5°	799.7	792.9	772.7	768.3	760.0
15°	786.2	777.9	752.5	738.3	730.9
17.5°	770.5	758.5	727.1	710.6	698.7
20°	752.5	737.5	700.2	681.5	665.0
22.5°	733.1	715.9	672.5	647.1	635.9
25°	713.7	689.7	640.3	609.7	598.4
27.5°	690.5	665.0	610.4	575.2	558.0
30°	665.8	637.3	577.5	539.4	519.1
32.5°	641.8	607.4	546.1	501.2	482.5
35°	614.9	576.8	511.0	463.8	447.3
37.5°	588.7	547.5	478.0	426.4	407.7
40°	561.0	516.2	443.6	390.5	371.0
42.5°	532.6	484.8	409.2	353.8	335.2
45°	502.7	452.5	374.1	320.9	302.9
47.5°	474.3	421.2	340.4	287.2	270.8
50°	442.9	389.8	307.5	255.8	240.2
52.5°	412.1	356.0	276.0	226.7	212.5
55°	382.2	323.9	243.1	198.3	184.0
57.5°	351.6	291.7	214.0	172.1	160.1
60°	320.2	260.3	183.3	145.2	133.2
62.5°	289.5	229.7	157.1	121.2	115.2
65°	258.1	197.5	130.2	104.8	102.5
67.5°	228.2	167.5	104.8	92.0	89.8
70°	196.7	138.4	86.7	79.3	76.3
72.5°	166.8	111.4	72.5	66.6	65.1
75°	137.6	85.2	59.8	54.6	53.9
77.5°	108.5	60.6	47.1	44.1	42.6
80°	81.5	43.4	35.9	32.9	32.9
82.5°	56.8	29.2	24.7	23.2	23.2
85°	32.1	16.4	14.2	14.2	14.2
87.5°	12.0	6.0	6.0	5.2	5.2
90°	0.6	6.9	18.7	17.5	18.1
92.5°	11.8	16.0	16.6	17.2	17.2
95°	27.8	33.2	34.1	34.1	33.2
97.5°	46.3	51.3	53.4	53.4	53.4
100°	67.7	72.1	73.6	73.6	73.0
102.5°	90.2	93.4	95.5	96.1	95.5
105°	114.8	116.3	117.5	118.4	118.4
107.5°	139.2	141.5	141.5	141.9	139.2
110°	162.9	165.9	165.9	165.9	164.4

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	188.4	191.6	191.1	189.5	188.4
115°	213.6	216.6	215.7	215.1	213.6
117.5°	238.6	242.8	240.1	238.6	237.0
120°	263.7	267.9	263.7	263.7	262.0
122.5°	286.6	291.9	289.3	287.8	286.6
125°	310.6	315.4	313.9	312.2	311.6
127.5°	334.1	340.0	337.9	335.6	334.1
130°	356.0	362.9	361.9	360.8	358.7
132.5°	380.6	386.0	386.3	383.7	382.1
135°	401.8	407.7	408.8	408.3	406.7
137.5°	425.4	430.2	431.2	430.8	428.5
140°	446.2	451.0	453.7	453.7	451.6
142.5°	467.6	472.3	473.9	474.4	472.3
145°	487.8	491.6	494.7	495.2	493.1
147.5°	505.9	510.7	513.0	513.9	511.8
150°	524.6	527.8	529.9	531.6	529.9
152.5°	541.2	544.4	547.1	549.2	547.1
155°	557.8	559.3	561.0	563.7	562.0
157.5°	572.1	573.2	574.2	578.0	575.3
160°	584.9	586.0	586.6	589.8	587.5
162.5°	596.7	596.7	597.2	600.9	598.2
165°	606.8	606.2	606.2	610.0	607.4
167.5°	615.9	614.2	614.2	618.0	615.4
170°	622.8	621.3	620.7	624.5	621.3
172.5°	627.6	626.0	625.5	629.3	626.0
175°	631.4	629.9	628.7	632.5	629.3
177.5°	633.5	632.0	630.8	634.0	630.8
180°	632.5	632.5	632.5	632.5	632.5

TEST NUMBER: P906990

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.05	9.87	10.02	10.86	12.14	5.03	5.86	6.01	6.84	8.13
	3H	10.70	11.44	11.69	12.43	13.74	6.21	6.94	7.19	7.93	9.24
	4H	11.30	11.99	12.29	12.99	14.30	6.65	7.34	7.64	8.34	9.65
	6H	11.70	12.34	12.71	13.34	14.67	6.95	7.59	7.96	8.59	9.92
	8H	11.81	12.42	12.83	13.44	14.77	7.04	7.64	8.05	8.66	9.99
	12H	11.87	12.44	12.88	13.45	14.80	7.07	7.65	8.09	8.66	10.01
4H	2H	9.06	9.76	10.07	10.75	12.07	5.62	6.31	6.62	7.31	8.62
	3H	10.87	11.44	11.88	12.47	13.80	6.95	7.53	7.96	8.55	9.88
	4H	11.54	12.07	12.56	13.08	14.44	7.48	8.01	8.50	9.03	10.38
	6H	12.03	12.49	13.06	13.52	14.88	7.88	8.34	8.91	9.38	10.73
	8H	12.19	12.62	13.22	13.65	15.02	8.00	8.43	9.03	9.46	10.82
	12H	12.28	12.66	13.32	13.70	15.08	8.06	8.44	9.11	9.49	10.86
8H	4H	11.50	11.93	12.53	12.96	14.32	7.75	8.17	8.78	9.20	10.57
	6H	12.04	12.39	13.10	13.47	14.83	8.24	8.59	9.30	9.67	11.03
	8H	12.24	12.55	13.31	13.61	14.99	8.42	8.73	9.48	9.79	11.17
	12H	12.37	12.64	13.43	13.69	15.12	8.53	8.80	9.59	9.85	11.28
12H	4H	11.45	11.84	12.50	12.88	14.25	7.75	8.13	8.80	9.18	10.55
	6H	12.02	12.33	13.08	13.38	14.77	8.28	8.59	9.35	9.65	11.03
	8H	12.22	12.49	13.29	13.54	14.97	8.48	8.75	9.55	9.80	11.23

END OF REPORT