

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906993

Luminaire Tested: DFN2DIP-TR2F0-020D030US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906993
REPORT IS A COMBINATION OF REPORTS P901751 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-020D030US835-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4635.0 lumens
Efficiency: N/A
Efficacy: 125.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 37
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLLONL

Luminous Intensity Polar Plot

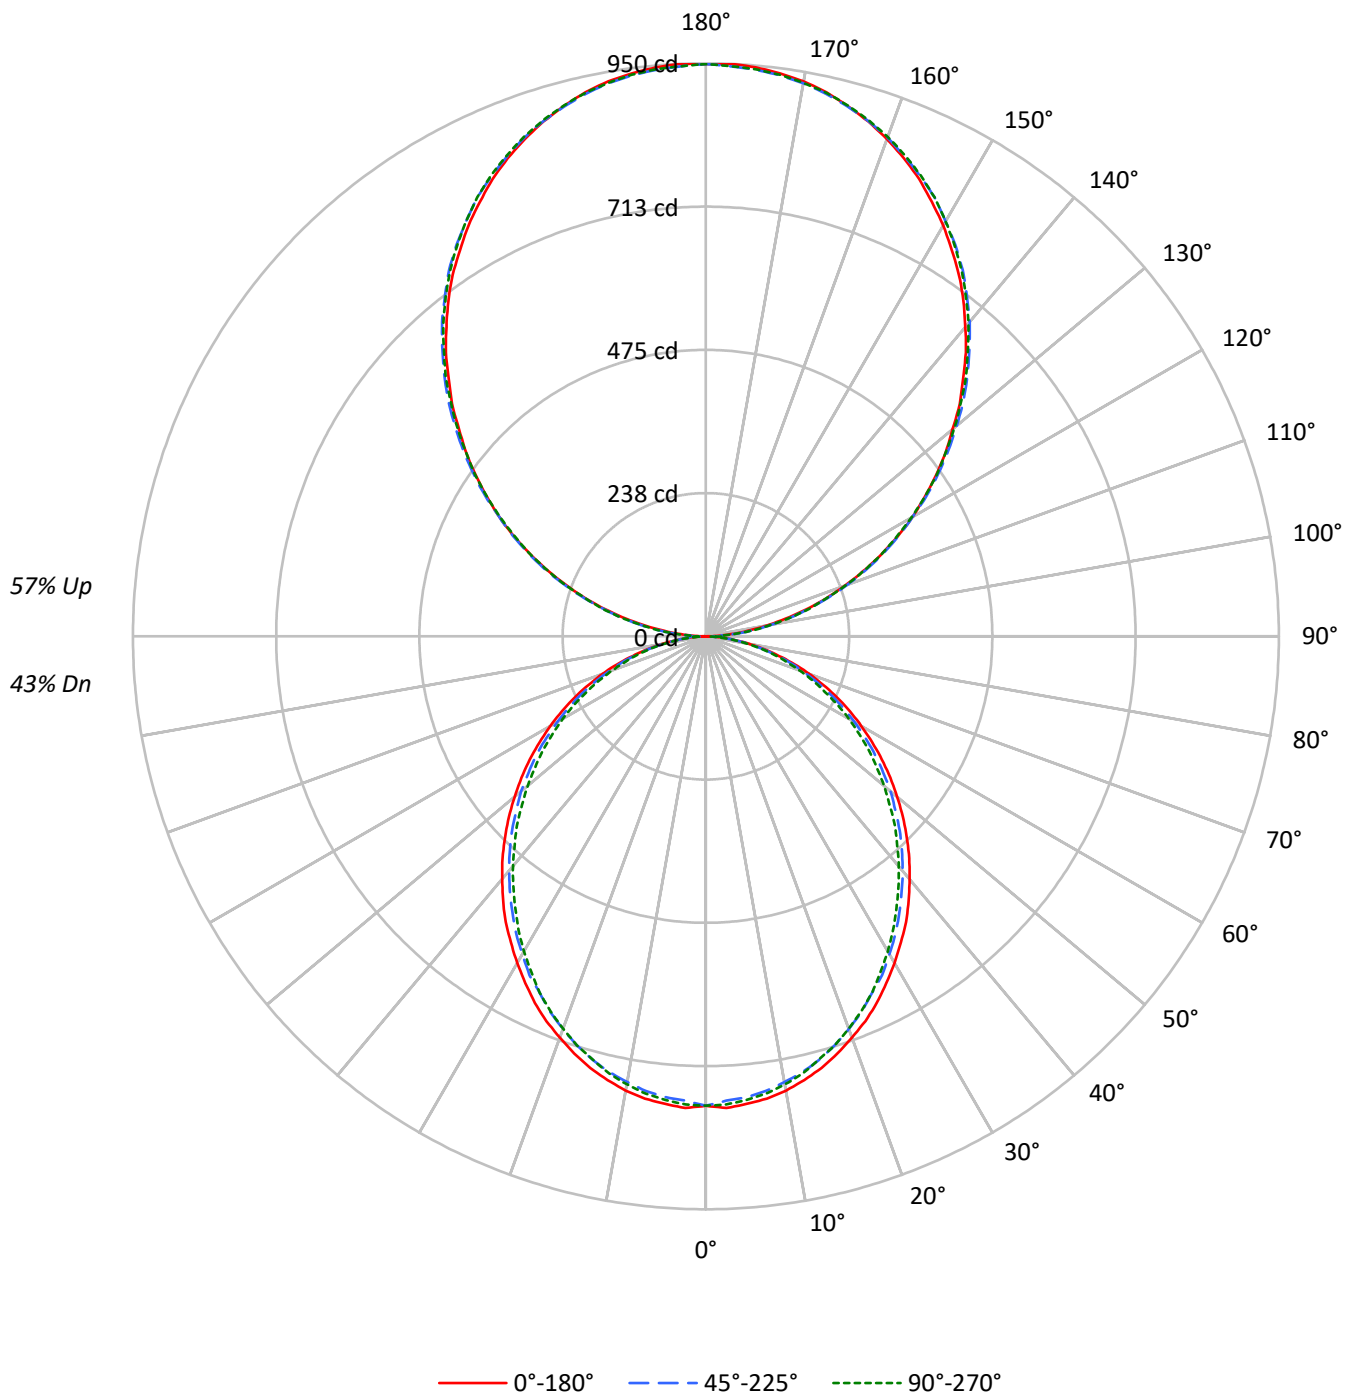

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1736	1736	1736
5°	1736	1708	1720
10°	1719	1681	1694
15°	1691	1649	1654
20°	1655	1607	1614
25°	1618	1557	1568
30°	1573	1511	1511
35°	1530	1456	1450
40°	1477	1401	1392
45°	1424	1346	1332
50°	1367	1288	1264
55°	1306	1220	1199
60°	1238	1141	1126
65°	1162	1058	1040
70°	1067	957	947
75°	935	836	856
80°	776	683	692
85°	528	430	430

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1424 cd/sqm

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	73.2	1.6
10°-20°	206.1	4.4
20°-30°	302.9	6.5
30°-40°	351.8	7.6
40°-50°	351.3	7.6
50°-60°	306.3	6.6
60°-70°	226.5	4.9
70°-80°	128.1	2.8
80°-90°	36.5	0.8
90°-100°	58.7	1.3
100°-110°	186.5	4.0
110°-120°	319.2	6.9
120°-130°	419.8	9.1
130°-140°	471.2	10.2
140°-150°	462.1	10.0
150°-160°	387.7	8.4
160°-170°	257.1	5.5
170°-180°	89.9	1.9
0°-30°	582.2	12.6
0°-40°	934.0	20.2
0°-60°	1591.6	34.3
0°-90°	1982.7	42.8
90°-120°	564.5	12.2
90°-150°	1917.7	41.4
90°-180°	2652.0	57.2
0°-180°	4635.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	778	778	778	778	778	
5°	778	775	767	773	772	74
15°	741	736	727	730	726	209
25°	670	664	652	653	652	309
35°	578	571	559	554	551	361
45°	471	466	454	446	443	363
55°	356	352	343	334	330	318
65°	240	236	228	222	218	238
75°	126	124	120	116	118	134
85°	31	30	29	27	26	34
90°	1	10	28	26	27	5
95°	42	50	51	51	50	46
105°	172	174	176	178	178	182
115°	320	325	324	323	320	317
125°	466	473	471	468	467	416
135°	603	612	613	612	610	466
145°	732	737	742	743	740	457
155°	837	839	842	846	843	385
165°	910	909	909	915	911	257
175°	947	945	943	949	944	90
180°	949	949	949	949	949	

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	778.2	778.2	778.2	778.2	778.2
2.5°	782.7	779.0	770.7	778.2	776.8
5°	778.2	775.3	767.0	773.0	771.5
7.5°	773.0	768.5	760.3	766.3	764.8
10°	764.8	759.6	750.6	756.5	754.3
12.5°	753.5	749.1	740.1	743.8	742.3
15°	740.8	736.4	726.6	729.6	725.9
17.5°	725.1	720.7	710.9	714.6	710.9
20°	707.9	703.4	692.9	695.2	692.2
22.5°	690.7	684.0	674.2	674.2	672.7
25°	670.5	664.5	651.8	653.2	651.8
27.5°	648.0	642.8	633.1	630.9	627.1
30°	625.6	619.6	608.4	606.2	603.1
32.5°	601.6	597.2	585.2	580.7	577.7
35°	578.5	571.0	559.0	554.5	550.7
37.5°	552.3	545.5	533.5	528.3	524.5
40°	525.3	519.3	507.3	500.7	497.6
42.5°	499.1	493.1	481.2	473.7	469.2
45°	470.7	465.5	454.2	446.0	443.0
47.5°	443.0	437.8	425.8	417.5	413.1
50°	413.8	410.1	399.6	389.1	385.4
52.5°	385.4	380.1	370.4	362.2	357.0
55°	356.2	351.7	342.7	333.8	330.0
57.5°	327.0	323.3	313.5	304.6	301.5
60°	297.8	294.9	284.4	276.1	273.9
62.5°	269.4	264.1	256.7	249.2	246.2
65°	240.2	235.7	228.3	221.5	217.8
67.5°	210.3	206.5	199.8	194.6	191.6
70°	182.6	179.6	172.8	167.6	164.7
72.5°	154.2	151.2	147.4	142.2	140.0
75°	125.7	124.3	120.4	116.0	117.5
77.5°	100.3	97.3	95.7	93.5	91.3
80°	74.9	74.1	72.6	70.3	68.8
82.5°	50.9	50.9	50.2	47.2	47.2
85°	30.6	29.9	29.2	26.9	26.2
87.5°	13.5	12.0	10.5	8.3	7.5
90°	0.9	10.3	28.0	26.3	27.2
92.5°	17.7	24.0	24.9	25.7	25.7
95°	41.8	49.8	51.2	51.2	49.8
97.5°	69.5	76.9	80.1	80.1	80.1
100°	101.5	108.1	110.4	110.4	109.6
102.5°	135.3	140.2	143.3	144.2	143.3
105°	172.2	174.5	176.2	177.6	177.6
107.5°	208.8	212.2	212.2	212.8	208.8
110°	244.3	248.9	248.9	248.9	246.6

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	282.6	287.5	286.6	284.3	282.6
115°	320.4	324.9	323.5	322.7	320.4
117.5°	357.8	364.1	360.1	357.8	355.5
120°	395.6	401.9	395.6	395.6	393.0
122.5°	429.9	437.9	433.9	431.6	429.9
125°	466.0	473.1	470.8	468.2	467.4
127.5°	501.1	510.0	506.9	503.4	501.1
130°	534.0	544.3	542.9	541.2	538.0
132.5°	570.9	578.9	579.5	575.5	573.2
135°	602.7	611.5	613.3	612.4	610.1
137.5°	638.1	645.3	646.7	646.2	642.7
140°	669.3	676.5	680.5	680.5	677.3
142.5°	701.4	708.5	710.8	711.7	708.5
145°	731.7	737.4	742.0	742.8	739.7
147.5°	758.9	766.0	769.4	770.9	767.7
150°	786.9	791.8	794.9	797.5	794.9
152.5°	811.8	816.6	820.6	823.8	820.6
155°	836.7	838.9	841.5	845.5	843.0
157.5°	858.1	859.8	861.3	867.0	863.0
160°	877.3	879.0	879.9	884.7	881.3
162.5°	895.0	895.0	895.9	901.3	897.3
165°	910.2	909.3	909.3	915.0	911.0
167.5°	923.9	921.3	921.3	927.0	923.0
170°	934.2	931.9	931.1	936.8	931.9
172.5°	941.3	939.1	938.2	943.9	939.1
175°	947.1	944.8	943.1	948.8	943.9
177.5°	950.2	947.9	946.2	951.1	946.2
180°	948.8	948.8	948.8	948.8	948.8

TEST NUMBER: P906993

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.35	9.15	9.37	10.18	11.55	7.93	8.73	8.94	9.75	11.12
	3H	9.98	10.70	11.01	11.73	13.13	9.52	10.24	10.55	11.27	12.66
	4H	10.55	11.23	11.59	12.27	13.67	10.09	10.77	11.13	11.81	13.21
	6H	10.93	11.56	11.98	12.60	14.01	10.47	11.10	11.52	12.14	13.55
	8H	11.02	11.62	12.08	12.68	14.08	10.57	11.16	11.62	12.22	13.62
	12H	11.06	11.63	12.12	12.68	14.11	10.60	11.17	11.66	12.22	13.65
4H	2H	8.80	9.48	9.84	10.51	11.91	8.46	9.14	9.50	10.17	11.57
	3H	10.63	11.20	11.68	12.26	13.67	10.25	10.81	11.30	11.88	13.29
	4H	11.32	11.84	12.38	12.90	14.33	10.93	11.45	11.99	12.50	13.94
	6H	11.81	12.26	12.88	13.34	14.77	11.41	11.86	12.48	12.94	14.37
	8H	11.95	12.37	13.02	13.44	14.88	11.55	11.97	12.62	13.04	14.48
	12H	12.01	12.39	13.10	13.47	14.92	11.60	11.98	12.69	13.07	14.51
8H	4H	11.50	11.92	12.57	12.99	14.44	11.15	11.57	12.22	12.64	14.08
	6H	12.10	12.45	13.20	13.56	15.00	11.75	12.10	12.84	13.21	14.65
	8H	12.31	12.61	13.41	13.71	15.17	11.95	12.25	13.05	13.35	14.81
	12H	12.42	12.69	13.53	13.78	15.28	12.05	12.32	13.16	13.41	14.91
12H	4H	11.48	11.86	12.57	12.95	14.40	11.14	11.52	12.23	12.60	14.05
	6H	12.13	12.43	13.23	13.53	14.99	11.79	12.09	12.89	13.19	14.65
	8H	12.35	12.62	13.45	13.71	15.21	12.00	12.27	13.11	13.36	14.86

END OF REPORT