

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907019

Luminaire Tested: DFN2DIP-TR2F0-030D040US835-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907019
REPORT IS A COMBINATION OF REPORTS P901764 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D040US835-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6090.0 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 54.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLLONL

Luminous Intensity Polar Plot

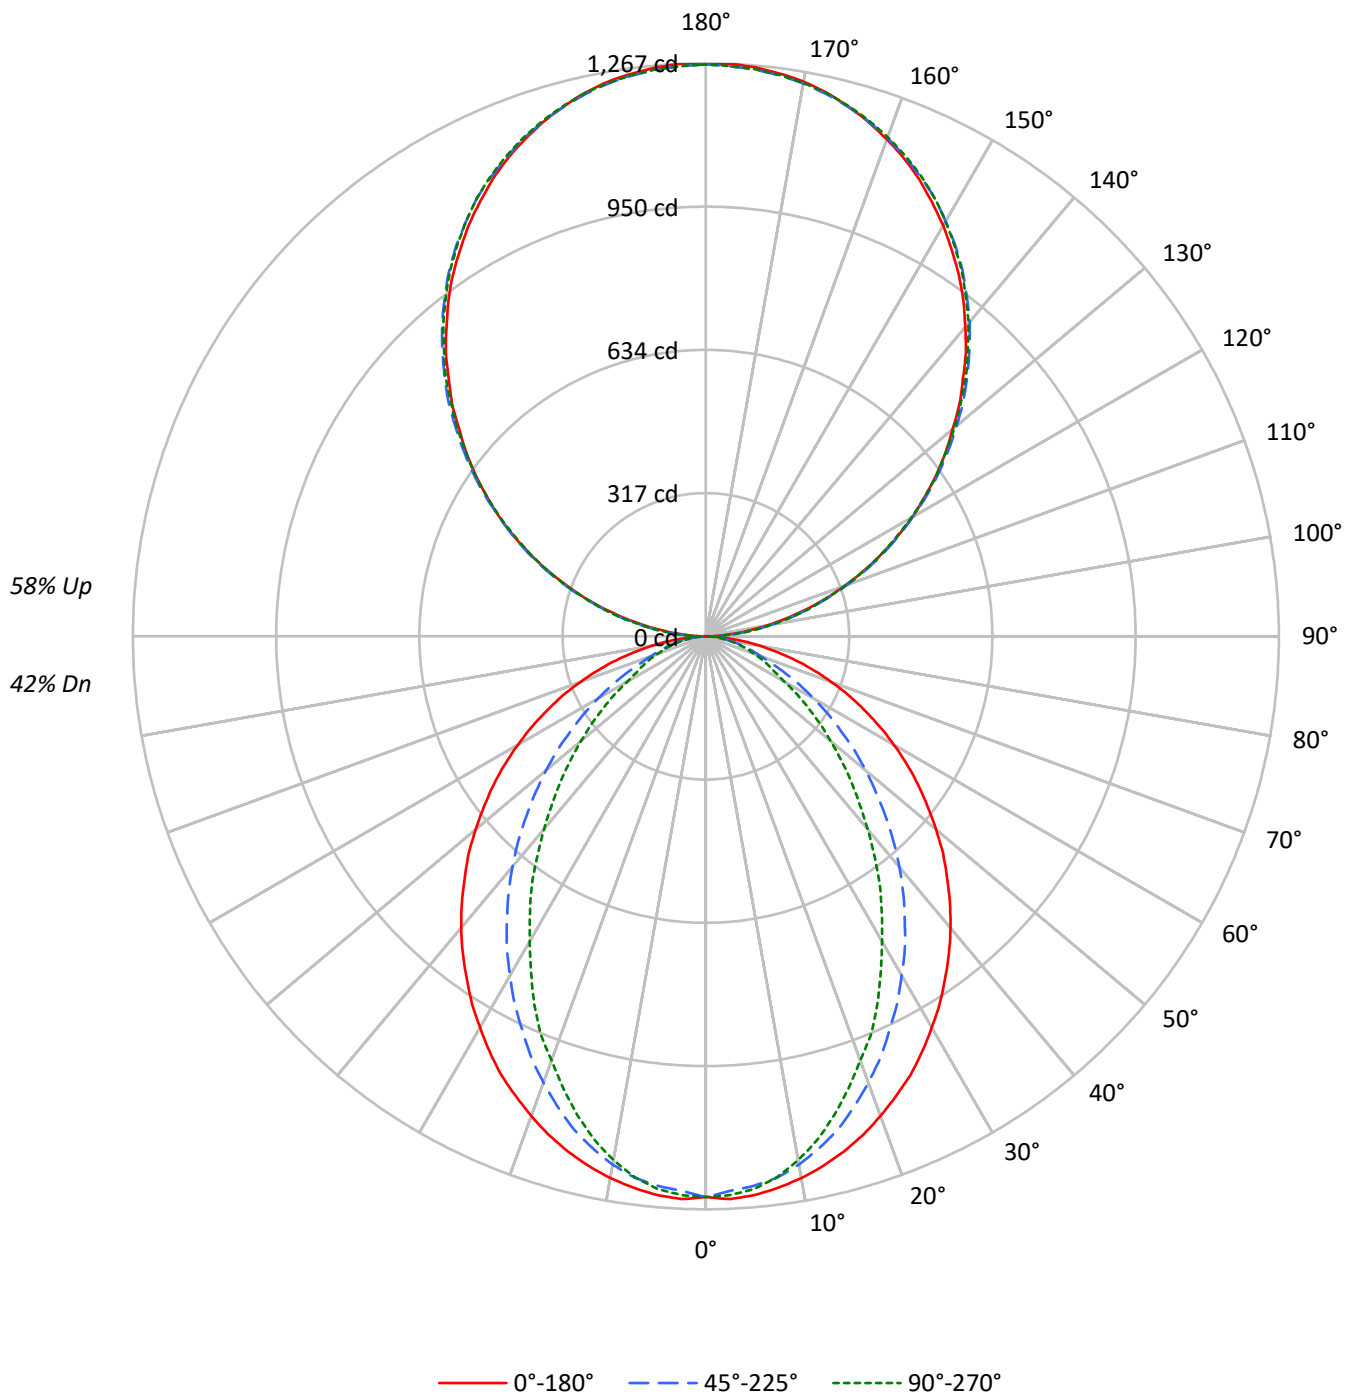

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2766	2766	2766
5°	2766	2716	2734
10°	2734	2656	2641
15°	2693	2562	2499
20°	2639	2436	2326
25°	2583	2295	2160
30°	2511	2151	1950
35°	2439	1997	1767
40°	2366	1838	1557
45°	2282	1663	1366
50°	2194	1486	1181
55°	2102	1298	1004
60°	1996	1103	822
65°	1873	905	734
70°	1724	721	658
75°	1536	624	589
80°	1267	506	497
85°	831	314	350

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2282 cd/sqm

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.2	1.9
10°-20°	319.0	5.2
20°-30°	447.9	7.4
30°-40°	488.2	8.0
40°-50°	448.7	7.4
50°-60°	352.4	5.8
60°-70°	229.4	3.8
70°-80°	118.1	1.9
80°-90°	33.7	0.6
90°-100°	78.3	1.3
100°-110°	248.7	4.1
110°-120°	425.6	7.0
120°-130°	559.8	9.2
130°-140°	628.3	10.3
140°-150°	616.2	10.1
150°-160°	516.9	8.5
160°-170°	342.8	5.6
170°-180°	119.8	2.0
0°-30°	883.1	14.5
0°-40°	1371.3	22.5
0°-60°	2172.4	35.7
0°-90°	2553.6	41.9
90°-120°	752.7	12.4
90°-150°	2556.9	42.0
90°-180°	3536.0	58.1
0°-180°	6090.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1240	1240	1240	1240	1240	
5°	1240	1234	1220	1230	1226	118
15°	1179	1167	1129	1108	1096	332
25°	1070	1034	960	914	898	492
35°	922	865	766	696	671	577
45°	754	679	561	481	454	582
55°	573	486	365	297	276	512
65°	387	296	195	157	154	384
75°	206	128	90	82	81	218
85°	48	25	21	21	21	55
90°	1	14	37	35	36	6
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1239.9	1239.9	1239.9	1239.9	1239.9
2.5°	1245.5	1239.9	1227.5	1238.8	1236.6
5°	1239.9	1234.3	1219.7	1229.8	1226.4
7.5°	1229.8	1223.1	1207.4	1211.8	1206.2
10°	1216.3	1208.5	1186.1	1182.6	1176.0
12.5°	1199.5	1189.4	1159.1	1152.4	1140.0
15°	1179.3	1166.9	1128.8	1107.5	1096.3
17.5°	1155.7	1137.8	1090.6	1066.0	1048.0
20°	1128.8	1106.3	1050.2	1022.3	997.5
22.5°	1099.7	1073.8	1008.7	970.6	953.8
25°	1070.5	1034.5	960.5	914.5	897.6
27.5°	1035.7	997.5	915.6	862.9	837.0
30°	998.7	956.0	866.2	809.1	778.7
32.5°	962.7	911.1	819.2	751.8	723.7
35°	922.4	865.1	766.4	695.7	671.0
37.5°	883.1	821.3	717.0	639.5	611.6
40°	841.6	774.3	665.4	585.7	556.6
42.5°	798.9	727.2	613.8	530.7	502.7
45°	754.1	678.8	561.1	481.3	454.4
47.5°	711.4	631.8	510.6	430.8	406.2
50°	664.3	584.6	461.2	383.7	360.2
52.5°	618.2	534.1	414.1	340.0	318.7
55°	573.3	485.8	364.6	297.4	276.1
57.5°	527.4	437.6	321.0	258.1	240.1
60°	480.2	390.5	274.9	217.7	199.8
62.5°	434.3	344.5	235.6	181.8	172.9
65°	387.1	296.2	195.2	157.1	153.7
67.5°	342.3	251.3	157.1	138.0	134.6
70°	295.1	207.6	130.1	118.9	114.4
72.5°	250.2	167.1	108.8	99.9	97.6
75°	206.4	127.9	89.8	81.9	80.8
77.5°	162.7	90.8	70.7	66.2	63.9
80°	122.3	65.1	53.8	49.4	49.4
82.5°	85.2	43.8	37.0	34.8	34.8
85°	48.2	24.6	21.3	21.3	21.3
87.5°	18.0	8.9	8.9	7.9	7.9
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P907019

CATALOG NUMBER: DFN2DIP-TR2F0-030D040US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.75	10.52	10.78	11.55	12.93	5.73	6.50	6.76	7.53	8.92
	3H	11.40	12.08	12.44	13.13	14.53	6.90	7.58	7.94	8.63	10.03
	4H	11.99	12.64	13.04	13.68	15.09	7.33	7.98	8.39	9.03	10.44
	6H	12.39	12.98	13.45	14.03	15.46	7.64	8.24	8.70	9.28	10.71
	8H	12.50	13.07	13.57	14.13	15.55	7.72	8.29	8.79	9.35	10.77
	12H	12.55	13.09	13.62	14.15	15.59	7.75	8.29	8.82	9.35	10.79
4H	2H	9.75	10.40	10.81	11.45	12.86	6.30	6.95	7.36	8.00	9.41
	3H	11.55	12.09	12.62	13.16	14.59	7.63	8.17	8.70	9.24	10.67
	4H	12.22	12.72	13.29	13.78	15.23	8.16	8.66	9.23	9.72	11.17
	6H	12.71	13.14	13.79	14.22	15.66	8.56	8.99	9.64	10.07	11.51
	8H	12.87	13.27	13.95	14.35	15.80	8.68	9.08	9.76	10.15	11.61
	12H	12.95	13.31	14.05	14.40	15.86	8.73	9.09	9.83	10.18	11.64
8H	4H	12.18	12.58	13.26	13.66	15.11	8.42	8.82	9.50	9.90	11.35
	6H	12.72	13.05	13.82	14.17	15.62	8.92	9.24	10.02	10.37	11.82
	8H	12.92	13.21	14.03	14.31	15.78	9.10	9.38	10.21	10.49	11.96
	12H	13.04	13.29	14.15	14.39	15.90	9.20	9.45	10.31	10.55	12.06
12H	4H	12.13	12.49	13.23	13.58	15.04	8.42	8.78	9.52	9.87	11.33
	6H	12.69	12.98	13.80	14.08	15.56	8.96	9.25	10.07	10.35	11.82
	8H	12.89	13.15	14.01	14.25	15.76	9.15	9.41	10.27	10.50	12.02

END OF REPORT