

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907057

Luminaire Tested: DFN2DIP-TR2F0-050D040US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907057
REPORT IS A COMBINATION OF REPORTS P901767 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D040US835-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8490.0 lumens
Efficiency: N/A
Efficacy: 110.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLLONL

Luminous Intensity Polar Plot

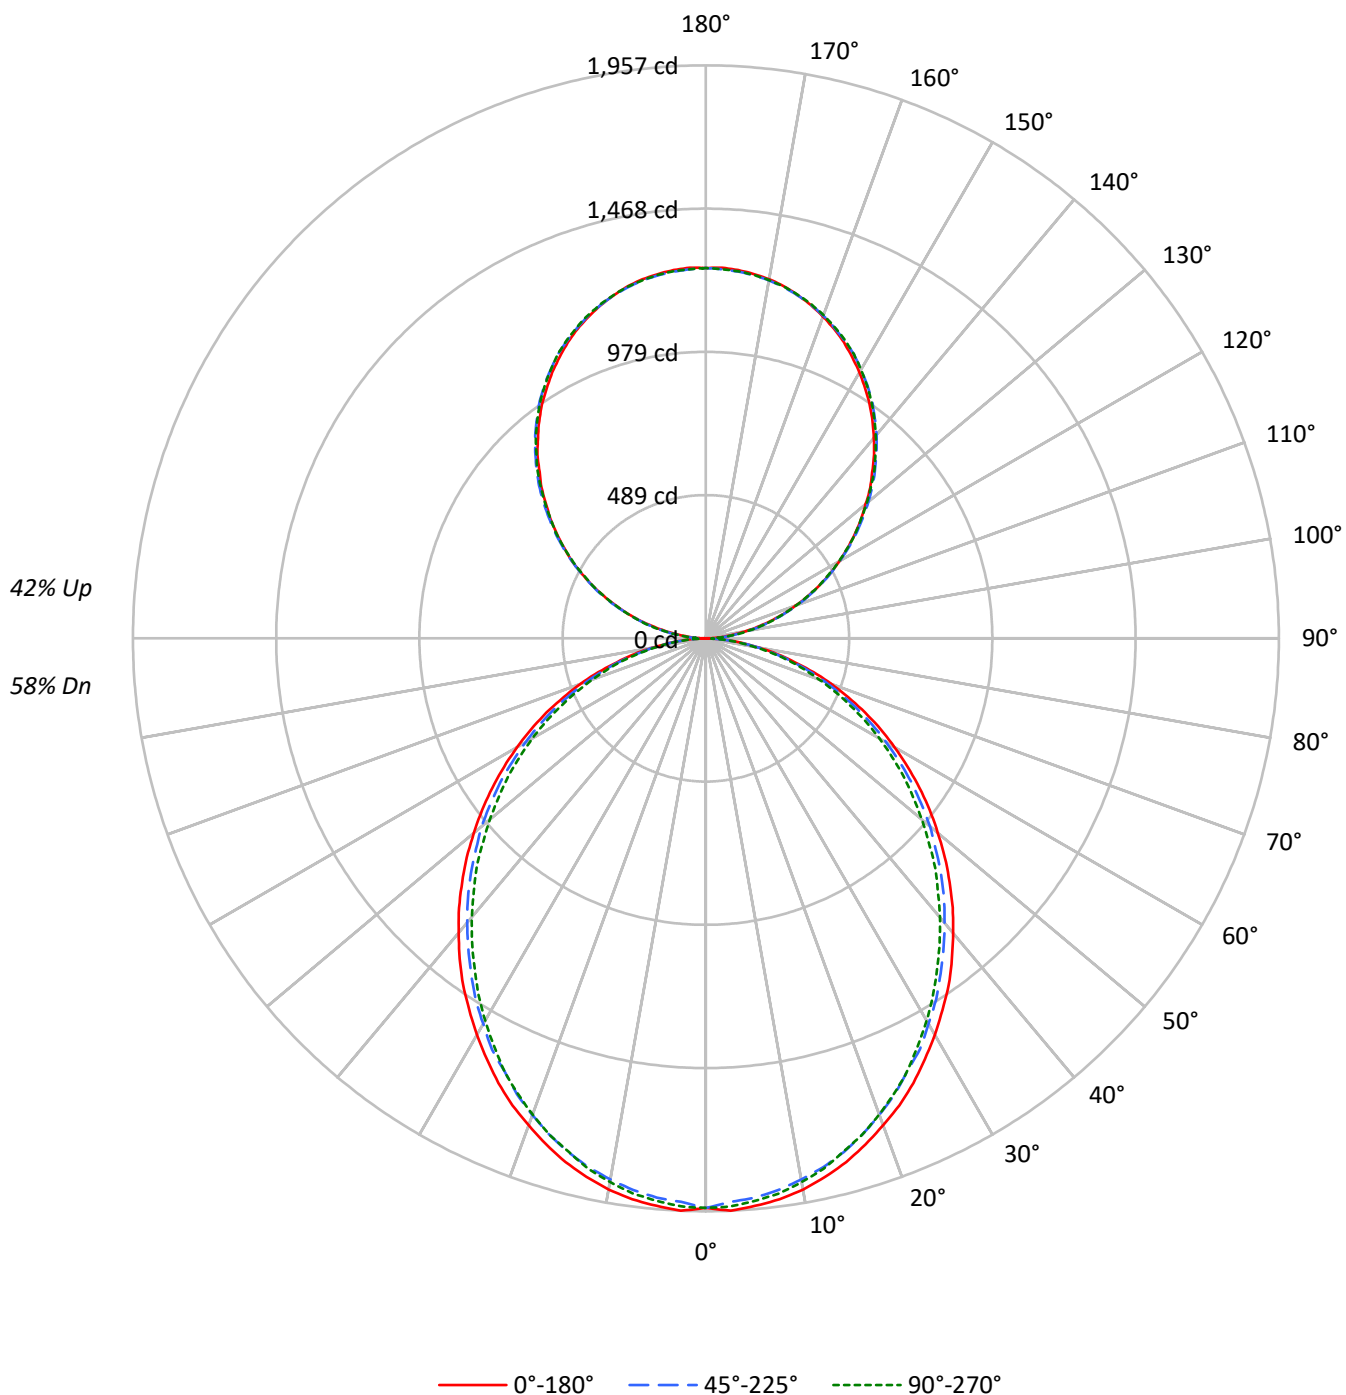

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4339	4339	4339
5°	4340	4269	4300
10°	4298	4202	4235
15°	4228	4123	4136
20°	4137	4018	4036
25°	4045	3893	3921
30°	3932	3777	3777
35°	3824	3641	3625
40°	3693	3503	3480
45°	3561	3365	3330
50°	3417	3219	3159
55°	3266	3051	2999
60°	3094	2853	2816
65°	2906	2645	2600
70°	2667	2393	2367
75°	2338	2091	2141
80°	1939	1706	1730
85°	1321	1075	1075

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3561 cd/sqm

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	183.1	2.2
10°-20°	515.2	6.1
20°-30°	757.2	8.9
30°-40°	879.4	10.4
40°-50°	878.3	10.3
50°-60°	765.8	9.0
60°-70°	566.1	6.7
70°-80°	320.3	3.8
80°-90°	88.1	1.0
90°-100°	78.3	0.9
100°-110°	248.7	2.9
110°-120°	425.6	5.0
120°-130°	559.8	6.6
130°-140°	628.3	7.4
140°-150°	616.2	7.3
150°-160°	516.9	6.1
160°-170°	342.8	4.0
170°-180°	119.8	1.4
0°-30°	1455.5	17.1
0°-40°	2334.9	27.5
0°-60°	3979.0	46.9
0°-90°	4953.6	58.3
90°-120°	752.7	8.9
90°-150°	2556.9	30.1
90°-180°	3536.0	41.6
0°-180°	8490.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	1	14	37	35	36	8
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P907057

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.98	13.92	13.86	14.82	15.97	12.56	13.50	13.44	14.40	15.55
	3H	14.62	15.47	15.52	16.38	17.55	14.16	15.01	15.05	15.92	17.09
	4H	15.20	16.00	16.11	16.91	18.10	14.74	15.54	15.65	16.45	17.64
	6H	15.58	16.32	16.50	17.24	18.44	15.12	15.86	16.04	16.78	17.98
	8H	15.68	16.38	16.61	17.32	18.52	15.22	15.92	16.15	16.87	18.06
	12H	15.72	16.39	16.66	17.33	18.55	15.26	15.93	16.19	16.86	18.08
4H	2H	13.44	14.24	14.35	15.16	16.34	13.10	13.90	14.02	14.82	16.00
	3H	15.29	15.95	16.21	16.90	18.10	14.90	15.57	15.83	16.52	17.71
	4H	15.99	16.59	16.92	17.54	18.76	15.59	16.20	16.53	17.14	18.36
	6H	16.48	17.01	17.43	17.98	19.20	16.09	16.61	17.04	17.58	18.80
	8H	16.62	17.11	17.57	18.07	19.31	16.23	16.72	17.18	17.68	18.91
	12H	16.69	17.13	17.66	18.11	19.35	16.28	16.73	17.25	17.70	18.95
8H	4H	16.18	16.67	17.13	17.63	18.87	15.83	16.32	16.78	17.28	18.51
	6H	16.78	17.19	17.76	18.19	19.43	16.43	16.84	17.41	17.84	19.08
	8H	16.99	17.35	17.98	18.34	19.59	16.63	16.99	17.62	17.99	19.24
	12H	17.11	17.43	18.10	18.41	19.71	16.74	17.06	17.73	18.04	19.34
12H	4H	16.16	16.61	17.14	17.59	18.83	15.82	16.26	16.79	17.24	18.48
	6H	16.81	17.17	17.80	18.16	19.41	16.47	16.83	17.46	17.82	19.07
	8H	17.04	17.36	18.03	18.34	19.64	16.69	17.01	17.68	17.99	19.29

END OF REPORT