

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907068

Luminaire Tested: DFN2DIP-TR2F0-060D020US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907068
REPORT IS A COMBINATION OF REPORTS P900229 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D020US835-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7710.0 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 74.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

Luminous Intensity Polar Plot

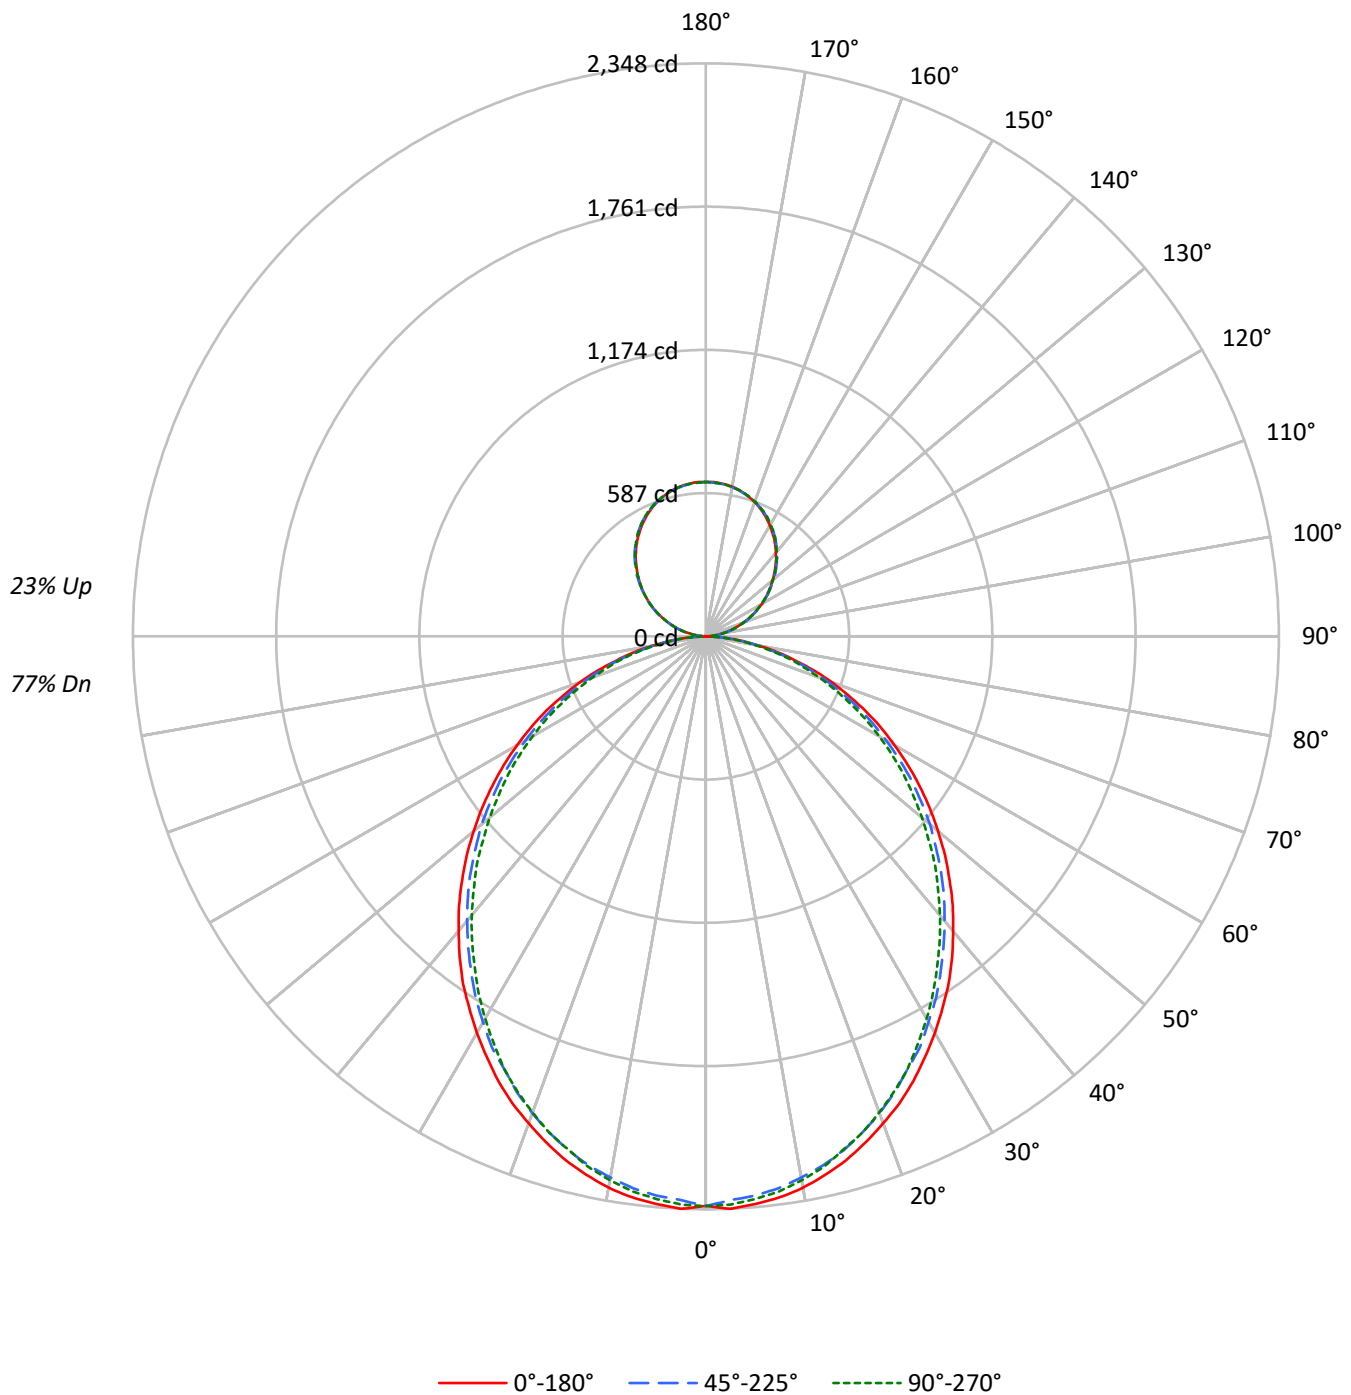

TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5207	5207	5207
5°	5208	5123	5160
10°	5158	5042	5081
15°	5074	4948	4963
20°	4964	4821	4843
25°	4854	4672	4705
30°	4719	4532	4532
35°	4589	4369	4350
40°	4431	4204	4175
45°	4273	4037	3997
50°	4101	3863	3791
55°	3919	3661	3599
60°	3713	3423	3379
65°	3487	3175	3121
70°	3200	2872	2840
75°	2805	2509	2569
80°	2326	2047	2076
85°	1585	1290	1290

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4273 cd/sqm

TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	2.8
10°-20°	618.3	8.0
20°-30°	908.6	11.8
30°-40°	1055.3	13.7
40°-50°	1054.0	13.7
50°-60°	919.0	11.9
60°-70°	679.4	8.8
70°-80°	384.4	5.0
80°-90°	103.2	1.3
90°-100°	39.1	0.5
100°-110°	124.4	1.6
110°-120°	212.8	2.8
120°-130°	279.9	3.6
130°-140°	314.2	4.1
140°-150°	308.1	4.0
150°-160°	258.4	3.4
160°-170°	171.4	2.2
170°-180°	59.9	0.8
0°-30°	1746.6	22.7
0°-40°	2801.8	36.3
0°-60°	4774.8	61.9
0°-90°	5941.8	77.1
90°-120°	376.3	4.9
90°-150°	1278.5	16.6
90°-180°	1768.0	22.9
0°-180°	7710.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	1	7	19	18	18	7
95°	28	33	34	34	33	31
105°	115	116	118	118	118	121
115°	214	217	216	215	214	211
125°	311	315	314	312	312	278
135°	402	408	409	408	407	311
145°	488	492	495	495	493	305
155°	558	559	561	564	562	257
165°	607	606	606	610	607	171
175°	631	630	629	632	629	60
180°	632	632	632	632	632	

TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	0.6	6.9	18.7	17.5	18.1
92.5°	11.8	16.0	16.6	17.2	17.2
95°	27.8	33.2	34.1	34.1	33.2
97.5°	46.3	51.3	53.4	53.4	53.4
100°	67.7	72.1	73.6	73.6	73.0
102.5°	90.2	93.4	95.5	96.1	95.5
105°	114.8	116.3	117.5	118.4	118.4
107.5°	139.2	141.5	141.5	141.9	139.2
110°	162.9	165.9	165.9	165.9	164.4



TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	188.4	191.6	191.1	189.5	188.4
115°	213.6	216.6	215.7	215.1	213.6
117.5°	238.6	242.8	240.1	238.6	237.0
120°	263.7	267.9	263.7	263.7	262.0
122.5°	286.6	291.9	289.3	287.8	286.6
125°	310.6	315.4	313.9	312.2	311.6
127.5°	334.1	340.0	337.9	335.6	334.1
130°	356.0	362.9	361.9	360.8	358.7
132.5°	380.6	386.0	386.3	383.7	382.1
135°	401.8	407.7	408.8	408.3	406.7
137.5°	425.4	430.2	431.2	430.8	428.5
140°	446.2	451.0	453.7	453.7	451.6
142.5°	467.6	472.3	473.9	474.4	472.3
145°	487.8	491.6	494.7	495.2	493.1
147.5°	505.9	510.7	513.0	513.9	511.8
150°	524.6	527.8	529.9	531.6	529.9
152.5°	541.2	544.4	547.1	549.2	547.1
155°	557.8	559.3	561.0	563.7	562.0
157.5°	572.1	573.2	574.2	578.0	575.3
160°	584.9	586.0	586.6	589.8	587.5
162.5°	596.7	596.7	597.2	600.9	598.2
165°	606.8	606.2	606.2	610.0	607.4
167.5°	615.9	614.2	614.2	618.0	615.4
170°	622.8	621.3	620.7	624.5	621.3
172.5°	627.6	626.0	625.5	629.3	626.0
175°	631.4	629.9	628.7	632.5	629.3
177.5°	633.5	632.0	630.8	634.0	630.8
180°	632.5	632.5	632.5	632.5	632.5

TEST NUMBER: P907068

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.07	16.25	15.76	16.95	17.77	14.65	15.82	15.34	16.53	17.35
	3H	16.73	17.79	17.43	18.50	19.36	16.27	17.33	16.97	18.04	18.90
	4H	17.32	18.31	18.04	19.04	19.91	16.86	17.85	17.58	18.58	19.45
	6H	17.72	18.63	18.45	19.37	20.25	17.26	18.17	17.99	18.91	19.79
	8H	17.82	18.70	18.56	19.45	20.33	17.36	18.24	18.10	18.99	19.88
	12H	17.87	18.71	18.62	19.45	20.37	17.41	18.24	18.15	18.99	19.90
4H	2H	15.56	16.56	16.28	17.28	18.15	15.22	16.22	15.94	16.94	17.81
	3H	17.43	18.26	18.16	19.02	19.91	17.05	17.88	17.78	18.64	19.52
	4H	18.14	18.89	18.89	19.65	20.57	17.74	18.50	18.49	19.26	20.17
	6H	18.65	19.30	19.41	20.09	21.01	18.25	18.91	19.02	19.69	20.62
	8H	18.79	19.40	19.56	20.19	21.12	18.40	19.01	19.17	19.79	20.73
	12H	18.87	19.42	19.66	20.23	21.17	18.46	19.02	19.26	19.82	20.76
8H	4H	18.35	18.96	19.12	19.74	20.68	18.00	18.61	18.77	19.39	20.33
	6H	18.96	19.47	19.77	20.30	21.23	18.61	19.12	19.41	19.94	20.88
	8H	19.17	19.62	19.99	20.45	21.40	18.82	19.27	19.63	20.09	21.05
	12H	19.30	19.70	20.12	20.51	21.53	18.93	19.33	19.75	20.15	21.16
12H	4H	18.35	18.90	19.14	19.70	20.64	18.00	18.55	18.79	19.36	20.30
	6H	18.99	19.44	19.80	20.27	21.22	18.65	19.10	19.46	19.93	20.88
	8H	19.23	19.63	20.05	20.44	21.46	18.89	19.28	19.70	20.10	21.11