

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909785

Luminaire Tested: DFN2DIP-TR2F0-050D040US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909785
REPORT IS A COMBINATION OF REPORTS P901767 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D040US840-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8573.8 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLLONL

Luminous Intensity Polar Plot

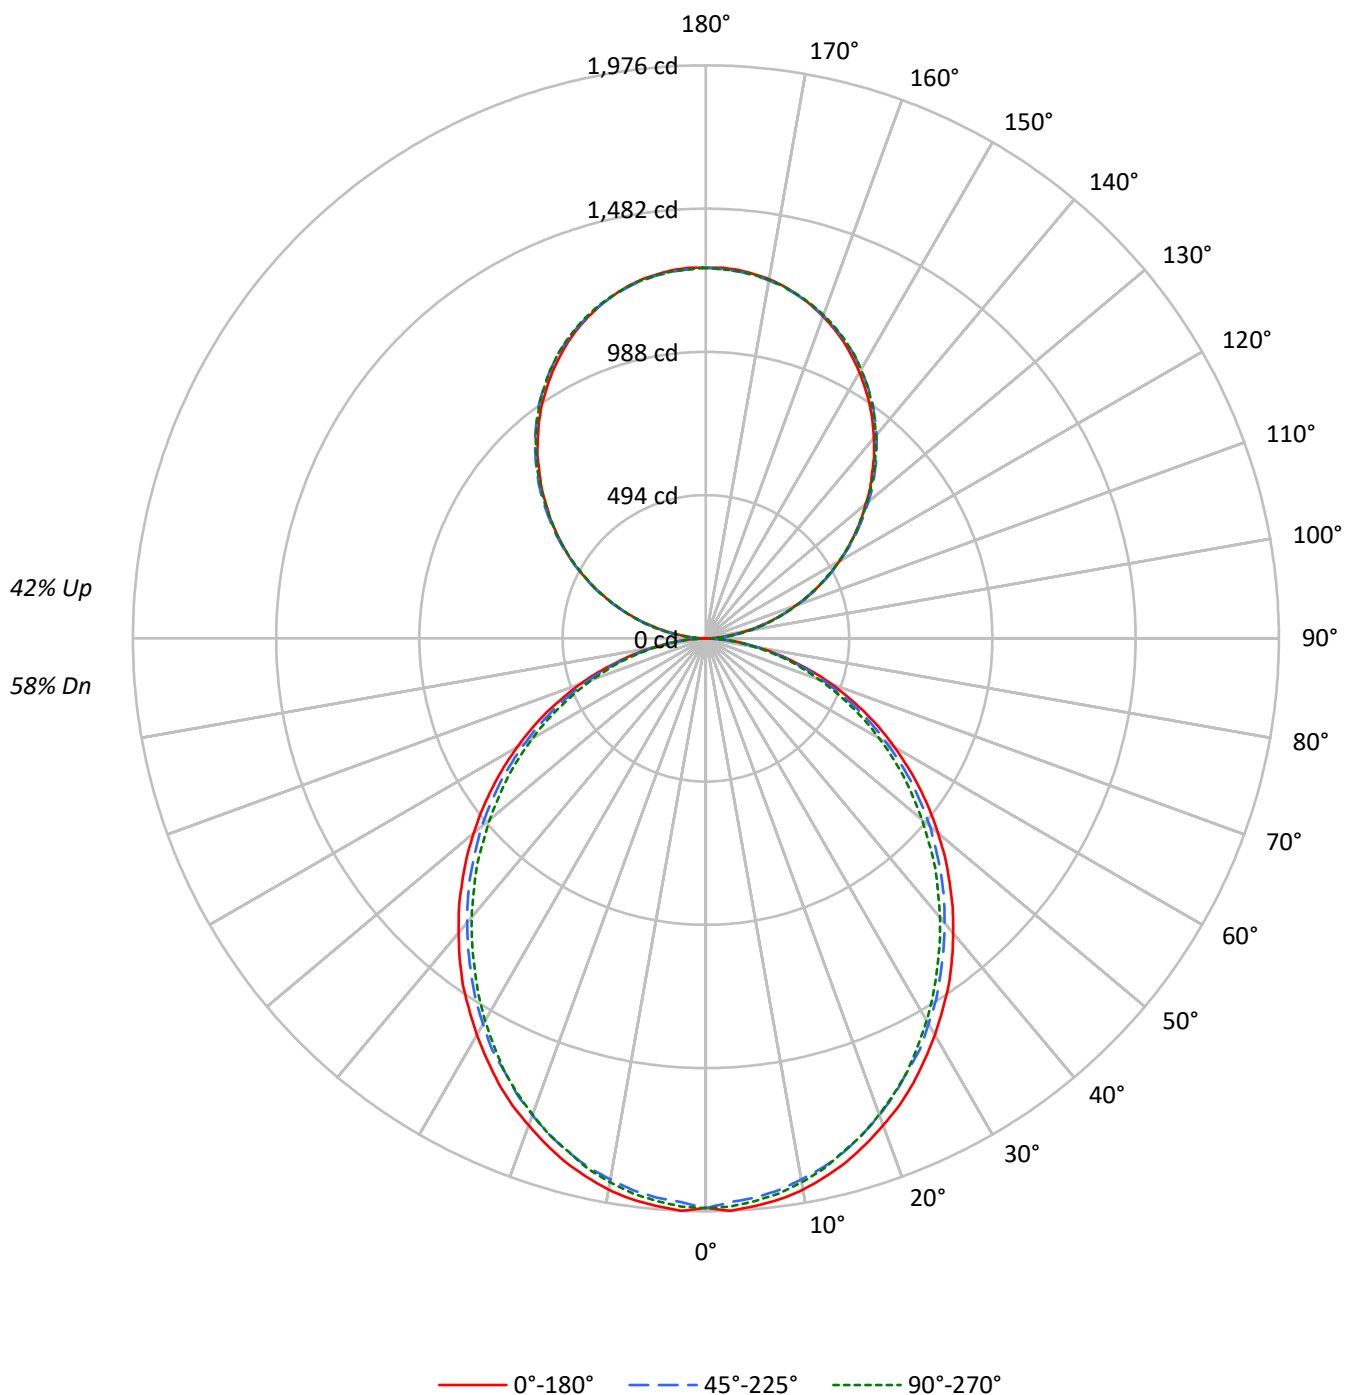

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4382	4382	4382
5°	4383	4311	4343
10°	4341	4244	4276
15°	4270	4164	4177
20°	4178	4057	4076
25°	4085	3932	3960
30°	3971	3814	3814
35°	3862	3677	3661
40°	3729	3538	3514
45°	3596	3398	3363
50°	3451	3251	3190
55°	3298	3081	3028
60°	3124	2881	2844
65°	2934	2671	2626
70°	2693	2417	2390
75°	2361	2112	2162
80°	1957	1723	1748
85°	1335	1085	1085

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3596 cd/sqm

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.9	2.2
10°-20°	520.3	6.1
20°-30°	764.6	8.9
30°-40°	888.1	10.4
40°-50°	887.0	10.3
50°-60°	773.4	9.0
60°-70°	571.7	6.7
70°-80°	323.5	3.8
80°-90°	89.0	1.0
90°-100°	79.1	0.9
100°-110°	251.2	2.9
110°-120°	429.8	5.0
120°-130°	565.3	6.6
130°-140°	634.5	7.4
140°-150°	622.2	7.3
150°-160°	522.0	6.1
160°-170°	346.2	4.0
170°-180°	121.0	1.4
0°-30°	1469.8	17.1
0°-40°	2357.9	27.5
0°-60°	4018.3	46.9
0°-90°	5002.5	58.3
90°-120°	760.1	8.9
90°-150°	2582.2	30.1
90°-180°	3571.0	41.7
0°-180°	8573.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1965	1965	1965	1965	1965	
5°	1965	1957	1936	1952	1948	187
15°	1870	1859	1834	1842	1833	527
25°	1693	1678	1646	1649	1646	779
35°	1460	1442	1411	1400	1390	912
45°	1188	1175	1147	1126	1118	917
55°	899	888	865	843	833	804
65°	606	595	576	559	550	600
75°	317	314	304	293	297	339
85°	77	76	74	68	66	86
90°	1	14	38	35	37	8
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.7	1964.7	1964.7	1964.7	1964.7
2.5°	1976.1	1966.7	1945.9	1964.7	1961.2
5°	1964.7	1957.3	1936.4	1951.5	1947.9
7.5°	1951.5	1940.3	1919.5	1934.7	1930.9
10°	1930.9	1917.6	1895.0	1910.0	1904.4
12.5°	1902.4	1891.2	1868.6	1877.9	1874.1
15°	1870.3	1859.1	1834.4	1842.1	1832.6
17.5°	1830.6	1819.4	1794.7	1804.1	1794.7
20°	1787.2	1775.9	1749.5	1755.0	1747.7
22.5°	1743.8	1726.8	1702.1	1702.1	1698.3
25°	1692.7	1677.7	1645.6	1649.2	1645.6
27.5°	1636.0	1622.8	1598.3	1592.7	1583.3
30°	1579.4	1564.3	1536.0	1530.4	1522.8
32.5°	1518.9	1507.7	1477.4	1466.0	1458.4
35°	1460.4	1441.6	1411.3	1399.9	1390.5
37.5°	1394.2	1377.3	1347.0	1333.7	1324.3
40°	1326.4	1311.1	1280.8	1263.9	1256.4
42.5°	1260.2	1245.0	1214.9	1195.8	1184.6
45°	1188.4	1175.2	1146.7	1126.1	1118.4
47.5°	1118.4	1105.2	1075.0	1054.1	1042.9
50°	1044.7	1035.3	1008.9	982.4	972.9
52.5°	972.9	959.7	935.2	914.4	901.2
55°	899.4	888.0	865.3	842.6	833.2
57.5°	825.6	816.2	791.5	768.9	761.2
60°	751.8	744.5	718.0	697.1	691.6
62.5°	680.1	666.9	648.0	629.1	621.6
65°	606.5	595.1	576.2	559.3	549.8
67.5°	531.0	521.4	504.5	491.3	483.6
70°	461.0	453.4	436.4	423.1	415.8
72.5°	389.3	381.6	372.2	359.0	353.4
75°	317.3	313.7	304.1	292.9	296.7
77.5°	253.2	245.5	241.8	236.1	230.6
80°	189.0	187.0	183.2	177.6	173.8
82.5°	128.5	128.5	126.6	119.1	119.1
85°	77.4	75.5	73.7	68.0	66.1
87.5°	34.0	30.3	26.5	20.8	18.9
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P909785

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.01	13.95	13.89	14.86	16.00	12.59	13.53	13.47	14.43	15.58
	3H	14.66	15.50	15.55	16.41	17.58	14.19	15.04	15.09	15.95	17.12
	4H	15.23	16.03	16.14	16.95	18.13	14.77	15.57	15.68	16.49	17.67
	6H	15.62	16.35	16.54	17.28	18.47	15.16	15.89	16.08	16.82	18.01
	8H	15.71	16.42	16.64	17.36	18.55	15.26	15.96	16.18	16.90	18.09
	12H	15.76	16.43	16.69	17.36	18.58	15.29	15.96	16.23	16.90	18.12
4H	2H	13.47	14.27	14.39	15.19	16.37	13.14	13.93	14.05	14.85	16.03
	3H	15.32	15.99	16.25	16.94	18.13	14.94	15.60	15.86	16.55	17.75
	4H	16.02	16.63	16.96	17.57	18.79	15.62	16.23	16.56	17.18	18.40
	6H	16.52	17.04	17.47	18.01	19.23	16.12	16.65	17.07	17.61	18.84
	8H	16.66	17.15	17.61	18.11	19.35	16.26	16.75	17.21	17.71	18.95
	12H	16.72	17.17	17.69	18.14	19.39	16.32	16.76	17.29	17.74	18.98
8H	4H	16.21	16.70	17.16	17.66	18.90	15.86	16.35	16.81	17.31	18.55
	6H	16.82	17.23	17.80	18.23	19.46	16.47	16.87	17.44	17.88	19.11
	8H	17.02	17.38	18.01	18.38	19.63	16.67	17.03	17.66	18.02	19.27
	12H	17.14	17.46	18.13	18.45	19.75	16.78	17.09	17.77	18.08	19.38
12H	4H	16.20	16.64	17.17	17.62	18.86	15.86	16.30	16.83	17.28	18.52
	6H	16.84	17.20	17.83	18.20	19.45	16.50	16.86	17.49	17.85	19.11
	8H	17.07	17.39	18.06	18.37	19.67	16.73	17.04	17.72	18.03	19.33

END OF REPORT