

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912447

Luminaire Tested: DFN2DIP-TR2F0-020D020US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912447
REPORT IS A COMBINATION OF REPORTS P901742 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-020D020US850-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3848.2 lumens
Efficiency: N/A
Efficacy: 126.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 30.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLLONL

Luminous Intensity Polar Plot

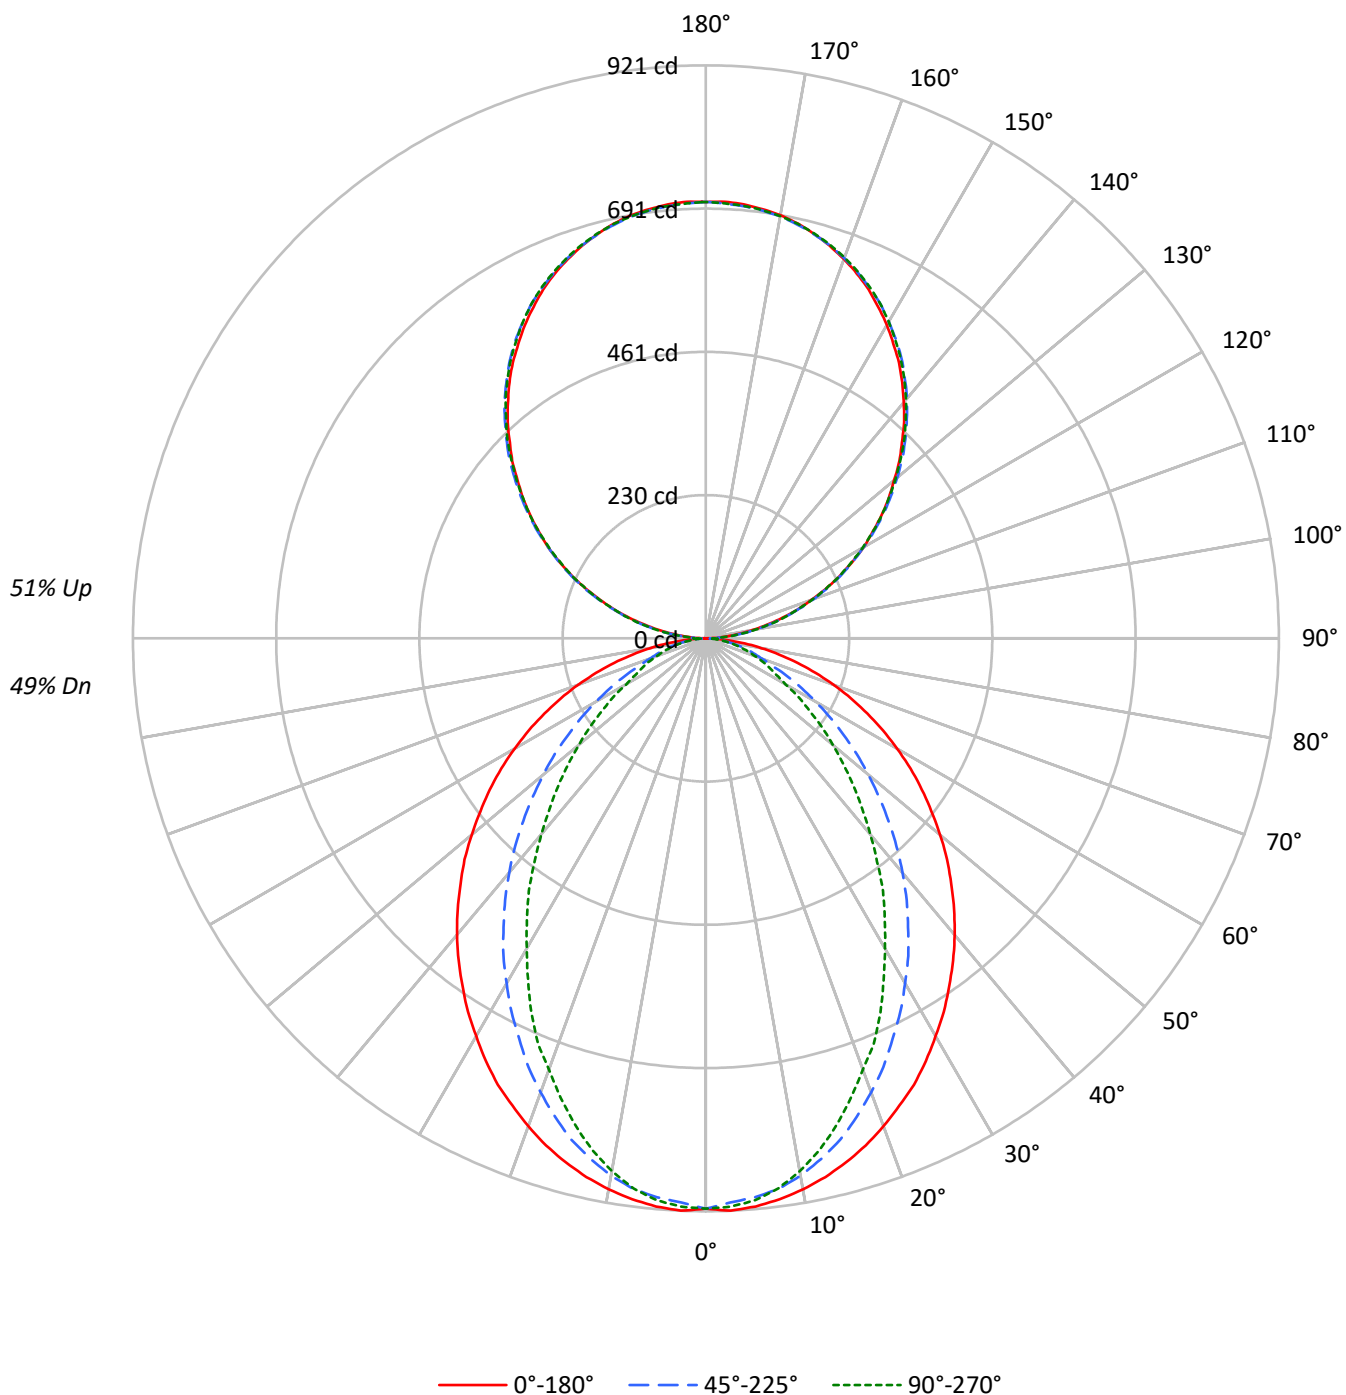

TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2045	2045	2045
5°	2045	2008	2021
10°	2022	1964	1952
15°	1991	1894	1848
20°	1951	1801	1720
25°	1910	1697	1597
30°	1856	1590	1442
35°	1803	1476	1306
40°	1749	1359	1151
45°	1687	1229	1010
50°	1623	1099	873
55°	1554	960	742
60°	1476	816	607
65°	1385	669	543
70°	1274	533	486
75°	1136	460	436
80°	936	374	367
85°	614	231	258

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1687 cd/sqm

TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	85.9	2.2
10°-20°	235.8	6.1
20°-30°	331.1	8.6
30°-40°	361.0	9.4
40°-50°	331.8	8.6
50°-60°	260.6	6.8
60°-70°	169.6	4.4
70°-80°	87.3	2.3
80°-90°	24.3	0.6
90°-100°	43.4	1.1
100°-110°	137.9	3.6
110°-120°	236.0	6.1
120°-130°	310.4	8.1
130°-140°	348.4	9.1
140°-150°	341.7	8.9
150°-160°	286.6	7.4
160°-170°	190.1	4.9
170°-180°	66.4	1.7
0°-30°	652.9	17.0
0°-40°	1013.8	26.3
0°-60°	1606.2	41.7
0°-90°	1887.3	49.0
90°-120°	417.3	10.8
90°-150°	1417.8	36.8
90°-180°	1961.0	51.0
0°-180°	3848.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	917	917	917	917	917	
5°	917	913	902	909	907	87
15°	872	863	834	819	811	246
25°	792	765	710	676	664	364
35°	682	640	567	514	496	427
45°	558	502	415	356	336	431
55°	424	359	270	220	204	379
65°	286	219	144	116	114	284
75°	153	94	66	61	60	161
85°	36	18	16	16	16	41
90°	1	8	21	19	20	4
95°	31	37	38	38	37	34
105°	127	129	130	131	131	134
115°	237	240	239	238	237	234
125°	344	350	348	346	346	308
135°	446	452	453	453	451	344
145°	541	545	549	549	547	338
155°	619	620	622	625	623	285
165°	673	672	672	676	674	190
175°	700	699	697	701	698	67
180°	701	701	701	701	701	

TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	916.7	916.7	916.7	916.7	916.7
2.5°	920.8	916.7	907.5	915.9	914.3
5°	916.7	912.6	901.7	909.3	906.7
7.5°	909.3	904.3	892.6	896.0	891.7
10°	899.3	893.4	876.9	874.3	869.5
12.5°	886.9	879.3	856.9	852.0	842.8
15°	871.9	862.7	834.5	818.8	810.6
17.5°	854.5	841.2	806.4	788.1	774.9
20°	834.5	817.9	776.5	755.8	737.5
22.5°	813.0	793.9	745.8	717.6	705.2
25°	791.5	764.9	710.1	676.2	663.6
27.5°	765.8	737.5	676.9	637.9	618.8
30°	738.4	706.8	640.4	598.2	575.7
32.5°	711.8	673.6	605.6	555.8	535.1
35°	681.9	639.7	566.7	514.4	496.1
37.5°	652.9	607.2	530.1	472.9	452.1
40°	622.1	572.5	492.0	433.1	411.4
42.5°	590.7	537.6	453.8	392.4	371.7
45°	557.5	501.8	414.9	355.9	335.9
47.5°	526.0	467.1	377.5	318.5	300.3
50°	491.2	432.3	341.0	283.7	266.4
52.5°	457.0	394.8	306.1	251.4	235.7
55°	423.9	359.2	269.6	219.9	204.1
57.5°	389.9	323.5	237.3	190.9	177.6
60°	355.1	288.7	203.3	161.0	147.7
62.5°	321.1	254.7	174.2	134.4	127.8
65°	286.2	219.0	144.4	116.2	113.7
67.5°	253.1	185.8	116.2	102.0	99.6
70°	218.1	153.5	96.2	87.9	84.6
72.5°	185.0	123.5	80.4	73.9	72.2
75°	152.6	94.5	66.3	60.6	59.8
77.5°	120.3	67.2	52.2	48.9	47.2
80°	90.4	48.1	39.8	36.5	36.5
82.5°	63.0	32.4	27.4	25.7	25.7
85°	35.6	18.2	15.7	15.7	15.7
87.5°	13.3	6.7	6.7	5.8	5.8
90°	0.7	7.7	20.7	19.4	20.1
92.5°	13.1	17.7	18.4	19.1	19.1
95°	30.8	36.8	37.8	37.8	36.8
97.5°	51.3	56.9	59.2	59.2	59.2
100°	75.1	80.0	81.6	81.6	81.0
102.5°	100.0	103.6	105.9	106.6	105.9
105°	127.3	129.0	130.3	131.3	131.3
107.5°	154.4	156.9	156.9	157.4	154.4
110°	180.7	184.0	184.0	184.0	182.3



TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	208.9	212.5	211.9	210.2	208.9
115°	236.9	240.2	239.2	238.5	236.9
117.5°	264.6	269.3	266.3	264.6	262.8
120°	292.4	297.1	292.4	292.4	290.6
122.5°	317.8	323.7	320.8	319.2	317.8
125°	344.5	349.8	348.1	346.2	345.6
127.5°	370.5	377.1	374.7	372.2	370.5
130°	394.8	402.5	401.3	400.1	397.8
132.5°	422.1	428.1	428.4	425.5	423.7
135°	445.6	452.1	453.4	452.8	451.0
137.5°	471.8	477.1	478.2	477.8	475.2
140°	494.8	500.2	503.2	503.2	500.8
142.5°	518.6	523.8	525.6	526.1	523.8
145°	541.0	545.2	548.6	549.2	546.8
147.5°	561.0	566.4	568.9	569.9	567.6
150°	581.8	585.3	587.7	589.5	587.7
152.5°	600.2	603.7	606.7	609.1	606.7
155°	618.6	620.3	622.1	625.1	623.3
157.5°	634.5	635.7	636.8	641.0	638.0
160°	648.7	649.9	650.5	654.1	651.5
162.5°	661.7	661.7	662.3	666.4	663.4
165°	672.9	672.3	672.3	676.5	673.6
167.5°	683.0	681.1	681.1	685.4	682.5
170°	690.7	689.0	688.4	692.6	689.0
172.5°	696.0	694.2	693.7	697.9	694.2
175°	700.2	698.6	697.2	701.4	697.9
177.5°	702.6	700.9	699.6	703.1	699.6
180°	701.4	701.4	701.4	701.4	701.4

TEST NUMBER: P912447

CATALOG NUMBER: DFN2DIP-TR2F0-020D020US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.41	10.23	10.38	11.21	12.50	5.40	6.22	6.37	7.20	8.49
	3H	11.06	11.80	12.05	12.79	14.10	6.57	7.30	7.55	8.29	9.60
	4H	11.66	12.35	12.65	13.35	14.66	7.01	7.70	8.00	8.70	10.01
	6H	12.06	12.70	13.07	13.70	15.03	7.31	7.95	8.32	8.95	10.28
	8H	12.17	12.78	13.19	13.80	15.12	7.40	8.00	8.41	9.02	10.35
	12H	12.23	12.80	13.24	13.81	15.16	7.43	8.01	8.45	9.02	10.37
4H	2H	9.42	10.12	10.43	11.11	12.43	5.98	6.67	6.98	7.67	8.98
	3H	11.23	11.80	12.24	12.83	14.16	7.31	7.89	8.32	8.91	10.24
	4H	11.90	12.43	12.92	13.44	14.80	7.84	8.37	8.86	9.39	10.74
	6H	12.39	12.85	13.42	13.88	15.24	8.24	8.70	9.27	9.74	11.09
	8H	12.55	12.98	13.58	14.01	15.37	8.36	8.79	9.39	9.82	11.18
	12H	12.64	13.02	13.68	14.06	15.44	8.42	8.80	9.47	9.85	11.22
8H	4H	11.86	12.29	12.89	13.32	14.68	8.11	8.53	9.14	9.56	10.93
	6H	12.40	12.75	13.46	13.83	15.19	8.60	8.95	9.66	10.03	11.39
	8H	12.60	12.91	13.67	13.97	15.35	8.78	9.09	9.84	10.15	11.53
	12H	12.73	13.00	13.79	14.05	15.47	8.89	9.16	9.95	10.21	11.63
12H	4H	11.81	12.20	12.86	13.24	14.61	8.11	8.49	9.16	9.54	10.91
	6H	12.38	12.68	13.44	13.74	15.13	8.64	8.95	9.71	10.01	11.39
	8H	12.58	12.85	13.65	13.90	15.33	8.84	9.11	9.91	10.16	11.59

END OF REPORT