

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912480

Luminaire Tested: DFN2DIP-TR2F0-030D060US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912480
REPORT IS A COMBINATION OF REPORTS P900263 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D060US850-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9182.5 lumens
Efficiency: N/A
Efficacy: 124.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 73.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

Luminous Intensity Polar Plot

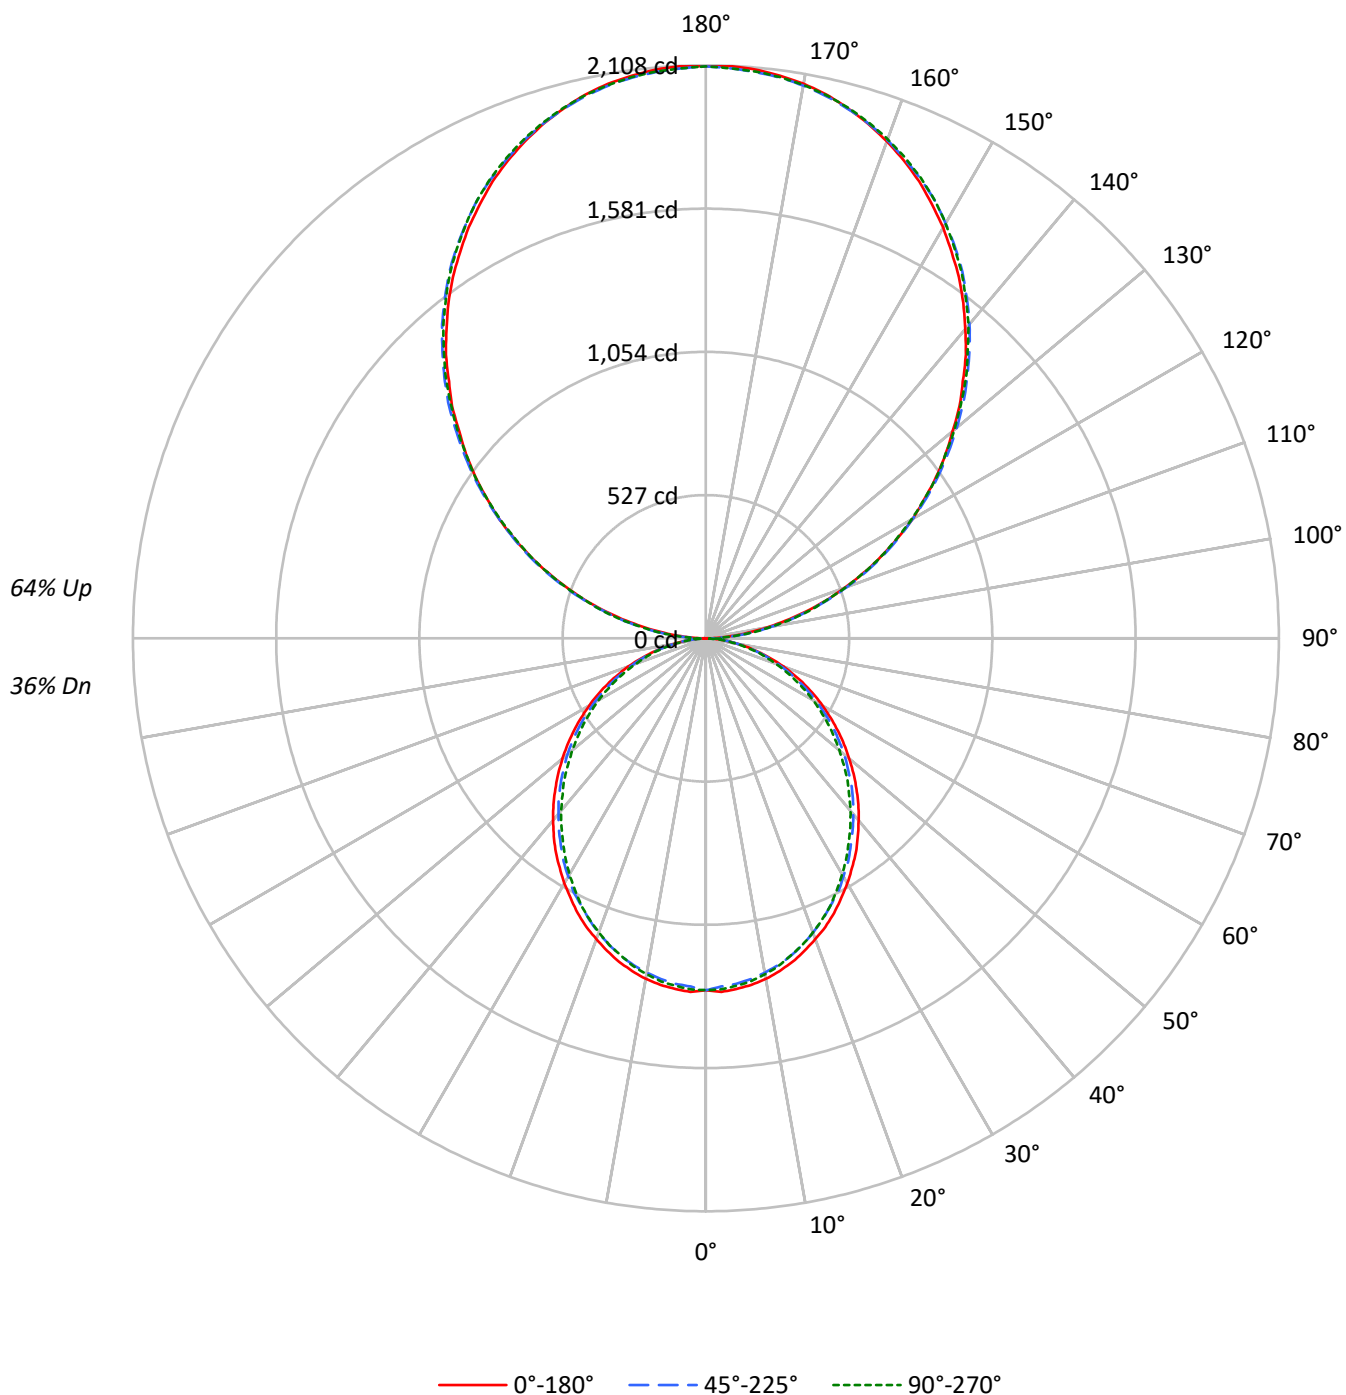

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2887	2887	2887
5°	2888	2841	2861
10°	2860	2796	2818
15°	2814	2744	2752
20°	2752	2673	2685
25°	2692	2591	2609
30°	2616	2513	2513
35°	2545	2422	2412
40°	2457	2331	2315
45°	2370	2239	2216
50°	2274	2142	2102
55°	2173	2030	1996
60°	2059	1898	1874
65°	1934	1760	1731
70°	1775	1593	1575
75°	1555	1392	1425
80°	1289	1135	1152
85°	879	716	716

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2745 cd/sqm

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	121.8	1.3
10°-20°	342.8	3.7
20°-30°	503.8	5.5
30°-40°	585.2	6.4
40°-50°	584.4	6.4
50°-60°	509.6	5.5
60°-70°	376.7	4.1
70°-80°	213.1	2.3
80°-90°	62.2	0.7
90°-100°	130.2	1.4
100°-110°	413.7	4.5
110°-120°	708.0	7.7
120°-130°	931.2	10.1
130°-140°	1045.3	11.4
140°-150°	1025.0	11.2
150°-160°	859.8	9.4
160°-170°	570.2	6.2
170°-180°	199.3	2.2
0°-30°	968.5	10.5
0°-40°	1553.6	16.9
0°-60°	2647.7	28.8
0°-90°	3299.7	35.9
90°-120°	1252.0	13.6
90°-150°	4253.5	46.3
90°-180°	5883.0	64.1
0°-180°	9182.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1294	1294	1294	1294	1294	
5°	1294	1290	1276	1286	1283	123
15°	1232	1225	1209	1214	1208	347
25°	1115	1106	1084	1087	1084	513
35°	962	950	930	922	916	601
45°	783	774	756	742	737	604
55°	593	585	570	555	549	530
65°	400	392	380	368	362	395
75°	209	207	200	193	196	223
85°	51	50	49	45	44	57
90°	2	23	62	58	60	9
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1294.5	1294.5	1294.5	1294.5	1294.5
2.5°	1302.1	1295.9	1282.1	1294.5	1292.2
5°	1294.5	1289.7	1275.9	1285.9	1283.4
7.5°	1285.9	1278.5	1264.7	1274.8	1272.2
10°	1272.2	1263.5	1248.6	1258.5	1254.8
12.5°	1253.5	1246.1	1231.2	1237.3	1234.9
15°	1232.3	1225.0	1208.7	1213.7	1207.5
17.5°	1206.1	1198.8	1182.5	1188.7	1182.5
20°	1177.5	1170.1	1152.7	1156.4	1151.5
22.5°	1149.0	1137.8	1121.5	1121.5	1119.0
25°	1115.3	1105.5	1084.3	1086.7	1084.3
27.5°	1077.9	1069.2	1053.1	1049.4	1043.2
30°	1040.7	1030.7	1012.1	1008.3	1003.3
32.5°	1000.9	993.4	973.5	965.9	960.9
35°	962.3	949.9	929.9	922.4	916.1
37.5°	918.7	907.5	887.5	878.8	872.6
40°	873.9	863.9	843.9	832.9	827.9
42.5°	830.3	820.3	800.5	787.9	780.5
45°	783.1	774.3	755.6	741.9	736.9
47.5°	736.9	728.3	708.3	694.6	687.1
50°	688.4	682.1	664.7	647.3	641.1
52.5°	641.1	632.4	616.3	602.5	593.8
55°	592.6	585.1	570.1	555.3	549.1
57.5°	544.0	537.8	521.6	506.6	501.6
60°	495.4	490.5	473.1	459.3	455.7
62.5°	448.1	439.4	427.0	414.5	409.6
65°	399.7	392.1	379.7	368.5	362.3
67.5°	349.9	343.6	332.4	323.7	318.7
70°	303.8	298.8	287.6	278.8	273.9
72.5°	256.5	251.4	245.2	236.5	232.9
75°	209.0	206.7	200.4	193.0	195.5
77.5°	166.8	161.8	159.3	155.6	151.9
80°	124.5	123.2	120.7	117.0	114.6
82.5°	84.6	84.6	83.5	78.4	78.4
85°	51.0	49.8	48.6	44.8	43.6
87.5°	22.4	20.0	17.4	13.8	12.4
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P912480

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.36	10.11	10.43	11.18	12.64	8.94	9.69	10.01	10.76	12.22
	3H	10.99	11.66	12.07	12.74	14.22	10.53	11.20	11.61	12.28	13.76
	4H	11.56	12.19	12.65	13.28	14.76	11.10	11.73	12.19	12.81	14.30
	6H	11.93	12.52	13.03	13.60	15.10	11.47	12.06	12.57	13.14	14.64
	8H	12.03	12.58	13.13	13.68	15.17	11.57	12.12	12.67	13.22	14.71
	12H	12.06	12.59	13.17	13.68	15.20	11.60	12.13	12.71	13.22	14.73
4H	2H	9.80	10.44	10.90	11.52	13.00	9.46	10.10	10.56	11.18	12.66
	3H	11.63	12.16	12.73	13.27	14.76	11.25	11.78	12.35	12.88	14.38
	4H	12.32	12.81	13.43	13.91	15.42	11.93	12.41	13.03	13.51	15.03
	6H	12.81	13.23	13.92	14.35	15.86	12.41	12.83	13.53	13.95	15.46
	8H	12.94	13.33	14.06	14.45	15.97	12.55	12.94	13.66	14.05	15.57
	12H	13.00	13.35	14.13	14.48	16.01	12.59	12.95	13.73	14.07	15.60
8H	4H	12.50	12.89	13.61	14.00	15.53	12.15	12.54	13.26	13.65	15.17
	6H	13.10	13.42	14.23	14.57	16.10	12.74	13.07	13.88	14.22	15.74
	8H	13.30	13.58	14.44	14.72	16.26	12.94	13.23	14.09	14.36	15.90
	12H	13.41	13.66	14.56	14.79	16.37	13.04	13.29	14.19	14.42	16.00
12H	4H	12.48	12.83	13.61	13.95	15.49	12.13	12.48	13.26	13.61	15.14
	6H	13.12	13.40	14.26	14.54	16.08	12.78	13.06	13.92	14.20	15.74
	8H	13.34	13.59	14.49	14.72	16.30	12.99	13.24	14.14	14.37	15.95