

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912498

Luminaire Tested: DFN2DIP-TR2F0-040D050US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912498
REPORT IS A COMBINATION OF REPORTS P900256 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-040D050US850-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8677.9 lumens
Efficiency: N/A
Efficacy: 116.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 74.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

Luminous Intensity Polar Plot

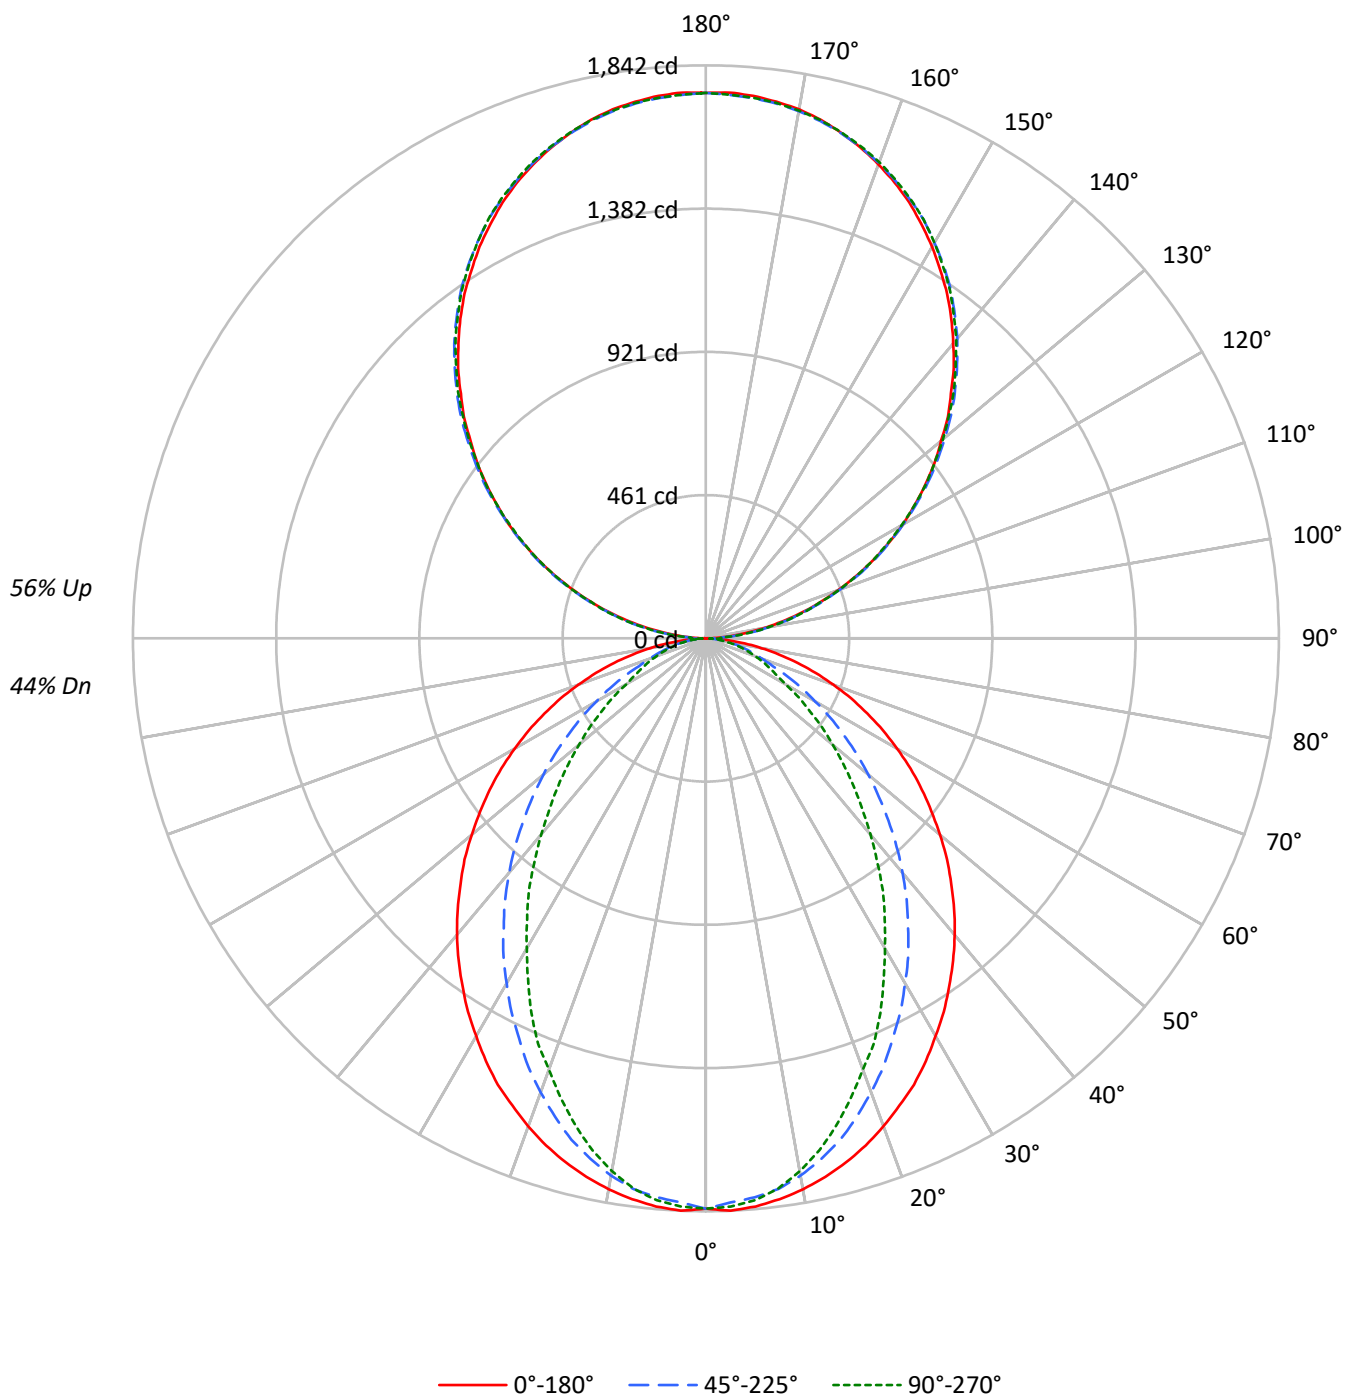

TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	57	47	41	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4089	4089	4089
5°	4090	4015	4043
10°	4043	3927	3905
15°	3981	3789	3695
20°	3902	3601	3440
25°	3820	3393	3194
30°	3712	3180	2884
35°	3607	2952	2612
40°	3499	2718	2302
45°	3374	2458	2021
50°	3244	2197	1747
55°	3109	1920	1484
60°	2951	1631	1215
65°	2770	1338	1085
70°	2549	1066	972
75°	2271	922	872
80°	1872	748	735
85°	1229	464	517

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3374 cd/sqm

TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	171.8	2.0
10°-20°	471.7	5.4
20°-30°	662.3	7.6
30°-40°	721.9	8.3
40°-50°	663.5	7.6
50°-60°	521.1	6.0
60°-70°	339.2	3.9
70°-80°	174.6	2.0
80°-90°	49.6	0.6
90°-100°	108.5	1.3
100°-110°	344.8	4.0
110°-120°	590.1	6.8
120°-130°	776.0	8.9
130°-140°	871.0	10.0
140°-150°	854.2	9.8
150°-160°	716.5	8.3
160°-170°	475.2	5.5
170°-180°	166.1	1.9
0°-30°	1305.8	15.0
0°-40°	2027.7	23.4
0°-60°	3212.2	37.0
0°-90°	3775.6	43.5
90°-120°	1043.4	12.0
90°-150°	3544.6	40.8
90°-180°	4902.0	56.5
0°-180°	8677.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1833	1833	1833	1833	1833	
5°	1833	1825	1804	1818	1814	174
15°	1744	1726	1669	1638	1621	491
25°	1583	1530	1420	1352	1327	728
35°	1364	1279	1133	1029	992	854
45°	1115	1004	830	712	672	861
55°	848	718	539	440	408	758
65°	572	438	289	232	227	568
75°	305	189	133	121	120	323
85°	71	36	32	32	32	82
90°	2	19	52	49	50	9
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1371	1373	1367	845
155°	1546	1551	1555	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.4	1833.4	1833.4	1833.4	1833.4
2.5°	1841.7	1833.4	1815.1	1831.8	1828.4
5°	1833.4	1825.1	1803.5	1818.4	1813.5
7.5°	1818.4	1808.6	1785.4	1791.8	1783.6
10°	1798.6	1786.9	1753.8	1748.7	1738.9
12.5°	1773.7	1758.8	1713.8	1704.0	1685.7
15°	1743.8	1725.5	1669.2	1637.7	1621.1
17.5°	1709.0	1682.4	1612.6	1576.2	1549.6
20°	1669.2	1635.9	1552.9	1511.6	1475.0
22.5°	1626.0	1587.9	1491.5	1435.2	1410.4
25°	1582.9	1529.8	1420.2	1352.3	1327.3
27.5°	1531.5	1475.0	1353.9	1275.9	1237.6
30°	1476.7	1413.5	1280.8	1196.3	1151.5
32.5°	1423.6	1347.2	1211.2	1111.7	1070.1
35°	1364.0	1279.2	1133.3	1028.7	992.1
37.5°	1305.8	1214.5	1060.2	945.6	904.3
40°	1244.4	1144.9	983.9	866.1	823.0
42.5°	1181.3	1075.2	907.6	784.7	743.4
45°	1115.0	1003.8	829.6	711.8	671.9
47.5°	1052.0	934.2	755.0	637.1	600.6
50°	982.2	864.5	681.9	567.4	532.7
52.5°	914.1	789.7	612.3	502.7	471.2
55°	847.8	718.4	539.2	439.7	408.2
57.5°	779.8	647.1	474.5	381.6	355.1
60°	710.1	577.3	406.4	321.9	295.4
62.5°	642.2	509.5	348.3	268.8	255.6
65°	572.5	437.9	288.7	232.3	227.2
67.5°	506.1	371.6	232.3	204.1	199.1
70°	436.4	307.0	192.4	175.9	169.1
72.5°	370.1	247.2	160.9	147.7	144.4
75°	305.2	189.1	132.7	121.1	119.6
77.5°	240.7	134.3	104.6	97.9	94.5
80°	180.8	96.3	79.5	73.1	73.1
82.5°	126.1	64.8	54.8	51.3	51.3
85°	71.3	36.5	31.5	31.5	31.5
87.5°	26.6	13.2	13.2	11.6	11.6
90°	1.6	19.1	51.8	48.7	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.6	94.6	92.0
97.5°	128.4	142.2	148.1	148.1	148.1
100°	187.6	199.8	204.1	204.1	202.5
102.5°	250.1	259.1	264.8	266.5	264.8
105°	318.3	322.5	325.7	328.3	328.3
107.5°	385.9	392.3	392.3	393.4	385.9
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.3	531.3	529.8	525.6	522.3
115°	592.1	600.6	598.0	596.4	592.1
117.5°	661.4	673.1	665.6	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.0	797.8	794.6
125°	861.2	874.4	870.2	865.5	863.9
127.5°	926.2	942.6	936.9	930.5	926.2
130°	987.1	1006.1	1003.4	1000.3	994.4
132.5°	1055.3	1070.1	1071.2	1063.8	1059.5
135°	1114.0	1130.3	1133.5	1132.0	1127.7
137.5°	1179.5	1192.7	1195.4	1194.3	1188.0
140°	1237.1	1250.4	1257.7	1257.7	1252.0
142.5°	1296.3	1309.6	1313.8	1315.4	1309.6
145°	1352.4	1363.0	1371.4	1373.1	1367.2
147.5°	1402.7	1415.9	1422.2	1424.8	1419.0
150°	1454.5	1463.4	1469.2	1474.0	1469.2
152.5°	1500.5	1509.5	1516.8	1522.7	1516.8
155°	1546.4	1550.6	1555.4	1562.8	1558.0
157.5°	1586.1	1589.2	1591.9	1602.5	1595.1
160°	1621.5	1624.7	1626.2	1635.2	1628.9
162.5°	1654.3	1654.3	1655.8	1665.9	1658.5
165°	1682.4	1680.7	1680.7	1691.3	1683.9
167.5°	1707.6	1702.9	1702.9	1713.5	1706.1
170°	1726.7	1722.5	1720.9	1731.5	1722.5
172.5°	1739.9	1735.7	1734.1	1744.7	1735.7
175°	1750.6	1746.2	1743.1	1753.7	1744.7
177.5°	1756.3	1752.1	1748.9	1757.9	1748.9
180°	1753.7	1753.7	1753.7	1753.7	1753.7



TEST NUMBER: P912498

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.27	12.05	12.29	13.07	14.44	7.25	8.03	8.27	9.05	10.42
	3H	12.92	13.62	13.95	14.65	16.03	8.42	9.12	9.45	10.15	11.53
	4H	13.51	14.17	14.55	15.21	16.60	8.86	9.52	9.90	10.55	11.94
	6H	13.91	14.52	14.96	15.56	16.96	9.16	9.77	10.21	10.81	12.21
	8H	14.03	14.60	15.08	15.66	17.06	9.25	9.82	10.30	10.88	12.28
	12H	14.08	14.63	15.14	15.67	17.10	9.28	9.83	10.34	10.88	12.30
4H	2H	11.28	11.94	12.33	12.97	14.36	7.83	8.49	8.88	9.52	10.91
	3H	13.08	13.63	14.13	14.69	16.09	9.16	9.71	10.21	10.77	12.17
	4H	13.75	14.25	14.81	15.30	16.73	9.69	10.19	10.75	11.24	12.67
	6H	14.24	14.67	15.31	15.75	17.17	10.09	10.52	11.16	11.60	13.02
	8H	14.40	14.80	15.47	15.87	17.31	10.21	10.61	11.28	11.68	13.11
	12H	14.48	14.84	15.57	15.93	17.37	10.26	10.62	11.35	11.71	13.15
8H	4H	13.71	14.11	14.78	15.18	16.62	9.95	10.35	11.02	11.42	12.86
	6H	14.25	14.58	15.34	15.69	17.12	10.45	10.78	11.54	11.89	13.32
	8H	14.45	14.74	15.55	15.83	17.29	10.62	10.92	11.72	12.01	13.46
	12H	14.57	14.83	15.67	15.91	17.41	10.73	10.98	11.83	12.07	13.57
12H	4H	13.66	14.02	14.75	15.10	16.55	9.95	10.31	11.04	11.40	12.84
	6H	14.22	14.51	15.32	15.61	17.06	10.49	10.78	11.59	11.87	13.33
	8H	14.42	14.68	15.53	15.77	17.26	10.68	10.94	11.79	12.03	13.52

END OF REPORT