

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912511

Luminaire Tested: DFN2DIP-TR2F0-050D030US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912511
REPORT IS A COMBINATION OF REPORTS P901758 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D030US850-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7657.6 lumens
Efficiency: N/A
Efficacy: 110.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 69.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLLONL

Luminous Intensity Polar Plot

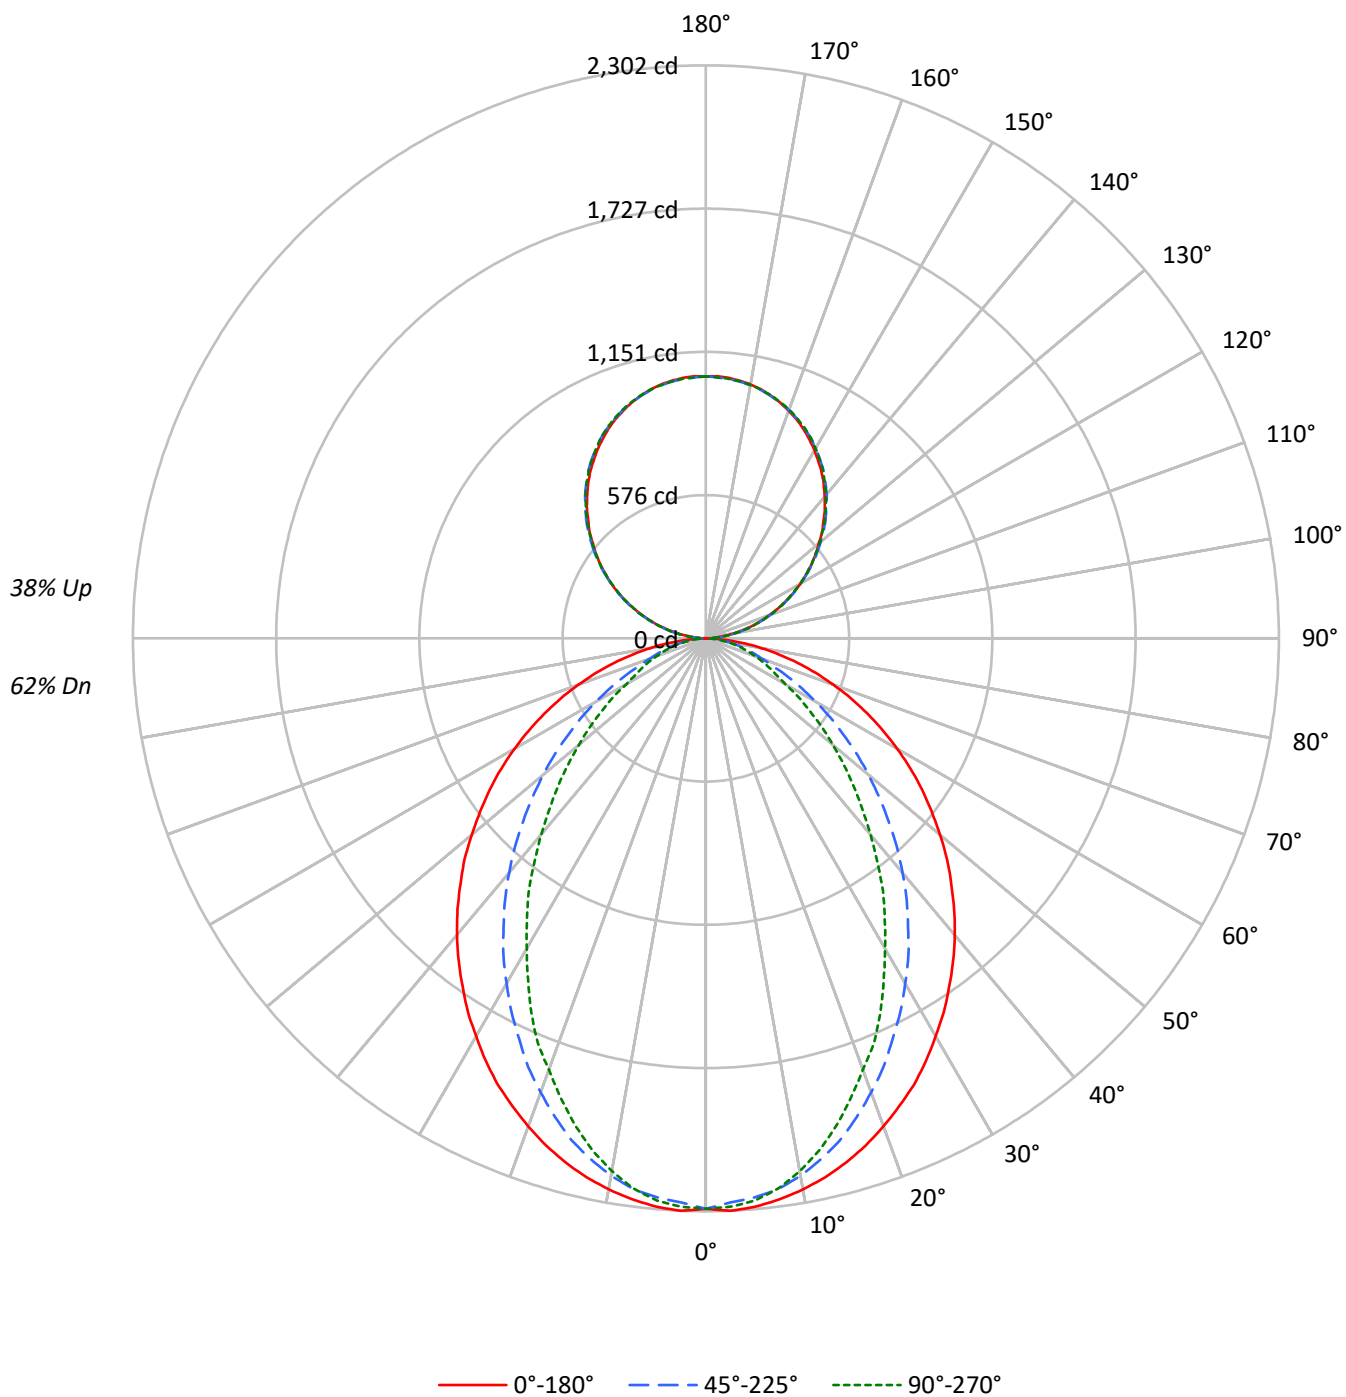

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	101	97	93	90	94	91	88	85	80	77	75	69	68	66	60	59	58
2	92	85	79	74	86	80	75	70	71	67	63	62	59	56	53	51	49
3	85	75	68	63	79	71	65	60	63	58	54	55	51	48	48	45	43
4	78	67	60	54	73	63	57	51	56	51	46	49	45	42	43	40	37
5	72	60	52	46	67	57	50	44	51	45	41	45	40	37	39	36	33
6	66	54	46	41	62	51	44	39	46	40	36	41	36	32	36	32	29
7	62	49	42	36	58	47	40	35	42	36	32	37	33	29	33	29	26
8	57	45	37	32	54	43	36	31	38	33	28	34	30	26	30	27	24
9	53	41	34	29	50	39	32	28	35	30	26	32	27	24	28	24	22
10	50	38	31	26	47	36	30	25	33	27	23	29	25	22	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5111	5111	5111
5°	5112	5019	5054
10°	5054	4909	4881
15°	4977	4736	4619
20°	4877	4502	4300
25°	4775	4241	3992
30°	4641	3975	3605
35°	4508	3690	3265
40°	4374	3397	2877
45°	4218	3073	2525
50°	4056	2747	2183
55°	3886	2399	1855
60°	3689	2038	1518
65°	3462	1673	1357
70°	3187	1332	1216
75°	2840	1152	1089
80°	2341	936	918
85°	1538	580	647

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4218 cd/sqm

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.8
10°-20°	589.6	7.7
20°-30°	827.8	10.8
30°-40°	902.4	11.8
40°-50°	829.4	10.8
50°-60°	651.3	8.5
60°-70°	424.0	5.5
70°-80°	218.2	2.9
80°-90°	58.7	0.8
90°-100°	65.1	0.9
100°-110°	206.9	2.7
110°-120°	354.0	4.6
120°-130°	465.6	6.1
130°-140°	522.6	6.8
140°-150°	512.5	6.7
150°-160°	429.9	5.6
160°-170°	285.1	3.7
170°-180°	99.7	1.3
0°-30°	1632.2	21.3
0°-40°	2534.6	33.1
0°-60°	4015.3	52.4
0°-90°	4716.3	61.6
90°-120°	626.0	8.2
90°-150°	2126.7	27.8
90°-180°	2941.0	38.4
0°-180°	7657.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2281	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	1	11	31	29	30	8
95°	46	55	57	57	55	52
105°	191	194	195	197	197	202
115°	355	360	359	358	355	351
125°	517	525	522	519	518	462
135°	668	678	680	679	677	517
145°	812	818	823	824	820	507
155°	928	930	933	938	935	427
165°	1009	1008	1008	1015	1010	285
175°	1050	1048	1046	1052	1047	100
180°	1052	1052	1052	1052	1052	

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.7	2291.7	2291.7	2291.7	2291.7
2.5°	2302.1	2291.7	2268.9	2289.8	2285.5
5°	2291.7	2281.4	2254.4	2273.0	2266.9
7.5°	2273.0	2260.7	2231.6	2239.8	2229.4
10°	2248.2	2233.6	2192.3	2185.9	2173.5
12.5°	2217.1	2198.5	2142.4	2130.1	2107.1
15°	2179.7	2156.9	2086.5	2047.1	2026.4
17.5°	2136.2	2103.0	2015.8	1970.2	1937.0
20°	2086.5	2044.9	1941.2	1889.5	1843.7
22.5°	2032.6	1984.8	1864.5	1794.0	1763.0
25°	1978.6	1912.1	1775.3	1690.3	1659.1
27.5°	1914.4	1843.7	1692.3	1594.9	1547.2
30°	1845.9	1767.0	1601.1	1495.4	1439.3
32.5°	1779.5	1684.0	1514.1	1389.6	1337.7
35°	1704.9	1599.1	1416.6	1285.9	1240.2
37.5°	1632.2	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.8	1082.6	1028.7
42.5°	1476.7	1344.0	1134.5	980.9	929.2
45°	1393.8	1254.7	1037.0	889.6	839.8
47.5°	1314.9	1167.8	943.8	796.4	750.8
50°	1227.9	1080.6	852.5	709.2	665.8
52.5°	1142.7	987.1	765.3	628.5	589.1
55°	1059.8	898.0	673.9	549.6	510.3
57.5°	974.8	808.9	593.2	477.1	443.8
60°	887.6	721.7	508.0	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.5	547.5	360.9	290.4	284.1
67.5°	632.6	464.6	290.4	255.1	248.9
70°	545.5	383.7	240.5	219.8	211.5
72.5°	462.6	309.0	201.2	184.6	180.4
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.8	122.3	118.1
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.2	45.6	39.4	39.4	39.4
87.5°	33.3	16.5	16.5	14.5	14.5
90°	1.0	11.4	31.1	29.2	30.2
92.5°	19.6	26.6	27.6	28.5	28.5
95°	46.4	55.2	56.8	56.8	55.2
97.5°	77.1	85.3	88.8	88.8	88.8
100°	112.6	119.9	122.4	122.4	121.5
102.5°	150.0	155.5	158.9	159.9	158.9
105°	191.0	193.5	195.4	197.0	197.0
107.5°	231.6	235.3	235.3	236.0	231.6
110°	270.9	276.0	276.0	276.0	273.5

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	313.4	318.8	317.8	315.3	313.4
115°	355.3	360.3	358.8	357.9	355.3
117.5°	396.8	403.8	399.4	396.8	394.2
120°	438.7	445.7	438.7	438.7	435.8
122.5°	476.8	485.6	481.2	478.6	476.8
125°	516.8	524.7	522.1	519.2	518.3
127.5°	555.7	565.6	562.2	558.3	555.7
130°	592.2	603.6	602.1	600.2	596.6
132.5°	633.1	642.0	642.7	638.2	635.7
135°	668.4	678.2	680.1	679.2	676.6
137.5°	707.7	715.6	717.2	716.6	712.8
140°	742.3	750.2	754.7	754.7	751.1
142.5°	777.9	785.7	788.3	789.3	785.7
145°	811.5	817.8	822.9	823.8	820.3
147.5°	841.6	849.5	853.3	854.9	851.4
150°	872.7	878.1	881.5	884.4	881.5
152.5°	900.3	905.6	910.0	913.6	910.0
155°	927.9	930.3	933.2	937.7	934.9
157.5°	951.6	953.5	955.2	961.5	957.1
160°	972.9	974.8	975.8	981.1	977.4
162.5°	992.6	992.6	993.6	999.5	995.1
165°	1009.4	1008.4	1008.4	1014.7	1010.3
167.5°	1024.6	1021.7	1021.7	1028.0	1023.6
170°	1036.0	1033.5	1032.6	1038.9	1033.5
172.5°	1043.9	1041.5	1040.5	1046.8	1041.5
175°	1050.3	1047.8	1045.9	1052.2	1046.8
177.5°	1053.8	1051.2	1049.3	1054.8	1049.3
180°	1052.2	1052.2	1052.2	1052.2	1052.2

TEST NUMBER: P912511

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.70	14.64	14.56	15.51	16.61	9.69	10.62	10.54	11.50	12.59
	3H	15.37	16.20	16.24	17.09	18.21	10.87	11.70	11.74	12.59	13.71
	4H	15.96	16.75	16.85	17.64	18.78	11.31	12.10	12.20	12.99	14.13
	6H	16.37	17.10	17.27	17.99	19.14	11.62	12.35	12.52	13.25	14.40
	8H	16.49	17.18	17.40	18.10	19.24	11.71	12.40	12.62	13.32	14.46
	12H	16.55	17.20	17.46	18.11	19.28	11.75	12.41	12.66	13.32	14.49
4H	2H	13.73	14.52	14.62	15.41	16.55	10.28	11.07	11.17	11.96	13.10
	3H	15.54	16.20	16.45	17.12	18.27	11.62	12.28	12.53	13.20	14.35
	4H	16.22	16.82	17.13	17.74	18.91	12.16	12.76	13.07	13.68	14.85
	6H	16.72	17.23	17.65	18.17	19.35	12.57	13.08	13.50	14.02	15.20
	8H	16.88	17.36	17.81	18.30	19.49	12.69	13.17	13.62	14.11	15.30
	12H	16.97	17.40	17.92	18.36	19.55	12.75	13.18	13.70	14.14	15.33
8H	4H	16.19	16.67	17.12	17.61	18.80	12.43	12.91	13.36	13.85	15.04
	6H	16.74	17.13	17.69	18.11	19.30	12.93	13.33	13.89	14.31	15.50
	8H	16.94	17.29	17.90	18.26	19.46	13.11	13.46	14.08	14.43	15.64
	12H	17.07	17.37	18.03	18.33	19.59	13.22	13.53	14.19	14.49	15.75
12H	4H	16.15	16.58	17.10	17.53	18.73	12.44	12.87	13.39	13.83	15.02
	6H	16.71	17.06	17.68	18.03	19.24	12.98	13.33	13.94	14.30	15.50
	8H	16.92	17.23	17.89	18.19	19.45	13.18	13.49	14.15	14.45	15.70