

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912522

Luminaire Tested: DFN2DIP-TR2F0-050D060US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912522
REPORT IS A COMBINATION OF REPORTS P900268 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D060US850-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10602.1 lumens
Efficiency: N/A
Efficacy: 110.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

Luminous Intensity Polar Plot

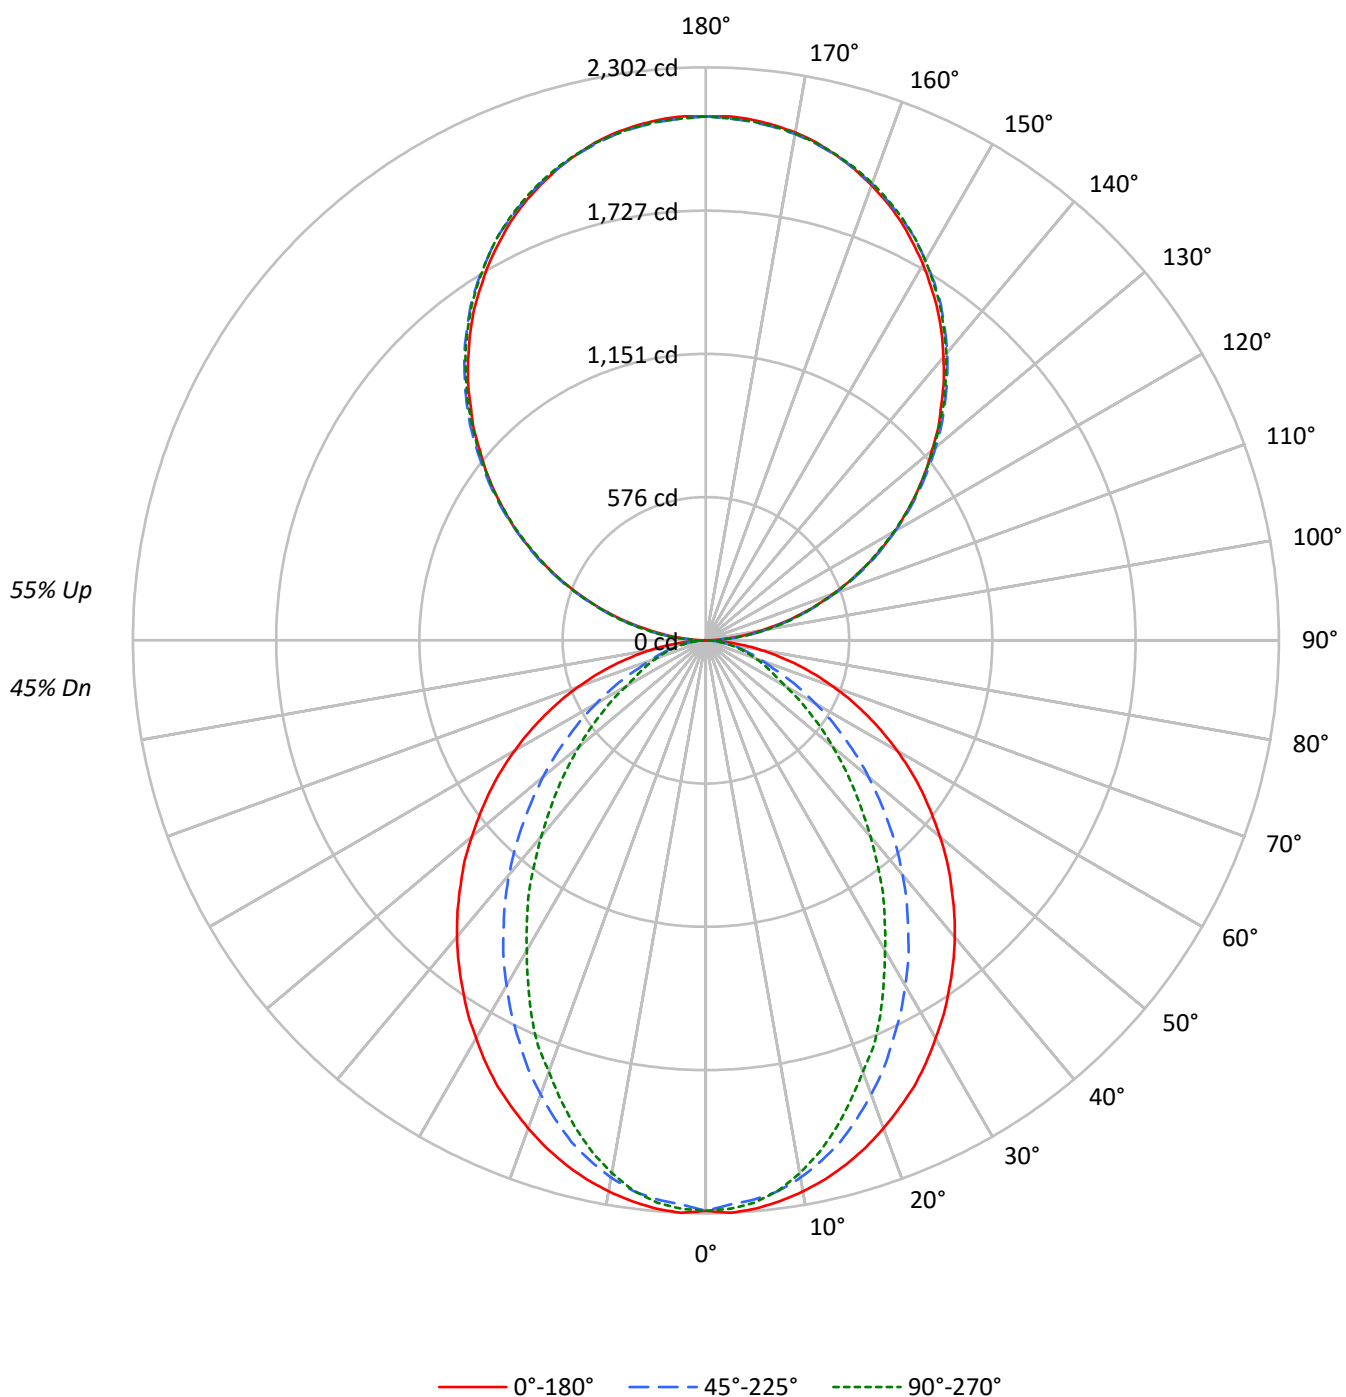

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5111	5111	5111
5°	5112	5019	5054
10°	5054	4909	4881
15°	4977	4736	4619
20°	4877	4502	4300
25°	4775	4241	3992
30°	4641	3975	3605
35°	4508	3690	3265
40°	4374	3397	2877
45°	4218	3073	2525
50°	4056	2747	2183
55°	3886	2399	1855
60°	3689	2038	1518
65°	3462	1673	1357
70°	3187	1332	1216
75°	2840	1152	1089
80°	2341	936	918
85°	1538	580	647

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4218 cd/sqm

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.0
10°-20°	589.6	5.6
20°-30°	827.8	7.8
30°-40°	902.4	8.5
40°-50°	829.4	7.8
50°-60°	651.3	6.1
60°-70°	424.0	4.0
70°-80°	218.2	2.1
80°-90°	61.7	0.6
90°-100°	130.2	1.2
100°-110°	413.7	3.9
110°-120°	708.0	6.7
120°-130°	931.2	8.8
130°-140°	1045.3	9.9
140°-150°	1025.0	9.7
150°-160°	859.8	8.1
160°-170°	570.2	5.4
170°-180°	199.3	1.9
0°-30°	1632.2	15.4
0°-40°	2534.6	23.9
0°-60°	4015.3	37.9
0°-90°	4719.3	44.5
90°-120°	1252.0	11.8
90°-150°	4253.5	40.1
90°-180°	5883.0	55.5
0°-180°	10602.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2281	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	2	23	62	58	60	10
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.7	2291.7	2291.7	2291.7	2291.7
2.5°	2302.1	2291.7	2268.9	2289.8	2285.5
5°	2291.7	2281.4	2254.4	2273.0	2266.9
7.5°	2273.0	2260.7	2231.6	2239.8	2229.4
10°	2248.2	2233.6	2192.3	2185.9	2173.5
12.5°	2217.1	2198.5	2142.4	2130.1	2107.1
15°	2179.7	2156.9	2086.5	2047.1	2026.4
17.5°	2136.2	2103.0	2015.8	1970.2	1937.0
20°	2086.5	2044.9	1941.2	1889.5	1843.7
22.5°	2032.6	1984.8	1864.5	1794.0	1763.0
25°	1978.6	1912.1	1775.3	1690.3	1659.1
27.5°	1914.4	1843.7	1692.3	1594.9	1547.2
30°	1845.9	1767.0	1601.1	1495.4	1439.3
32.5°	1779.5	1684.0	1514.1	1389.6	1337.7
35°	1704.9	1599.1	1416.6	1285.9	1240.2
37.5°	1632.2	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.8	1082.6	1028.7
42.5°	1476.7	1344.0	1134.5	980.9	929.2
45°	1393.8	1254.7	1037.0	889.6	839.8
47.5°	1314.9	1167.8	943.8	796.4	750.8
50°	1227.9	1080.6	852.5	709.2	665.8
52.5°	1142.7	987.1	765.3	628.5	589.1
55°	1059.8	898.0	673.9	549.6	510.3
57.5°	974.8	808.9	593.2	477.1	443.8
60°	887.6	721.7	508.0	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.5	547.5	360.9	290.4	284.1
67.5°	632.6	464.6	290.4	255.1	248.9
70°	545.5	383.7	240.5	219.8	211.5
72.5°	462.6	309.0	201.2	184.6	180.4
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.8	122.3	118.1
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.2	45.6	39.4	39.4	39.4
87.5°	33.3	16.5	16.5	14.5	14.5
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P912522

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.15	12.94	13.16	13.95	15.30	8.13	8.92	9.14	9.93	11.28
	3H	13.80	14.50	14.82	15.53	16.90	9.30	10.01	10.32	11.03	12.40
	4H	14.39	15.06	15.42	16.08	17.46	9.74	10.41	10.77	11.43	12.81
	6H	14.79	15.40	15.83	16.44	17.83	10.04	10.66	11.09	11.69	13.08
	8H	14.91	15.49	15.95	16.54	17.92	10.13	10.71	11.17	11.76	13.14
	12H	14.96	15.51	16.01	16.55	17.96	10.16	10.71	11.21	11.76	13.16
4H	2H	12.16	12.83	13.20	13.85	15.23	8.71	9.38	9.75	10.40	11.78
	3H	13.96	14.51	15.00	15.57	16.96	10.04	10.59	11.08	11.65	13.04
	4H	14.63	15.14	15.68	16.18	17.60	10.57	11.08	11.62	12.12	13.54
	6H	15.12	15.56	16.18	16.62	18.03	10.97	11.40	12.03	12.47	13.88
	8H	15.28	15.69	16.34	16.75	18.17	11.09	11.49	12.15	12.56	13.98
	12H	15.36	15.73	16.44	16.80	18.23	11.14	11.51	12.22	12.58	14.01
8H	4H	14.59	15.00	15.65	16.06	17.48	10.83	11.24	11.90	12.30	13.72
	6H	15.13	15.46	16.22	16.57	17.99	11.33	11.66	12.41	12.77	14.19
	8H	15.33	15.62	16.42	16.71	18.15	11.51	11.80	12.60	12.89	14.33
	12H	15.45	15.71	16.55	16.79	18.27	11.61	11.87	12.71	12.95	14.43
12H	4H	14.54	14.91	15.62	15.98	17.41	10.83	11.20	11.91	12.27	13.70
	6H	15.10	15.40	16.20	16.48	17.93	11.37	11.66	12.46	12.75	14.19
	8H	15.31	15.56	16.40	16.65	18.13	11.56	11.82	12.66	12.91	14.39