

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912534

Luminaire Tested: DFN2DIP-TR2F0-060D040US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912534
REPORT IS A COMBINATION OF REPORTS P900250 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D040US850-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9581.7 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 88.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

Luminous Intensity Polar Plot

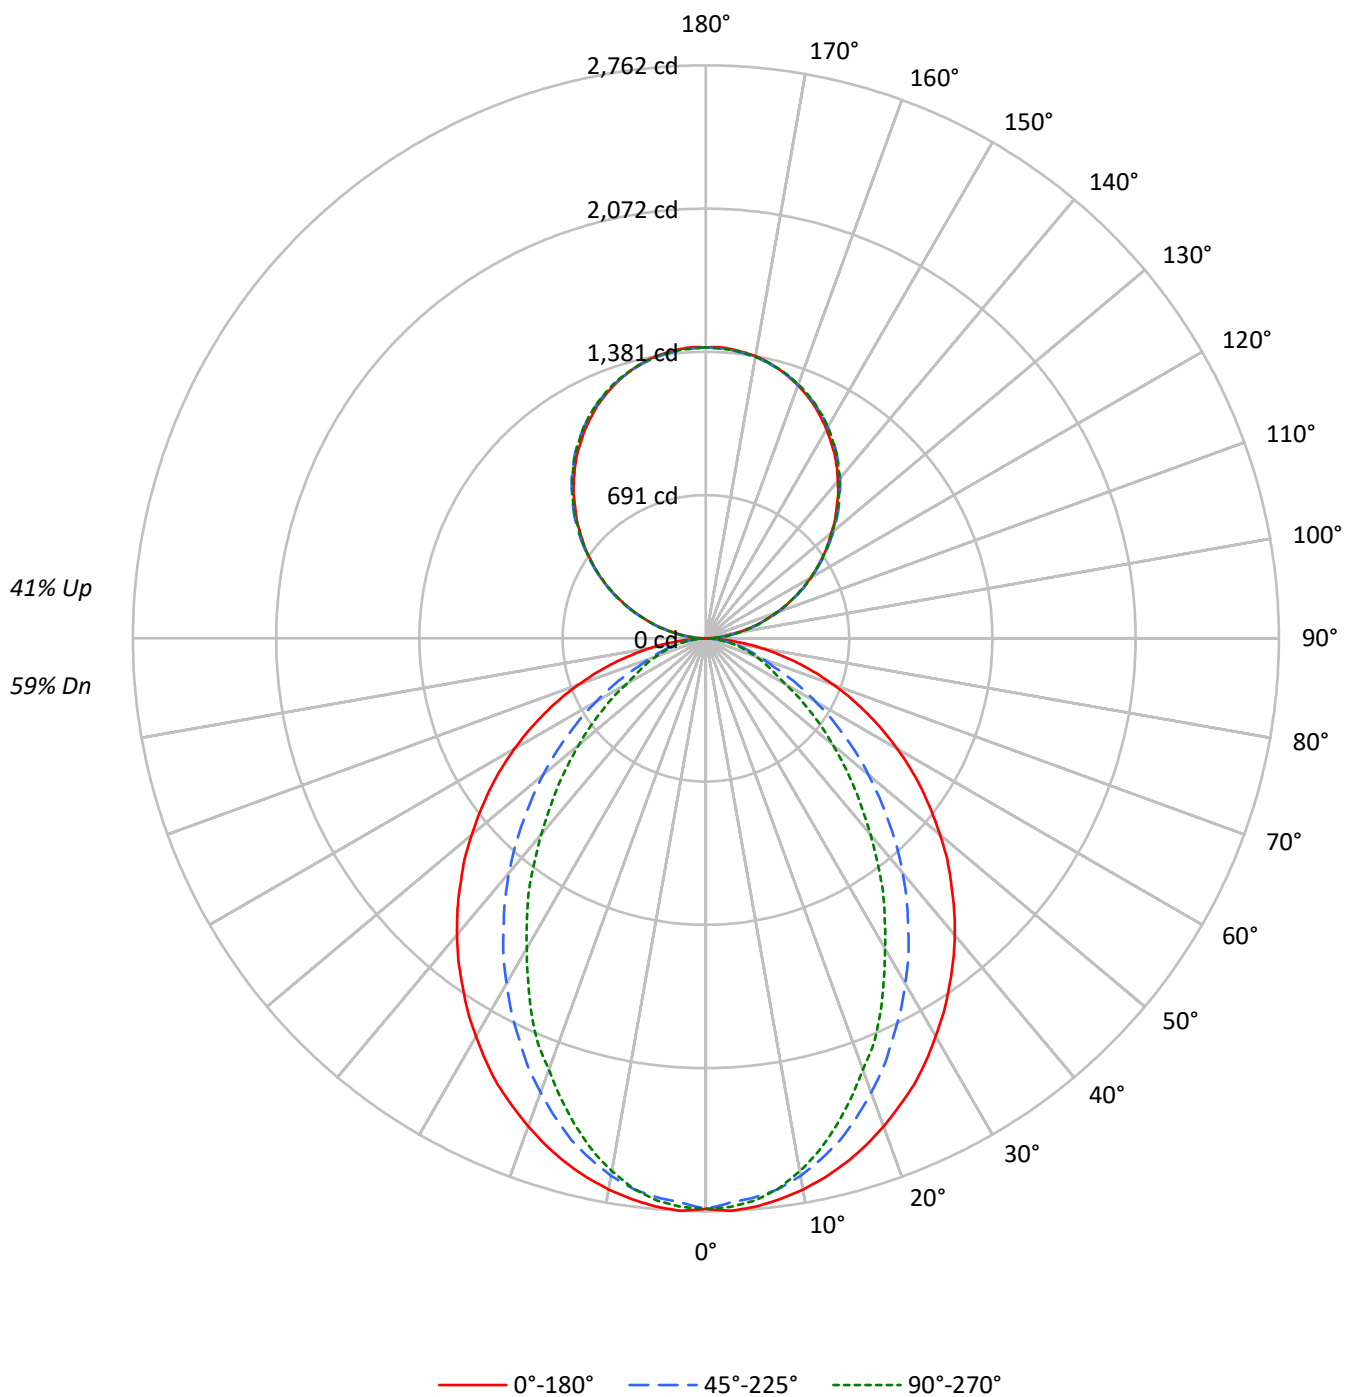

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6134	6134	6134
5°	6135	6023	6065
10°	6065	5891	5857
15°	5972	5683	5542
20°	5852	5402	5160
25°	5730	5090	4791
30°	5569	4770	4326
35°	5410	4429	3918
40°	5248	4076	3452
45°	5061	3688	3031
50°	4867	3296	2620
55°	4663	2880	2226
60°	4427	2446	1822
65°	4155	2008	1628
70°	3823	1599	1458
75°	3407	1383	1307
80°	2809	1122	1102
85°	1843	695	775

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5061 cd/sqm

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	2.7
10°-20°	707.6	7.4
20°-30°	993.4	10.4
30°-40°	1082.8	11.3
40°-50°	995.2	10.4
50°-60°	781.6	8.2
60°-70°	508.8	5.3
70°-80°	261.9	2.7
80°-90°	70.8	0.7
90°-100°	86.8	0.9
100°-110°	275.8	2.9
110°-120°	472.0	4.9
120°-130°	620.8	6.5
130°-140°	696.8	7.3
140°-150°	683.3	7.1
150°-160°	573.2	6.0
160°-170°	380.1	4.0
170°-180°	132.9	1.4
0°-30°	1958.7	20.4
0°-40°	3041.5	31.7
0°-60°	4818.4	50.3
0°-90°	5659.9	59.1
90°-120°	834.7	8.7
90°-150°	2835.6	29.6
90°-180°	3922.0	40.9
0°-180°	9581.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	1	15	42	39	40	9
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P912534

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.13	15.04	15.01	15.93	17.07	10.11	11.02	10.99	11.92	13.05
	3H	15.79	16.60	16.68	17.51	18.67	11.29	12.10	12.18	13.01	14.17
	4H	16.38	17.15	17.29	18.06	19.24	11.73	12.50	12.64	13.41	14.59
	6H	16.79	17.50	17.71	18.42	19.60	12.04	12.75	12.96	13.67	14.86
	8H	16.91	17.58	17.84	18.52	19.70	12.13	12.80	13.06	13.74	14.92
	12H	16.96	17.60	17.90	18.53	19.74	12.17	12.81	13.10	13.74	14.95
4H	2H	14.15	14.92	15.07	15.83	17.01	10.70	11.47	11.62	12.38	13.56
	3H	15.96	16.60	16.89	17.54	18.73	12.04	12.68	12.97	13.62	14.81
	4H	16.64	17.22	17.57	18.16	19.37	12.58	13.16	13.51	14.10	15.31
	6H	17.13	17.63	18.08	18.60	19.81	12.98	13.48	13.93	14.45	15.66
	8H	17.30	17.77	18.25	18.72	19.95	13.11	13.57	14.06	14.53	15.76
	12H	17.38	17.80	18.35	18.78	20.01	13.16	13.59	14.13	14.56	15.79
8H	4H	16.61	17.07	17.56	18.03	19.26	12.85	13.32	13.80	14.27	15.50
	6H	17.15	17.54	18.13	18.54	19.76	13.35	13.73	14.33	14.73	15.96
	8H	17.35	17.69	18.34	18.68	19.93	13.53	13.87	14.51	14.86	16.10
	12H	17.48	17.78	18.47	18.76	20.05	13.64	13.94	14.63	14.92	16.21
12H	4H	16.56	16.98	17.53	17.96	19.19	12.85	13.27	13.82	14.25	15.48
	6H	17.12	17.47	18.11	18.45	19.70	13.39	13.73	14.38	14.72	15.97
	8H	17.33	17.63	18.32	18.61	19.91	13.59	13.89	14.58	14.87	16.16