

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912537

Luminaire Tested: DFN2DIP-TR2F0-060D050US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912537
REPORT IS A COMBINATION OF REPORTS P901779 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D050US850-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11494.8 lumens
Efficiency: N/A
Efficacy: 117.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 97.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLLONL

Luminous Intensity Polar Plot

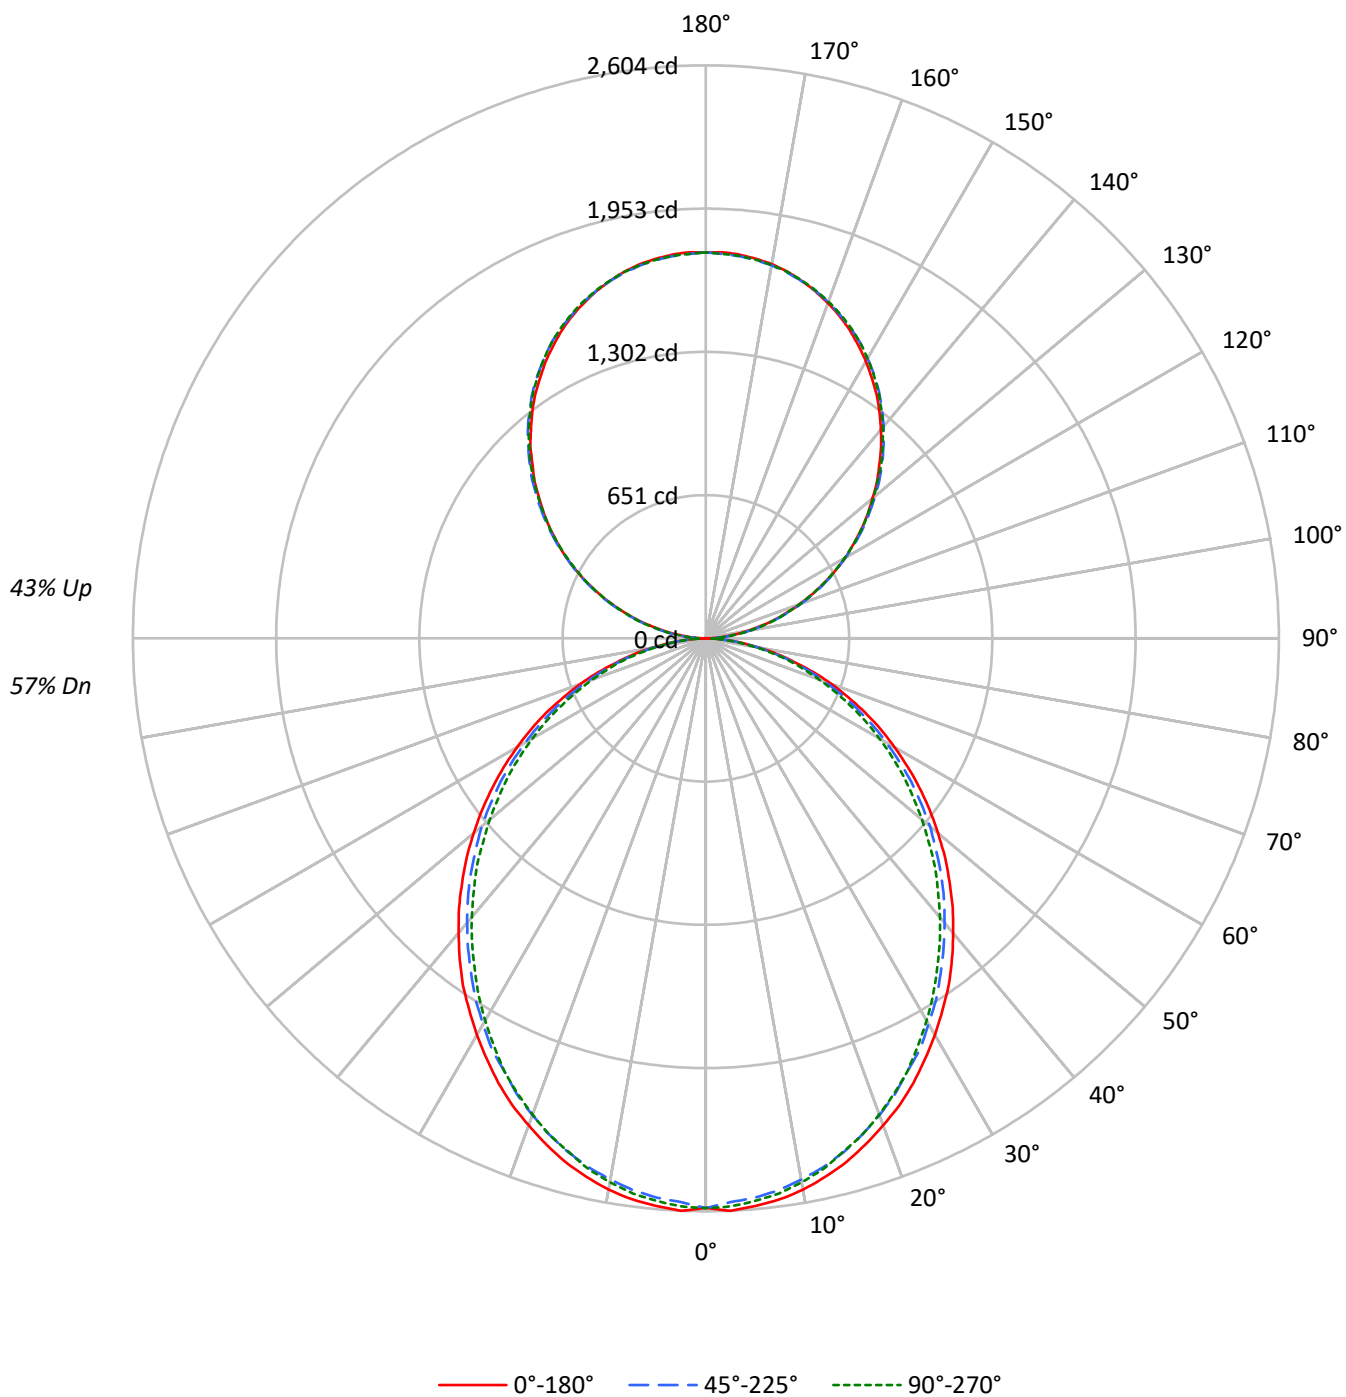

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5775	5775	5775
5°	5775	5681	5723
10°	5720	5592	5635
15°	5627	5487	5505
20°	5505	5346	5371
25°	5383	5181	5218
30°	5233	5026	5026
35°	5089	4845	4824
40°	4914	4662	4630
45°	4739	4477	4432
50°	4547	4284	4204
55°	4346	4060	3991
60°	4118	3796	3748
65°	3867	3521	3461
70°	3549	3185	3149
75°	3111	2783	2849
80°	2580	2270	2303
85°	1757	1430	1431

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4739 cd/sqm

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	2.1
10°-20°	685.6	6.0
20°-30°	1007.6	8.8
30°-40°	1170.3	10.2
40°-50°	1168.8	10.2
50°-60°	1019.2	8.9
60°-70°	753.4	6.6
70°-80°	426.3	3.7
80°-90°	117.5	1.0
90°-100°	108.5	0.9
100°-110°	344.8	3.0
110°-120°	590.1	5.1
120°-130°	776.0	6.8
130°-140°	871.0	7.6
140°-150°	854.2	7.4
150°-160°	716.5	6.2
160°-170°	475.2	4.1
170°-180°	166.1	1.4
0°-30°	1937.0	16.9
0°-40°	3107.2	27.0
0°-60°	5295.3	46.1
0°-90°	6592.4	57.4
90°-120°	1043.4	9.1
90°-150°	3544.6	30.8
90°-180°	4902.0	42.6
0°-180°	11494.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	2	19	52	49	50	11
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1371	1373	1367	845
155°	1546	1551	1555	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	1.6	19.1	51.8	48.7	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.6	94.6	92.0
97.5°	128.4	142.2	148.1	148.1	148.1
100°	187.6	199.8	204.1	204.1	202.5
102.5°	250.1	259.1	264.8	266.5	264.8
105°	318.3	322.5	325.7	328.3	328.3
107.5°	385.9	392.3	392.3	393.4	385.9
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.3	531.3	529.8	525.6	522.3
115°	592.1	600.6	598.0	596.4	592.1
117.5°	661.4	673.1	665.6	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.0	797.8	794.6
125°	861.2	874.4	870.2	865.5	863.9
127.5°	926.2	942.6	936.9	930.5	926.2
130°	987.1	1006.1	1003.4	1000.3	994.4
132.5°	1055.3	1070.1	1071.2	1063.8	1059.5
135°	1114.0	1130.3	1133.5	1132.0	1127.7
137.5°	1179.5	1192.7	1195.4	1194.3	1188.0
140°	1237.1	1250.4	1257.7	1257.7	1252.0
142.5°	1296.3	1309.6	1313.8	1315.4	1309.6
145°	1352.4	1363.0	1371.4	1373.1	1367.2
147.5°	1402.7	1415.9	1422.2	1424.8	1419.0
150°	1454.5	1463.4	1469.2	1474.0	1469.2
152.5°	1500.5	1509.5	1516.8	1522.7	1516.8
155°	1546.4	1550.6	1555.4	1562.8	1558.0
157.5°	1586.1	1589.2	1591.9	1602.5	1595.1
160°	1621.5	1624.7	1626.2	1635.2	1628.9
162.5°	1654.3	1654.3	1655.8	1665.9	1658.5
165°	1682.4	1680.7	1680.7	1691.3	1683.9
167.5°	1707.6	1702.9	1702.9	1713.5	1706.1
170°	1726.7	1722.5	1720.9	1731.5	1722.5
172.5°	1739.9	1735.7	1734.1	1744.7	1735.7
175°	1750.6	1746.2	1743.1	1753.7	1744.7
177.5°	1756.3	1752.1	1748.9	1757.9	1748.9
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P912537

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.89	14.82	14.78	15.73	16.89	13.46	14.40	14.36	15.31	16.47
	3H	15.53	16.37	16.43	17.29	18.47	15.07	15.90	15.97	16.82	18.01
	4H	16.10	16.89	17.02	17.82	19.02	15.64	16.43	16.56	17.36	18.56
	6H	16.49	17.22	17.42	18.15	19.36	16.03	16.76	16.96	17.69	18.90
	8H	16.59	17.28	17.52	18.23	19.44	16.13	16.82	17.07	17.77	18.98
	12H	16.63	17.29	17.57	18.23	19.47	16.17	16.83	17.11	17.77	19.00
4H	2H	14.35	15.14	15.27	16.06	17.26	14.01	14.80	14.93	15.73	16.92
	3H	16.19	16.85	17.13	17.81	19.02	15.81	16.47	16.74	17.43	18.64
	4H	16.89	17.49	17.84	18.45	19.68	16.50	17.10	17.44	18.05	19.29
	6H	17.39	17.91	18.35	18.88	20.12	16.99	17.51	17.95	18.49	19.72
	8H	17.53	18.01	18.49	18.98	20.23	17.13	17.62	18.09	18.59	19.84
	12H	17.59	18.03	18.57	19.02	20.27	17.19	17.63	18.17	18.61	19.87
8H	4H	17.08	17.57	18.04	18.54	19.79	16.73	17.22	17.69	18.19	19.44
	6H	17.69	18.09	18.68	19.10	20.35	17.34	17.74	18.32	18.75	20.00
	8H	17.90	18.25	18.89	19.25	20.52	17.54	17.89	18.53	18.89	20.16
	12H	18.01	18.33	19.01	19.32	20.63	17.65	17.96	18.64	18.95	20.26
12H	4H	17.07	17.51	18.05	18.49	19.75	16.73	17.16	17.70	18.15	19.41
	6H	17.72	18.07	18.71	19.07	20.34	17.37	17.73	18.37	18.73	20.00
	8H	17.94	18.26	18.94	19.25	20.56	17.60	17.91	18.60	18.90	20.22