

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915221

Luminaire Tested: DFN2DIP-TR2F0-040D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915221
REPORT IS A COMBINATION OF REPORTS P901765 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-040D040US927-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5941.4 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 65.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

Luminous Intensity Polar Plot

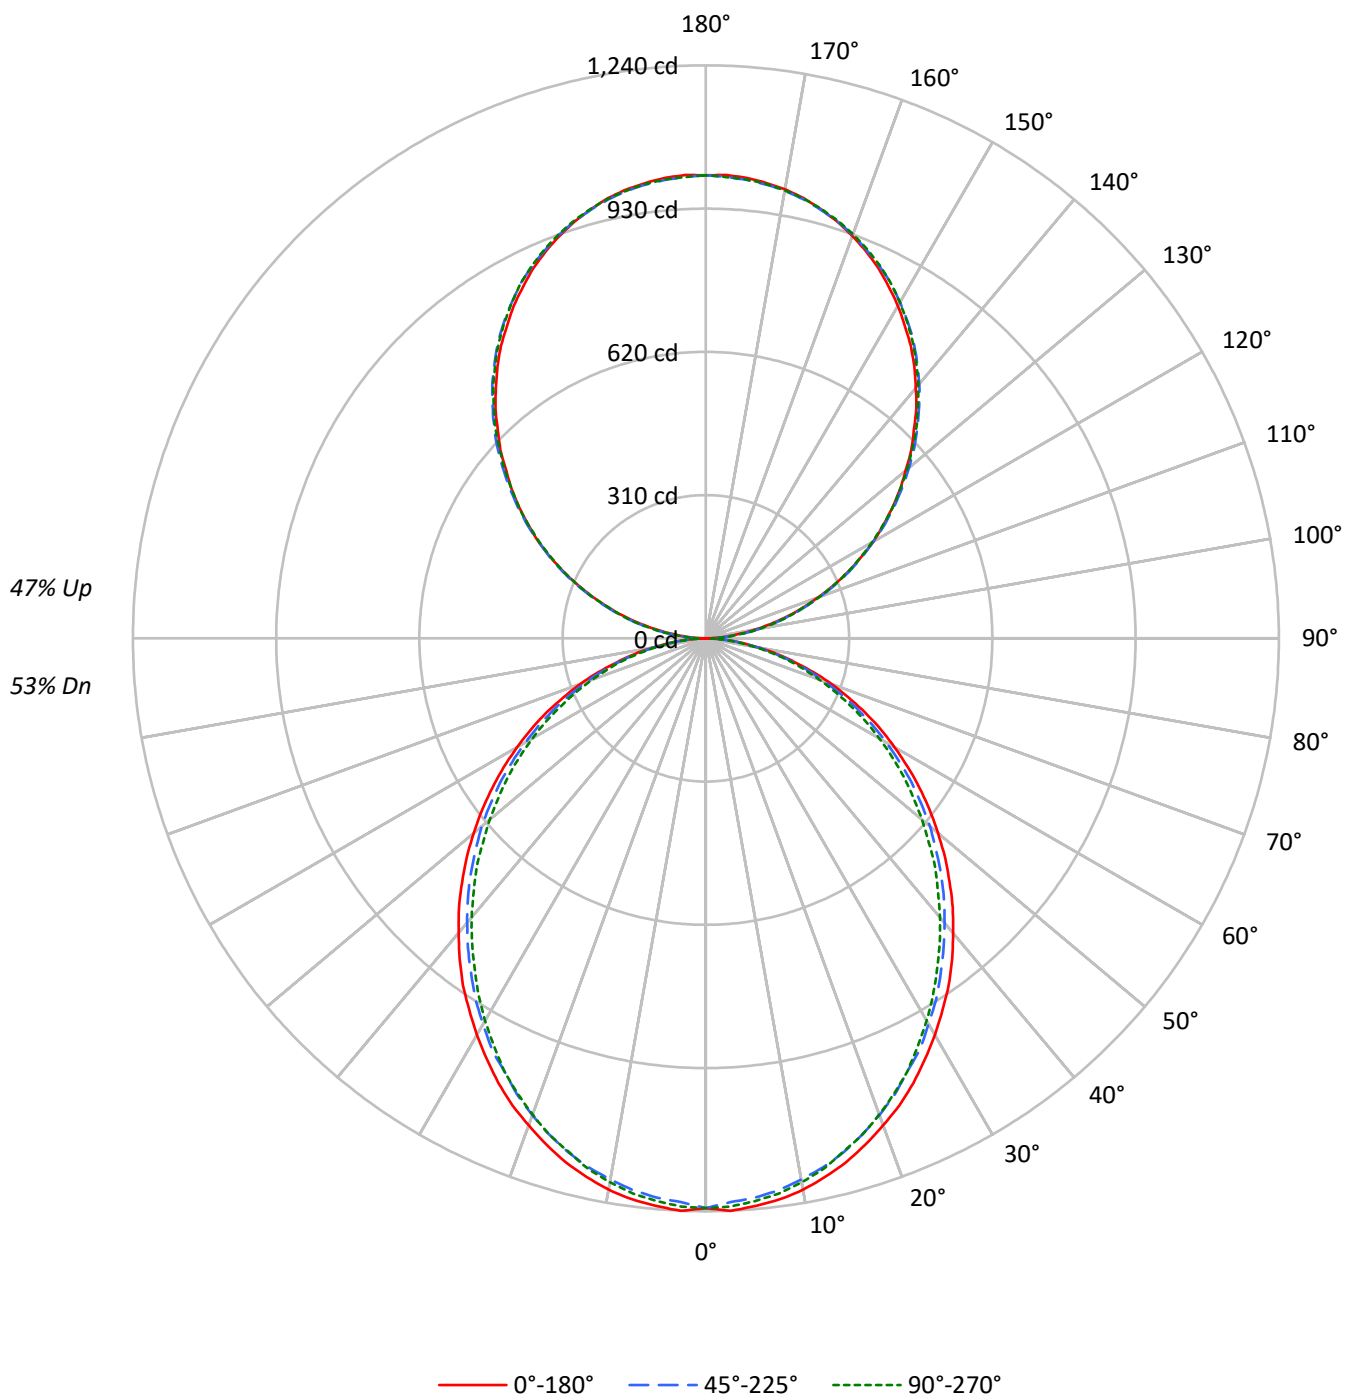

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2750	2750	2750
5°	2750	2705	2725
10°	2724	2663	2684
15°	2680	2613	2621
20°	2622	2546	2558
25°	2563	2467	2485
30°	2492	2393	2394
35°	2424	2307	2297
40°	2340	2220	2205
45°	2257	2132	2111
50°	2166	2040	2002
55°	2070	1933	1901
60°	1961	1808	1785
65°	1841	1676	1648
70°	1690	1517	1500
75°	1482	1325	1357
80°	1228	1080	1097
85°	838	682	681

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2257 cd/sqm

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	2.0
10°-20°	326.5	5.5
20°-30°	479.8	8.1
30°-40°	557.3	9.4
40°-50°	556.6	9.4
50°-60°	485.3	8.2
60°-70°	358.8	6.0
70°-80°	203.0	3.4
80°-90°	56.4	0.9
90°-100°	62.0	1.0
100°-110°	197.0	3.3
110°-120°	337.2	5.7
120°-130°	443.5	7.5
130°-140°	497.8	8.4
140°-150°	488.1	8.2
150°-160°	409.5	6.9
160°-170°	271.5	4.6
170°-180°	94.9	1.6
0°-30°	922.4	15.5
0°-40°	1479.7	24.9
0°-60°	2521.7	42.4
0°-90°	3139.9	52.8
90°-120°	596.2	10.0
90°-150°	2025.6	34.1
90°-180°	2801.0	47.1
0°-180°	5941.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	1	11	30	28	29	6
95°	44	53	54	54	53	49
105°	182	184	186	188	188	192
115°	338	343	342	341	338	335
125°	492	500	497	495	494	440
135°	637	646	648	647	644	492
145°	773	779	784	785	781	483
155°	884	886	889	893	890	407
165°	961	960	960	966	962	271
175°	1000	998	996	1002	997	95
180°	1002	1002	1002	1002	1002	

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	0.9	10.9	29.6	27.8	28.7
92.5°	18.7	25.3	26.3	27.2	27.2
95°	44.1	52.6	54.1	54.1	52.6
97.5°	73.4	81.3	84.6	84.6	84.6
100°	107.3	114.2	116.6	116.6	115.7
102.5°	142.9	148.1	151.4	152.3	151.4
105°	181.9	184.3	186.1	187.6	187.6
107.5°	220.5	224.2	224.2	224.7	220.5
110°	258.0	262.8	262.8	262.8	260.5

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	298.5	303.6	302.7	300.3	298.5
115°	338.3	343.3	341.7	340.8	338.3
117.5°	377.9	384.6	380.4	377.9	375.6
120°	417.9	424.5	417.9	417.9	415.1
122.5°	454.1	462.6	458.4	455.9	454.1
125°	492.2	499.7	497.3	494.6	493.7
127.5°	529.3	538.7	535.4	531.7	529.3
130°	564.0	575.0	573.5	571.6	568.3
132.5°	603.0	611.5	612.1	607.8	605.5
135°	636.6	645.9	647.8	646.8	644.4
137.5°	674.1	681.6	683.1	682.5	678.9
140°	706.9	714.5	718.7	718.7	715.4
142.5°	740.8	748.4	750.8	751.7	748.4
145°	772.9	778.9	783.7	784.7	781.3
147.5°	801.5	809.1	812.7	814.2	810.9
150°	831.2	836.3	839.6	842.3	839.6
152.5°	857.5	862.5	866.8	870.1	866.8
155°	883.7	886.1	888.8	893.1	890.3
157.5°	906.4	908.2	909.7	915.8	911.5
160°	926.6	928.4	929.3	934.5	930.8
162.5°	945.3	945.3	946.3	952.0	947.8
165°	961.4	960.4	960.4	966.5	962.3
167.5°	975.9	973.1	973.1	979.2	974.9
170°	986.7	984.3	983.4	989.4	984.3
172.5°	994.3	991.9	990.9	997.0	991.9
175°	1000.4	997.9	996.1	1002.1	997.0
177.5°	1003.7	1001.2	999.4	1004.6	999.4
180°	1002.1	1002.1	1002.1	1002.1	1002.1

TEST NUMBER: P915221

CATALOG NUMBER: DFN2DIP-TR2F0-040D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.92	11.80	11.85	12.75	13.98	10.49	11.38	11.43	12.33	13.56
	3H	12.56	13.35	13.50	14.31	15.56	12.09	12.89	13.04	13.85	15.10
	4H	13.13	13.88	14.09	14.85	16.11	12.67	13.42	13.63	14.39	15.65
	6H	13.51	14.21	14.48	15.17	16.45	13.05	13.75	14.02	14.71	15.99
	8H	13.61	14.27	14.58	15.25	16.53	13.15	13.81	14.12	14.80	16.07
	12H	13.65	14.28	14.63	15.26	16.55	13.19	13.81	14.17	14.79	16.09
4H	2H	11.37	12.13	12.34	13.09	14.35	11.03	11.79	12.00	12.75	14.01
	3H	13.21	13.84	14.19	14.83	16.11	12.83	13.46	13.80	14.45	15.73
	4H	13.91	14.48	14.89	15.47	16.77	13.51	14.09	14.50	15.08	16.38
	6H	14.40	14.90	15.40	15.91	17.21	14.01	14.50	15.00	15.51	16.81
	8H	14.54	15.01	15.54	16.01	17.32	14.15	14.61	15.14	15.61	16.92
	12H	14.61	15.02	15.62	16.04	17.36	14.20	14.62	15.22	15.64	16.96
8H	4H	14.10	14.56	15.09	15.56	16.88	13.75	14.21	14.74	15.21	16.53
	6H	14.70	15.09	15.72	16.13	17.44	14.35	14.73	15.37	15.78	17.09
	8H	14.91	15.25	15.94	16.28	17.61	14.55	14.89	15.58	15.92	17.25
	12H	15.03	15.32	16.06	16.35	17.72	14.66	14.95	15.69	15.98	17.35
12H	4H	14.08	14.50	15.10	15.52	16.84	13.74	14.16	14.75	15.18	16.49
	6H	14.73	15.07	15.76	16.10	17.43	14.39	14.72	15.42	15.76	17.09
	8H	14.95	15.25	15.99	16.28	17.65	14.61	14.91	15.64	15.93	17.31

END OF REPORT