

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915252

Luminaire Tested: DFN2DIP-TR2F0-060D020US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915252
REPORT IS A COMBINATION OF REPORTS P900229 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D020US927-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6107.7 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 74.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFLL

Luminous Intensity Polar Plot

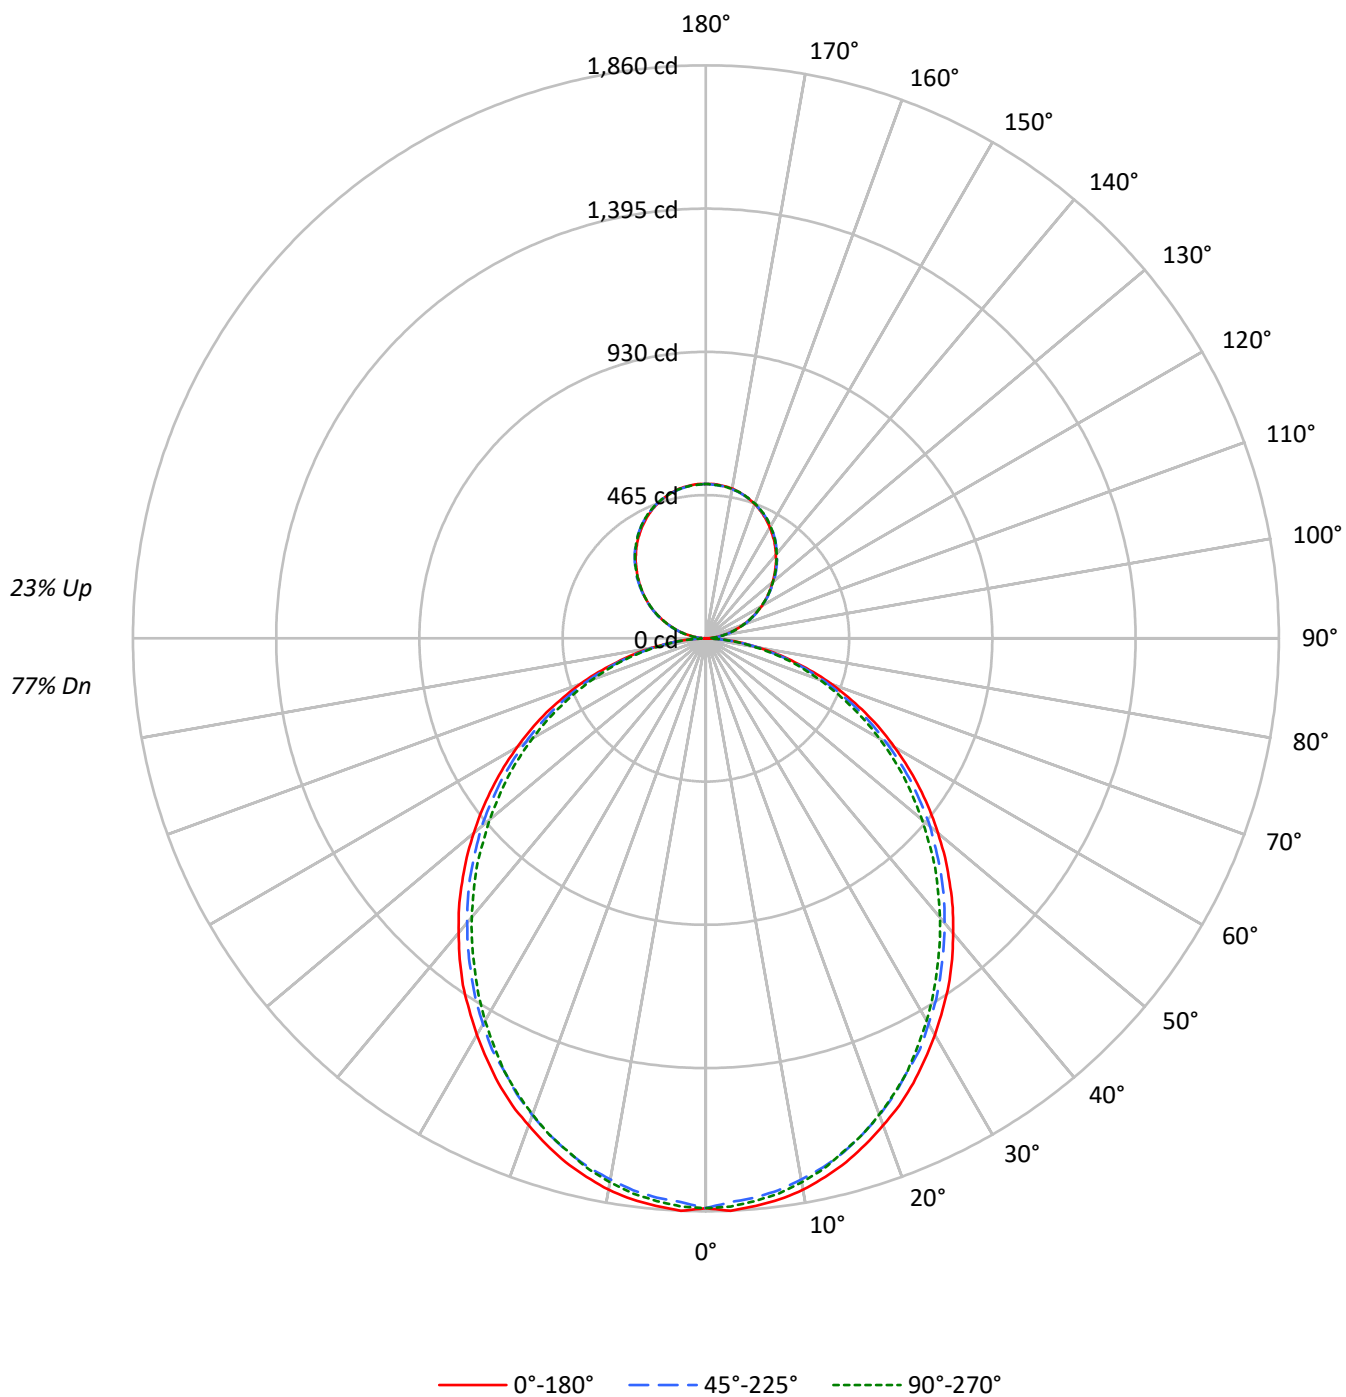

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4125	4125	4125
5°	4125	4058	4088
10°	4086	3995	4025
15°	4020	3920	3932
20°	3932	3819	3836
25°	3845	3701	3727
30°	3738	3590	3590
35°	3636	3461	3446
40°	3510	3330	3308
45°	3385	3198	3166
50°	3248	3060	3003
55°	3104	2900	2851
60°	2941	2712	2677
65°	2762	2515	2472
70°	2535	2275	2249
75°	2223	1988	2035
80°	1842	1622	1645
85°	1255	1022	1023

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3385 cd/sqm

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	2.9
10°-20°	489.8	8.0
20°-30°	719.8	11.8
30°-40°	836.0	13.7
40°-50°	834.9	13.7
50°-60°	728.0	11.9
60°-70°	538.2	8.8
70°-80°	304.5	5.0
80°-90°	81.8	1.3
90°-100°	31.0	0.5
100°-110°	98.5	1.6
110°-120°	168.6	2.8
120°-130°	221.7	3.6
130°-140°	248.9	4.1
140°-150°	244.1	4.0
150°-160°	204.7	3.4
160°-170°	135.8	2.2
170°-180°	47.5	0.8
0°-30°	1383.6	22.7
0°-40°	2219.6	36.3
0°-60°	3782.5	61.9
0°-90°	4707.0	77.1
90°-120°	298.1	4.9
90°-150°	1012.8	16.6
90°-180°	1401.0	22.9
0°-180°	6107.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	0	6	15	14	14	6
95°	22	26	27	27	26	25
105°	91	92	93	94	94	96
115°	169	172	171	170	169	167
125°	246	250	249	247	247	220
135°	318	323	324	323	322	246
145°	386	389	392	392	391	241
155°	442	443	444	447	445	203
165°	481	480	480	483	481	136
175°	500	499	498	501	498	48
180°	501	501	501	501	501	

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	0.5	5.5	14.8	13.9	14.3
92.5°	9.3	12.7	13.2	13.6	13.6
95°	22.0	26.3	27.0	27.0	26.3
97.5°	36.7	40.6	42.3	42.3	42.3
100°	53.6	57.1	58.3	58.3	57.8
102.5°	71.5	74.0	75.7	76.1	75.7
105°	90.9	92.1	93.1	93.8	93.8
107.5°	110.3	112.1	112.1	112.4	110.3
110°	129.0	131.4	131.4	131.4	130.2

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	149.2	151.8	151.4	150.1	149.2
115°	169.2	171.6	170.9	170.4	169.2
117.5°	189.0	192.3	190.2	189.0	187.7
120°	208.9	212.2	208.9	208.9	207.6
122.5°	227.0	231.2	229.2	228.0	227.0
125°	246.1	249.9	248.7	247.3	246.8
127.5°	264.7	269.3	267.7	265.9	264.7
130°	282.0	287.5	286.7	285.8	284.2
132.5°	301.5	305.8	306.0	304.0	302.7
135°	318.3	323.0	323.8	323.4	322.2
137.5°	337.0	340.8	341.6	341.3	339.4
140°	353.5	357.3	359.4	359.4	357.7
142.5°	370.4	374.1	375.4	375.8	374.1
145°	386.4	389.4	391.9	392.3	390.6
147.5°	400.8	404.6	406.4	407.1	405.4
150°	415.6	418.1	419.8	421.1	419.8
152.5°	428.7	431.3	433.4	435.1	433.4
155°	441.9	443.1	444.4	446.6	445.2
157.5°	453.2	454.1	454.9	457.9	455.7
160°	463.3	464.2	464.7	467.2	465.4
162.5°	472.7	472.7	473.1	476.0	473.9
165°	480.7	480.2	480.2	483.2	481.2
167.5°	487.9	486.6	486.6	489.6	487.5
170°	493.4	492.2	491.7	494.7	492.2
172.5°	497.2	495.9	495.5	498.5	495.9
175°	500.2	499.0	498.0	501.1	498.5
177.5°	501.8	500.7	499.7	502.2	499.7
180°	501.1	501.1	501.1	501.1	501.1

TEST NUMBER: P915252

CATALOG NUMBER: DFN2DIP-TR2F0-060D020US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.27	15.44	14.95	16.14	16.96	13.84	15.01	14.53	15.72	16.54
	3H	15.92	16.98	16.62	17.69	18.55	15.46	16.52	16.16	17.23	18.09
	4H	16.51	17.50	17.23	18.23	19.10	16.05	17.04	16.77	17.77	18.64
	6H	16.91	17.83	17.64	18.56	19.44	16.45	17.37	17.18	18.10	18.98
	8H	17.01	17.89	17.75	18.64	19.53	16.55	17.43	17.29	18.18	19.07
	12H	17.06	17.90	17.81	18.64	19.56	16.60	17.43	17.34	18.18	19.09
4H	2H	14.75	15.75	15.47	16.47	17.34	14.41	15.41	15.13	16.13	17.00
	3H	16.62	17.45	17.35	18.21	19.10	16.24	17.07	16.97	17.83	18.71
	4H	17.33	18.08	18.08	18.84	19.76	16.93	17.69	17.68	18.45	19.37
	6H	17.84	18.49	18.60	19.28	20.20	17.44	18.10	18.21	18.88	19.81
	8H	17.98	18.60	18.75	19.38	20.31	17.59	18.20	18.36	18.98	19.92
	12H	18.06	18.61	18.85	19.42	20.36	17.66	18.21	18.45	19.01	19.95
8H	4H	17.54	18.15	18.31	18.93	19.87	17.19	17.80	17.96	18.58	19.52
	6H	18.15	18.66	18.96	19.49	20.43	17.80	18.31	18.60	19.13	20.07
	8H	18.36	18.81	19.18	19.64	20.59	18.01	18.46	18.82	19.28	20.24
	12H	18.49	18.89	19.31	19.71	20.72	18.12	18.52	18.94	19.34	20.35
12H	4H	17.54	18.09	18.33	18.89	19.83	17.19	17.74	17.98	18.55	19.49
	6H	18.18	18.64	19.00	19.46	20.41	17.84	18.29	18.65	19.12	20.07
	8H	18.42	18.82	19.24	19.63	20.65	18.08	18.47	18.89	19.29	20.30