

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915258

Luminaire Tested: DFN2DIP-TR2F0-060D030US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915258
REPORT IS A COMBINATION OF REPORTS P900240 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D030US927-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6143.4 lumens
Efficiency: N/A
Efficacy: 75.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 81.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

Luminous Intensity Polar Plot

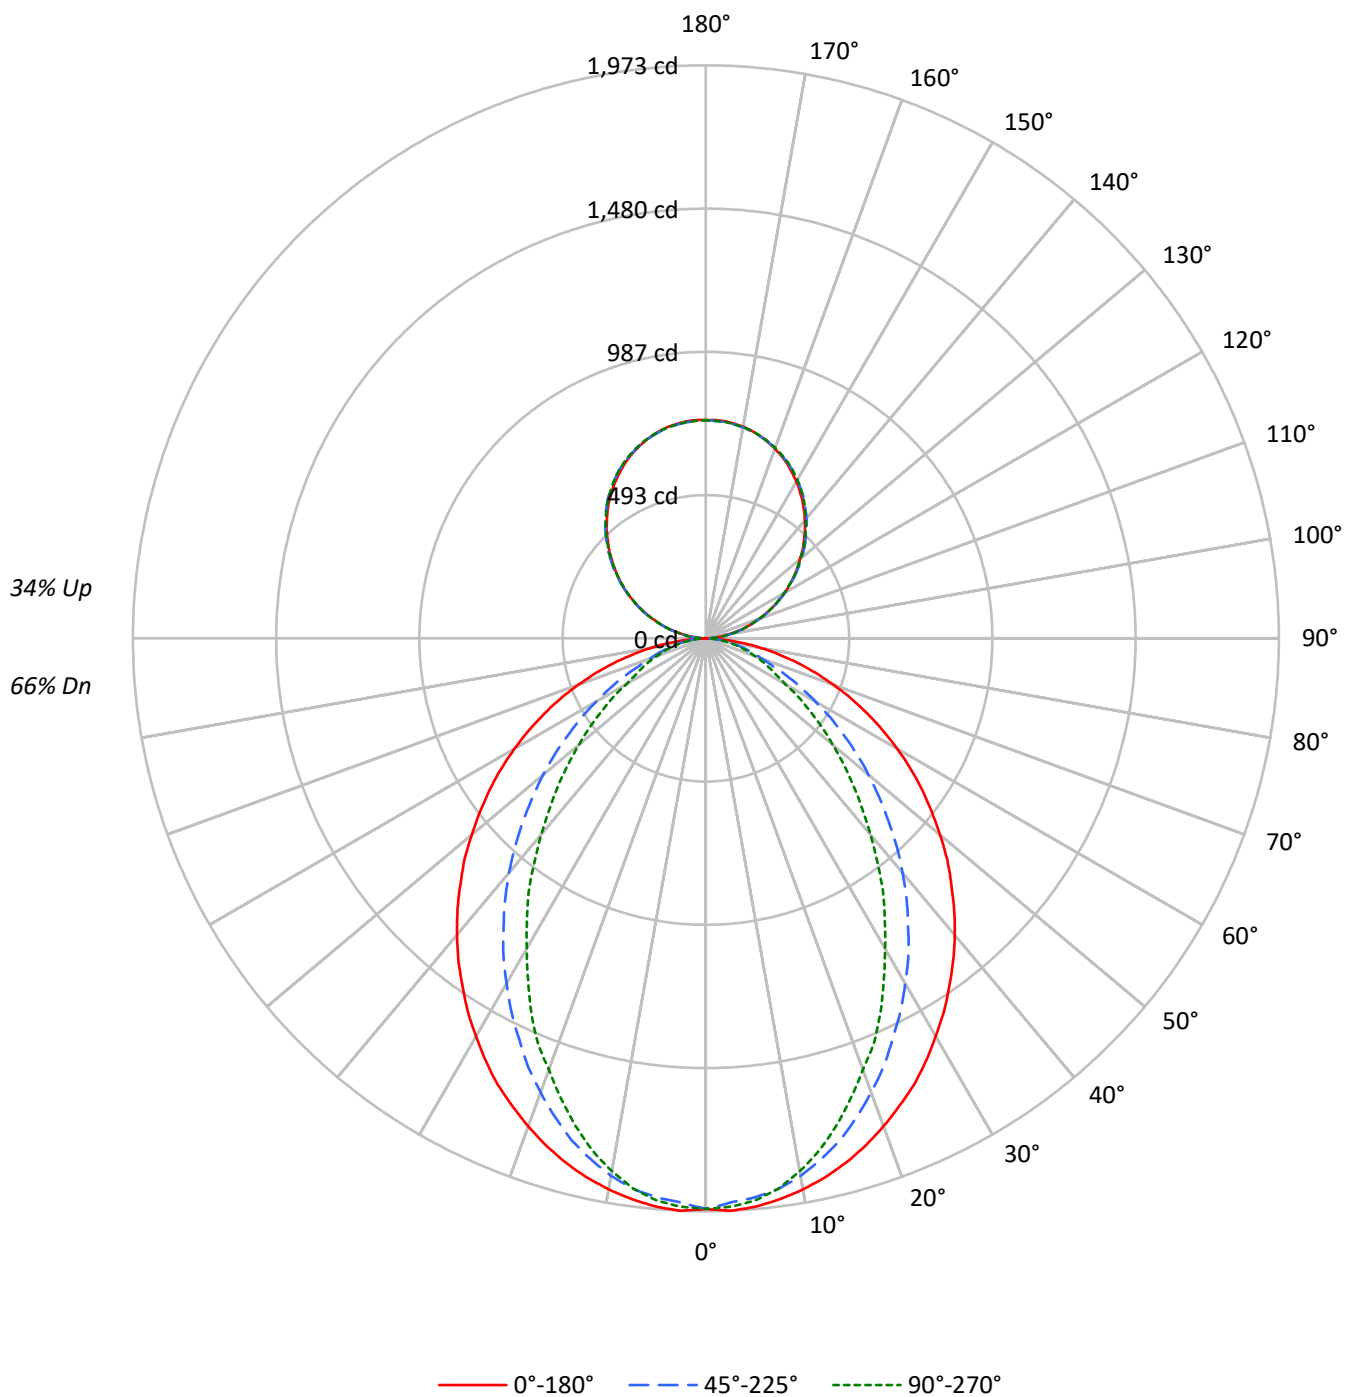

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4382	4382	4382
5°	4382	4302	4332
10°	4332	4208	4184
15°	4266	4059	3959
20°	4180	3859	3686
25°	4093	3636	3422
30°	3978	3408	3090
35°	3865	3163	2799
40°	3749	2912	2466
45°	3615	2634	2165
50°	3477	2354	1872
55°	3331	2057	1590
60°	3162	1747	1302
65°	2968	1434	1163
70°	2731	1142	1042
75°	2434	988	934
80°	2006	801	787
85°	1317	496	553

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3615 cd/sqm

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	3.0
10°-20°	505.4	8.2
20°-30°	709.6	11.6
30°-40°	773.5	12.6
40°-50°	710.9	11.6
50°-60°	558.3	9.1
60°-70°	363.4	5.9
70°-80°	187.1	3.0
80°-90°	49.9	0.8
90°-100°	46.5	0.8
100°-110°	147.8	2.4
110°-120°	252.9	4.1
120°-130°	332.6	5.4
130°-140°	373.3	6.1
140°-150°	366.1	6.0
150°-160°	307.1	5.0
160°-170°	203.7	3.3
170°-180°	71.2	1.2
0°-30°	1399.1	22.8
0°-40°	2172.6	35.4
0°-60°	3441.9	56.0
0°-90°	4042.3	65.8
90°-120°	447.2	7.3
90°-150°	1519.2	24.7
90°-180°	2101.0	34.2
0°-180°	6143.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	8	22	21	22	6
95°	33	40	41	41	40	37
105°	136	138	140	141	141	144
115°	254	257	256	256	254	251
125°	369	375	373	371	370	330
135°	477	484	486	485	483	369
145°	580	584	588	588	586	362
155°	663	665	667	670	668	305
165°	721	720	720	725	722	203
175°	750	748	747	752	748	71
180°	752	752	752	752	752	

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	0.7	8.2	22.2	20.8	21.5
92.5°	14.0	19.0	19.7	20.4	20.4
95°	33.1	39.5	40.6	40.6	39.5
97.5°	55.1	60.9	63.5	63.5	63.5
100°	80.4	85.6	87.5	87.5	86.8
102.5°	107.2	111.1	113.5	114.2	113.5
105°	136.4	138.2	139.6	140.7	140.7
107.5°	165.4	168.1	168.1	168.6	165.4
110°	193.5	197.2	197.2	197.2	195.4

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	223.9	227.8	227.0	225.2	223.9
115°	253.8	257.4	256.3	255.6	253.8
117.5°	283.4	288.4	285.3	283.4	281.6
120°	313.4	318.4	313.4	313.4	311.3
122.5°	340.6	346.9	343.7	341.9	340.6
125°	369.2	374.8	373.0	370.9	370.3
127.5°	397.0	404.0	401.6	398.8	397.0
130°	423.0	431.2	430.1	428.7	426.2
132.5°	452.3	458.6	459.1	455.9	454.1
135°	477.4	484.4	485.8	485.1	483.3
137.5°	505.5	511.2	512.3	511.9	509.1
140°	530.2	535.9	539.1	539.1	536.5
142.5°	555.6	561.3	563.1	563.8	561.3
145°	579.6	584.2	587.8	588.4	586.0
147.5°	601.2	606.8	609.5	610.7	608.2
150°	623.4	627.2	629.7	631.8	629.7
152.5°	643.1	646.9	650.1	652.6	650.1
155°	662.8	664.6	666.6	669.8	667.8
157.5°	679.8	681.1	682.3	686.8	683.7
160°	695.0	696.3	697.0	700.8	698.1
162.5°	709.0	709.0	709.7	714.0	710.8
165°	721.0	720.3	720.3	724.8	721.7
167.5°	731.9	729.8	729.8	734.4	731.2
170°	740.1	738.2	737.6	742.1	738.2
172.5°	745.7	743.9	743.2	747.7	743.9
175°	750.3	748.5	747.1	751.6	747.7
177.5°	752.7	750.9	749.6	753.4	749.6
180°	751.6	751.6	751.6	751.6	751.6

TEST NUMBER: P915258

CATALOG NUMBER: DFN2DIP-TR2F0-060D030US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.51	14.49	14.33	15.32	16.35	9.49	10.47	10.31	11.30	12.33
	3H	15.18	16.05	16.01	16.89	17.95	10.68	11.55	11.51	12.40	13.45
	4H	15.78	16.60	16.62	17.45	18.52	11.12	11.95	11.97	12.80	13.87
	6H	16.19	16.95	17.04	17.80	18.89	11.44	12.20	12.30	13.06	14.14
	8H	16.31	17.03	17.17	17.90	18.99	11.53	12.25	12.39	13.12	14.21
	12H	16.36	17.05	17.23	17.92	19.03	11.57	12.26	12.44	13.12	14.23
4H	2H	13.54	14.37	14.39	15.22	16.29	10.09	10.92	10.94	11.77	12.84
	3H	15.36	16.04	16.22	16.93	18.01	11.44	12.12	12.30	13.01	14.09
	4H	16.04	16.66	16.91	17.54	18.65	11.98	12.60	12.85	13.48	14.59
	6H	16.54	17.08	17.43	17.98	19.10	12.39	12.93	13.28	13.83	14.95
	8H	16.70	17.21	17.60	18.11	19.23	12.51	13.01	13.40	13.91	15.04
	12H	16.79	17.24	17.70	18.16	19.29	12.57	13.03	13.49	13.94	15.08
8H	4H	16.01	16.52	16.91	17.41	18.54	12.26	12.76	13.15	13.66	14.78
	6H	16.56	16.97	17.48	17.91	19.04	12.76	13.17	13.68	14.11	15.24
	8H	16.76	17.13	17.69	18.06	19.21	12.94	13.30	13.87	14.24	15.38
	12H	16.89	17.21	17.82	18.14	19.33	13.05	13.37	13.98	14.30	15.49
12H	4H	15.97	16.42	16.88	17.34	18.47	12.26	12.71	13.17	13.63	14.76
	6H	16.53	16.90	17.46	17.83	18.98	12.80	13.17	13.73	14.10	15.25
	8H	16.74	17.07	17.68	17.99	19.19	13.00	13.33	13.93	14.25	15.45