

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915266

Luminaire Tested: DFN2DIP-TR2F0-060D050US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915266
REPORT IS A COMBINATION OF REPORTS P900260 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D050US927-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7545.6 lumens
Efficiency: N/A
Efficacy: 77.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 97.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

Luminous Intensity Polar Plot

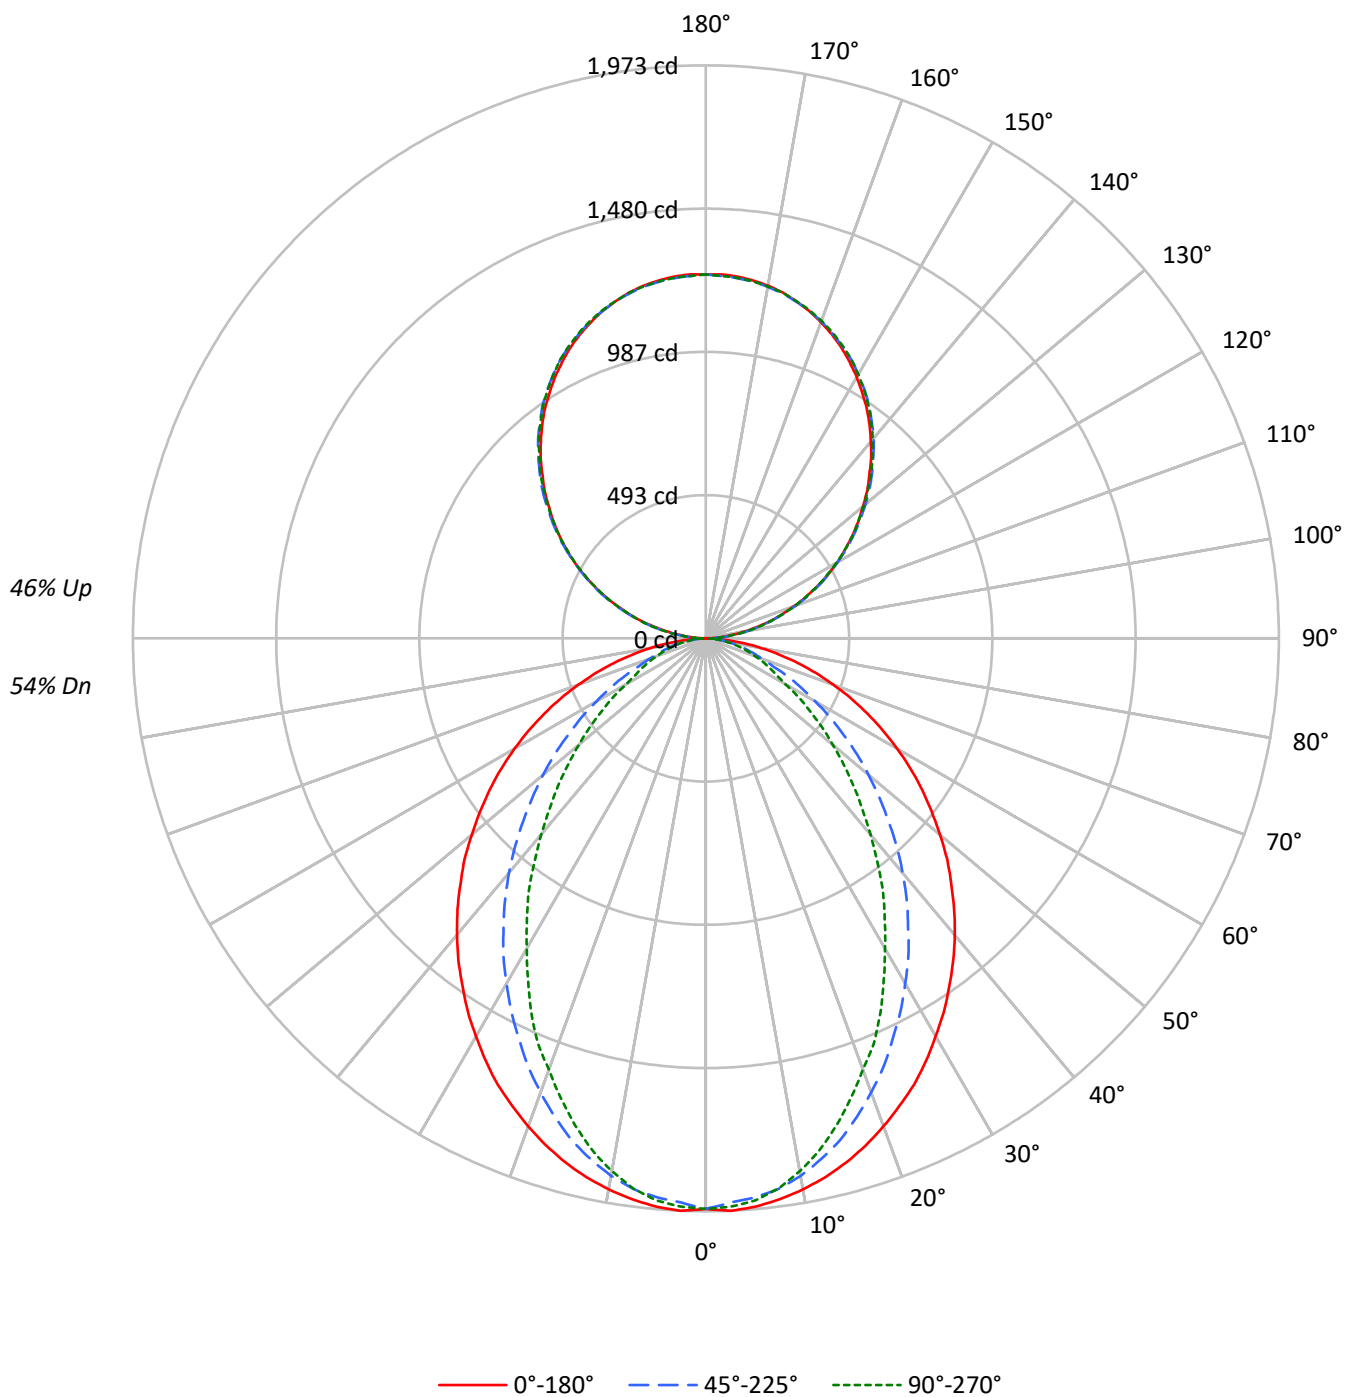

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4382	4382	4382
5°	4382	4302	4332
10°	4332	4208	4184
15°	4266	4059	3959
20°	4180	3859	3686
25°	4093	3636	3422
30°	3978	3408	3090
35°	3865	3163	2799
40°	3749	2912	2466
45°	3615	2634	2165
50°	3477	2354	1872
55°	3331	2057	1590
60°	3162	1747	1302
65°	2968	1434	1163
70°	2731	1142	1042
75°	2434	988	934
80°	2006	801	787
85°	1317	496	553

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3615 cd/sqm

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.4
10°-20°	505.4	6.7
20°-30°	709.6	9.4
30°-40°	773.5	10.3
40°-50°	710.9	9.4
50°-60°	558.3	7.4
60°-70°	363.4	4.8
70°-80°	187.1	2.5
80°-90°	51.3	0.7
90°-100°	77.5	1.0
100°-110°	246.3	3.3
110°-120°	421.5	5.6
120°-130°	554.3	7.3
130°-140°	622.2	8.2
140°-150°	610.1	8.1
150°-160°	511.8	6.8
160°-170°	339.4	4.5
170°-180°	118.6	1.6
0°-30°	1399.1	18.5
0°-40°	2172.6	28.8
0°-60°	3441.9	45.6
0°-90°	4043.7	53.6
90°-120°	745.3	9.9
90°-150°	2532.0	33.6
90°-180°	3502.0	46.4
0°-180°	7545.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	14	37	35	36	7
95°	55	66	68	68	66	61
105°	227	230	233	234	234	240
115°	423	429	427	426	423	418
125°	615	625	622	618	617	550
135°	796	807	810	809	806	615
145°	966	974	980	981	977	604
155°	1105	1108	1111	1116	1113	508
165°	1202	1201	1201	1208	1203	339
175°	1250	1247	1245	1253	1246	119
180°	1253	1253	1253	1253	1253	

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.1	13.6	37.0	34.8	35.9
92.5°	23.4	31.7	32.9	34.0	34.0
95°	55.1	65.8	67.6	67.6	65.8
97.5°	91.7	101.6	105.8	105.8	105.8
100°	134.0	142.8	145.8	145.8	144.7
102.5°	178.6	185.1	189.2	190.4	189.2
105°	227.4	230.4	232.7	234.5	234.5
107.5°	275.7	280.2	280.2	281.0	275.7
110°	322.5	328.6	328.6	328.6	325.5

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	373.1	379.5	378.4	375.4	373.1
115°	422.9	429.0	427.1	426.0	422.9
117.5°	472.5	480.8	475.5	472.5	469.4
120°	522.3	530.6	522.3	522.3	518.9
122.5°	567.6	578.2	572.9	569.9	567.6
125°	615.2	624.6	621.6	618.2	617.1
127.5°	661.6	673.4	669.2	664.6	661.6
130°	705.1	718.7	716.8	714.5	710.3
132.5°	753.8	764.4	765.2	759.9	756.8
135°	795.7	807.4	809.7	808.6	805.6
137.5°	842.6	852.0	853.9	853.1	848.6
140°	883.7	893.2	898.4	898.4	894.3
142.5°	926.0	935.5	938.5	939.6	935.5
145°	966.1	973.6	979.6	980.8	976.6
147.5°	1002.0	1011.4	1015.9	1017.8	1013.6
150°	1038.9	1045.4	1049.5	1052.9	1049.5
152.5°	1071.8	1078.2	1083.5	1087.7	1083.5
155°	1104.6	1107.6	1111.0	1116.3	1112.9
157.5°	1133.0	1135.2	1137.1	1144.7	1139.4
160°	1158.2	1160.5	1161.7	1168.1	1163.6
162.5°	1181.7	1181.7	1182.8	1190.0	1184.7
165°	1201.7	1200.6	1200.6	1208.2	1202.8
167.5°	1219.8	1216.4	1216.4	1224.0	1218.7
170°	1233.4	1230.4	1229.3	1236.8	1230.4
172.5°	1242.9	1239.8	1238.7	1246.3	1239.8
175°	1250.5	1247.4	1245.2	1252.7	1246.3
177.5°	1254.6	1251.6	1249.3	1255.7	1249.3
180°	1252.7	1252.7	1252.7	1252.7	1252.7

TEST NUMBER: P915266

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.48	13.34	13.41	14.29	15.51	8.46	9.32	9.39	10.27	11.49
	3H	14.14	14.90	15.08	15.86	17.10	9.64	10.41	10.58	11.36	12.61
	4H	14.73	15.46	15.69	16.42	17.67	10.08	10.80	11.04	11.76	13.02
	6H	15.13	15.80	16.10	16.77	18.03	10.39	11.06	11.36	12.02	13.29
	8H	15.25	15.89	16.23	16.87	18.13	10.47	11.11	11.45	12.09	13.35
	12H	15.30	15.91	16.28	16.88	18.17	10.51	11.11	11.49	12.09	13.38
4H	2H	12.50	13.22	13.46	14.18	15.44	9.05	9.77	10.01	10.73	11.99
	3H	14.30	14.91	15.28	15.90	17.16	10.38	10.99	11.36	11.97	13.24
	4H	14.98	15.53	15.96	16.51	17.80	10.92	11.47	11.90	12.45	13.74
	6H	15.47	15.95	16.47	16.95	18.24	11.32	11.80	12.32	12.80	14.09
	8H	15.63	16.08	16.63	17.08	18.38	11.44	11.88	12.44	12.88	14.19
	12H	15.72	16.12	16.73	17.13	18.44	11.50	11.90	12.51	12.91	14.22
8H	4H	14.94	15.39	15.94	16.39	17.69	11.19	11.63	12.18	12.63	13.93
	6H	15.49	15.85	16.51	16.89	18.20	11.68	12.05	12.70	13.09	14.39
	8H	15.69	16.01	16.72	17.04	18.36	11.86	12.18	12.89	13.21	14.53
	12H	15.81	16.09	16.84	17.12	18.48	11.97	12.25	13.00	13.27	14.64
12H	4H	14.90	15.30	15.91	16.31	17.62	11.19	11.59	12.20	12.60	13.91
	6H	15.46	15.78	16.49	16.81	18.13	11.73	12.05	12.76	13.08	14.40
	8H	15.66	15.95	16.70	16.97	18.34	11.92	12.21	12.96	13.23	14.60