

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917905

Luminaire Tested: DFN2DIP-TR2F0-020D030US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917905
REPORT IS A COMBINATION OF REPORTS P901751 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-020D030US930-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3778.9 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 37
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLLONL

Luminous Intensity Polar Plot

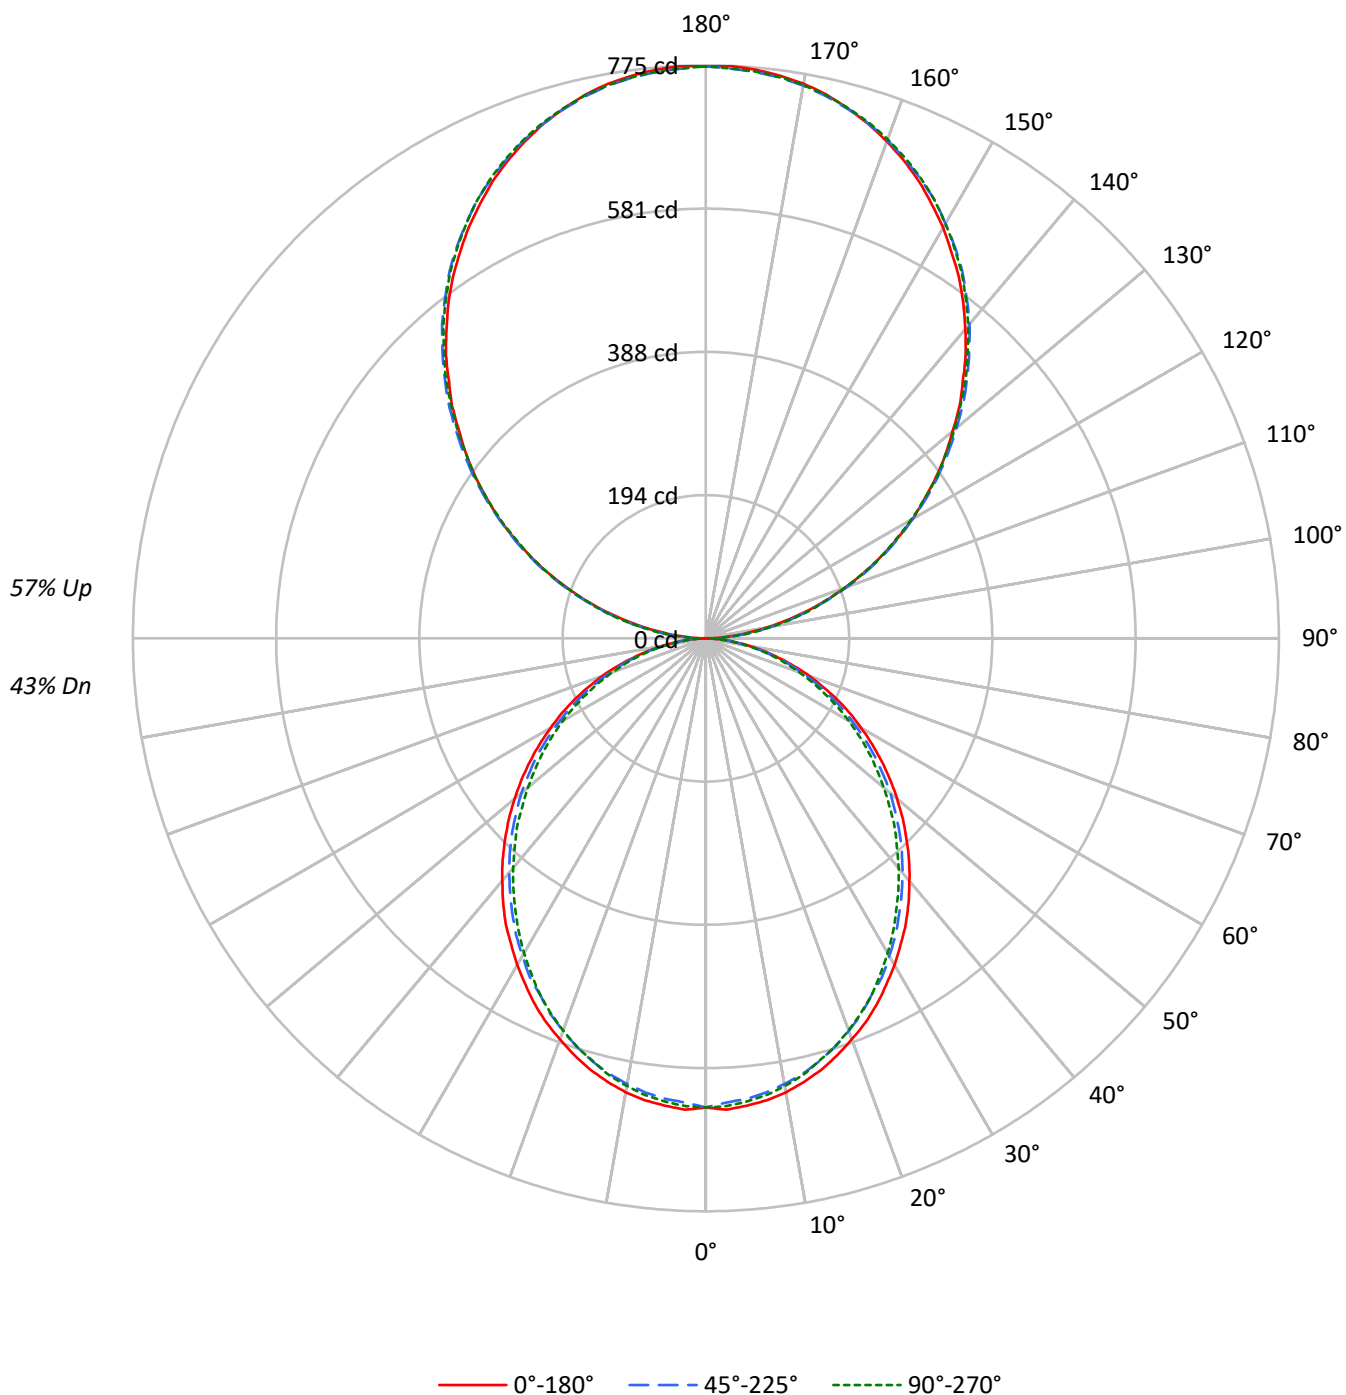

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1415	1415	1415
5°	1415	1392	1402
10°	1402	1370	1381
15°	1379	1345	1349
20°	1349	1310	1316
25°	1319	1270	1279
30°	1282	1232	1232
35°	1247	1187	1182
40°	1204	1142	1135
45°	1161	1097	1086
50°	1114	1050	1030
55°	1065	995	978
60°	1009	930	918
65°	947	863	848
70°	870	780	772
75°	763	682	698
80°	633	557	564
85°	429	350	351

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1161 cd/sqm

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	59.7	1.6
10°-20°	168.0	4.4
20°-30°	246.9	6.5
30°-40°	286.8	7.6
40°-50°	286.4	7.6
50°-60°	249.7	6.6
60°-70°	184.6	4.9
70°-80°	104.5	2.8
80°-90°	29.8	0.8
90°-100°	47.9	1.3
100°-110°	152.1	4.0
110°-120°	260.3	6.9
120°-130°	342.3	9.1
130°-140°	384.2	10.2
140°-150°	376.8	10.0
150°-160°	316.1	8.4
160°-170°	209.6	5.5
170°-180°	73.3	1.9
0°-30°	474.7	12.6
0°-40°	761.5	20.2
0°-60°	1297.6	34.3
0°-90°	1616.5	42.8
90°-120°	460.2	12.2
90°-150°	1563.5	41.4
90°-180°	2162.0	57.2
0°-180°	3778.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	634	634	634	634	634	
5°	634	632	625	630	629	60
15°	604	600	592	595	592	170
25°	547	542	531	533	531	252
35°	472	466	456	452	449	295
45°	384	380	370	364	361	296
55°	290	287	279	272	269	260
65°	196	192	186	181	178	194
75°	102	101	98	95	96	109
85°	25	24	24	22	21	28
90°	1	8	23	21	22	4
95°	34	41	42	42	41	38
105°	140	142	144	145	145	148
115°	261	265	264	263	261	258
125°	380	386	384	382	381	339
135°	491	499	500	499	497	380
145°	597	601	605	606	603	373
155°	682	684	686	689	687	314
165°	742	741	741	746	743	209
175°	772	770	769	774	770	73
180°	774	774	774	774	774	

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	634.5	634.5	634.5	634.5	634.5
2.5°	638.1	635.1	628.4	634.5	633.3
5°	634.5	632.1	625.3	630.2	629.0
7.5°	630.2	626.6	619.9	624.8	623.5
10°	623.5	619.3	612.0	616.8	615.0
12.5°	614.3	610.7	603.4	606.4	605.2
15°	604.0	600.4	592.4	594.8	591.8
17.5°	591.2	587.6	579.6	582.6	579.6
20°	577.1	573.5	564.9	566.8	564.3
22.5°	563.1	557.7	549.7	549.7	548.5
25°	546.7	541.8	531.4	532.6	531.4
27.5°	528.3	524.1	516.2	514.4	511.3
30°	510.1	505.2	496.0	494.2	491.7
32.5°	490.5	486.9	477.1	473.4	471.0
35°	471.7	465.5	455.8	452.1	449.0
37.5°	450.3	444.7	435.0	430.7	427.6
40°	428.3	423.4	413.6	408.2	405.7
42.5°	406.9	402.0	392.3	386.2	382.5
45°	383.8	379.5	370.3	363.6	361.2
47.5°	361.2	356.9	347.2	340.4	336.8
50°	337.4	334.4	325.8	317.2	314.2
52.5°	314.2	309.9	302.0	295.3	291.1
55°	290.4	286.7	279.4	272.1	269.0
57.5°	266.6	263.6	255.6	248.3	245.8
60°	242.8	240.4	231.9	225.1	223.3
62.5°	219.6	215.3	209.3	203.2	200.7
65°	195.8	192.2	186.1	180.6	177.6
67.5°	171.5	168.4	162.9	158.7	156.2
70°	148.9	146.4	140.9	136.6	134.3
72.5°	125.7	123.3	120.2	115.9	114.1
75°	102.5	101.3	98.2	94.6	95.8
77.5°	81.8	79.3	78.0	76.2	74.4
80°	61.1	60.4	59.2	57.3	56.1
82.5°	41.5	41.5	40.9	38.5	38.5
85°	24.9	24.4	23.8	21.9	21.4
87.5°	11.0	9.8	8.6	6.8	6.1
90°	0.7	8.4	22.8	21.4	22.2
92.5°	14.4	19.6	20.3	21.0	21.0
95°	34.1	40.6	41.7	41.7	40.6
97.5°	56.7	62.7	65.3	65.3	65.3
100°	82.8	88.1	90.0	90.0	89.4
102.5°	110.3	114.3	116.8	117.6	116.8
105°	140.4	142.3	143.7	144.8	144.8
107.5°	170.2	173.0	173.0	173.5	170.2
110°	199.2	202.9	202.9	202.9	201.1

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	230.4	234.4	233.7	231.8	230.4
115°	261.2	264.9	263.7	263.1	261.2
117.5°	291.7	296.9	293.6	291.7	289.8
120°	322.5	327.7	322.5	322.5	320.4
122.5°	350.5	357.0	353.8	351.9	350.5
125°	379.9	385.7	383.8	381.7	381.1
127.5°	408.5	415.8	413.3	410.4	408.5
130°	435.4	443.8	442.6	441.2	438.6
132.5°	465.5	472.0	472.5	469.2	467.3
135°	491.4	498.6	500.0	499.3	497.4
137.5°	520.2	526.1	527.3	526.8	524.0
140°	545.7	551.5	554.8	554.8	552.2
142.5°	571.9	577.6	579.5	580.2	577.6
145°	596.6	601.2	605.0	605.6	603.1
147.5°	618.7	624.5	627.3	628.5	625.9
150°	641.6	645.6	648.1	650.2	648.1
152.5°	661.9	665.8	669.0	671.6	669.0
155°	682.2	684.0	686.1	689.3	687.3
157.5°	699.6	701.0	702.2	706.9	703.6
160°	715.3	716.6	717.4	721.3	718.5
162.5°	729.7	729.7	730.4	734.8	731.6
165°	742.1	741.4	741.4	746.0	742.7
167.5°	753.3	751.1	751.1	755.8	752.5
170°	761.7	759.8	759.1	763.8	759.8
172.5°	767.4	765.6	764.9	769.6	765.6
175°	772.2	770.3	768.9	773.6	769.6
177.5°	774.7	772.8	771.4	775.4	771.4
180°	773.6	773.6	773.6	773.6	773.6

TEST NUMBER: P917905

CATALOG NUMBER: DFN2DIP-TR2F0-020D030US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.64	8.44	8.66	9.47	10.84	7.22	8.02	8.23	9.04	10.41
	3H	9.27	9.99	10.30	11.03	12.42	8.81	9.53	9.84	10.56	11.95
	4H	9.84	10.52	10.88	11.56	12.96	9.38	10.06	10.42	11.10	12.50
	6H	10.22	10.85	11.27	11.89	13.30	9.76	10.39	10.81	11.43	12.84
	8H	10.32	10.91	11.37	11.97	13.37	9.86	10.45	10.91	11.51	12.91
	12H	10.35	10.92	11.41	11.97	13.40	9.89	10.46	10.95	11.51	12.94
4H	2H	8.09	8.77	9.13	9.80	11.20	7.75	8.43	8.79	9.46	10.86
	3H	9.92	10.49	10.97	11.55	12.96	9.53	10.10	10.59	11.17	12.58
	4H	10.61	11.13	11.67	12.19	13.62	10.22	10.74	11.28	11.79	13.23
	6H	11.10	11.55	12.17	12.63	14.06	10.70	11.15	11.77	12.23	13.66
	8H	11.24	11.66	12.31	12.73	14.17	10.84	11.26	11.91	12.33	13.77
	12H	11.30	11.68	12.39	12.76	14.21	10.89	11.27	11.98	12.36	13.80
8H	4H	10.79	11.21	11.86	12.28	13.73	10.44	10.86	11.51	11.93	13.37
	6H	11.39	11.74	12.49	12.85	14.29	11.04	11.39	12.13	12.50	13.94
	8H	11.60	11.90	12.70	13.00	14.46	11.24	11.54	12.34	12.64	14.10
	12H	11.71	11.98	12.82	13.07	14.57	11.34	11.61	12.45	12.70	14.20
12H	4H	10.77	11.15	11.86	12.24	13.69	10.43	10.81	11.52	11.89	13.34
	6H	11.42	11.72	12.52	12.82	14.28	11.08	11.38	12.18	12.48	13.94
	8H	11.64	11.91	12.75	13.00	14.50	11.29	11.56	12.40	12.65	14.15

END OF REPORT