

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917913

Luminaire Tested: DFN2DIP-TR2F0-020D050US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917913
REPORT IS A COMBINATION OF REPORTS P901771 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-020D050US930-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5222.0 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 53.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLLONL

Luminous Intensity Polar Plot

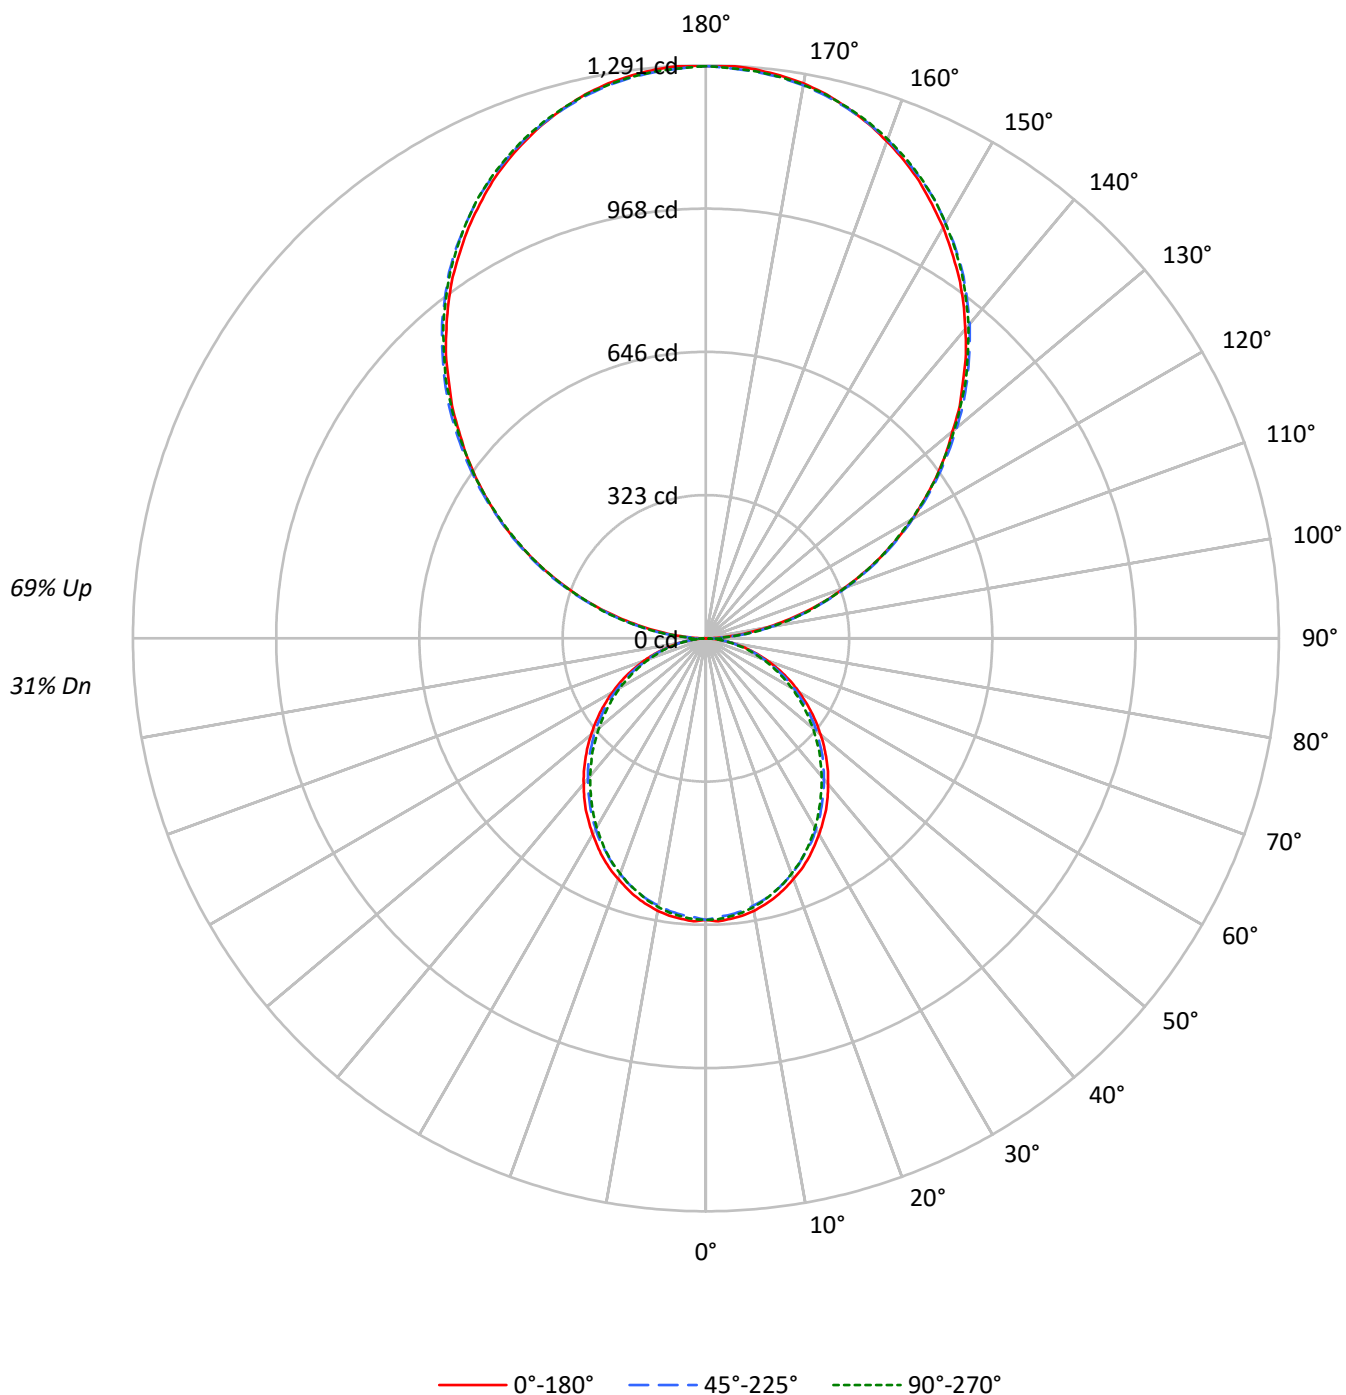

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	61	60	48	47	46	34	33	33
2	85	78	72	67	76	70	65	61	56	52	49	42	40	38	30	29	27
3	78	68	61	56	69	62	56	51	49	45	41	37	35	32	27	25	23
4	71	60	53	47	63	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	26	24	21	19	17
6	60	48	40	35	54	44	37	32	35	30	26	27	23	21	19	17	15
7	55	43	36	30	49	39	33	28	32	27	23	24	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	47	36	28	24	43	32	26	22	26	21	18	20	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	15	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1415	1415	1415
5°	1415	1392	1402
10°	1402	1370	1381
15°	1379	1345	1349
20°	1349	1310	1316
25°	1319	1270	1279
30°	1282	1232	1232
35°	1247	1187	1182
40°	1204	1142	1135
45°	1161	1097	1086
50°	1114	1050	1030
55°	1065	995	978
60°	1009	930	918
65°	947	863	848
70°	870	780	772
75°	763	682	698
80°	633	557	564
85°	429	350	351

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1682 cd/sqm

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	59.7	1.1
10°-20°	168.0	3.2
20°-30°	246.9	4.7
30°-40°	286.8	5.5
40°-50°	286.4	5.5
50°-60°	249.7	4.8
60°-70°	184.6	3.5
70°-80°	104.5	2.0
80°-90°	31.2	0.6
90°-100°	79.8	1.5
100°-110°	253.5	4.9
110°-120°	433.8	8.3
120°-130°	570.5	10.9
130°-140°	640.4	12.3
140°-150°	627.9	12.0
150°-160°	526.8	10.1
160°-170°	349.3	6.7
170°-180°	122.1	2.3
0°-30°	474.7	9.1
0°-40°	761.5	14.6
0°-60°	1297.6	24.8
0°-90°	1618.0	31.0
90°-120°	767.0	14.7
90°-150°	2605.8	49.9
90°-180°	3604.0	69.0
0°-180°	5222.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	634	634	634	634	634	
5°	634	632	625	630	629	60
15°	604	600	592	595	592	170
25°	547	542	531	533	531	252
35°	472	466	456	452	449	295
45°	384	380	370	364	361	296
55°	290	287	279	272	269	260
65°	196	192	186	181	178	194
75°	102	101	98	95	96	109
85°	25	24	24	22	21	28
90°	1	14	38	36	37	5
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	634.5	634.5	634.5	634.5	634.5
2.5°	638.1	635.1	628.4	634.5	633.3
5°	634.5	632.1	625.3	630.2	629.0
7.5°	630.2	626.6	619.9	624.8	623.5
10°	623.5	619.3	612.0	616.8	615.0
12.5°	614.3	610.7	603.4	606.4	605.2
15°	604.0	600.4	592.4	594.8	591.8
17.5°	591.2	587.6	579.6	582.6	579.6
20°	577.1	573.5	564.9	566.8	564.3
22.5°	563.1	557.7	549.7	549.7	548.5
25°	546.7	541.8	531.4	532.6	531.4
27.5°	528.3	524.1	516.2	514.4	511.3
30°	510.1	505.2	496.0	494.2	491.7
32.5°	490.5	486.9	477.1	473.4	471.0
35°	471.7	465.5	455.8	452.1	449.0
37.5°	450.3	444.7	435.0	430.7	427.6
40°	428.3	423.4	413.6	408.2	405.7
42.5°	406.9	402.0	392.3	386.2	382.5
45°	383.8	379.5	370.3	363.6	361.2
47.5°	361.2	356.9	347.2	340.4	336.8
50°	337.4	334.4	325.8	317.2	314.2
52.5°	314.2	309.9	302.0	295.3	291.1
55°	290.4	286.7	279.4	272.1	269.0
57.5°	266.6	263.6	255.6	248.3	245.8
60°	242.8	240.4	231.9	225.1	223.3
62.5°	219.6	215.3	209.3	203.2	200.7
65°	195.8	192.2	186.1	180.6	177.6
67.5°	171.5	168.4	162.9	158.7	156.2
70°	148.9	146.4	140.9	136.6	134.3
72.5°	125.7	123.3	120.2	115.9	114.1
75°	102.5	101.3	98.2	94.6	95.8
77.5°	81.8	79.3	78.0	76.2	74.4
80°	61.1	60.4	59.2	57.3	56.1
82.5°	41.5	41.5	40.9	38.5	38.5
85°	24.9	24.4	23.8	21.9	21.4
87.5°	11.0	9.8	8.6	6.8	6.1
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2

TEST NUMBER: P917913

CATALOG NUMBER: DFN2DIP-TR2F0-020D050US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.27	6.98	7.37	8.08	9.60	5.84	6.55	6.95	7.66	9.18
	3H	7.89	8.53	9.00	9.64	11.18	7.43	8.07	8.54	9.18	10.71
	4H	8.46	9.06	9.58	10.17	11.71	8.00	8.60	9.12	9.71	11.25
	6H	8.83	9.39	9.96	10.50	12.05	8.37	8.93	9.50	10.04	11.59
	8H	8.92	9.45	10.06	10.58	12.13	8.46	8.99	9.60	10.12	11.67
	12H	8.96	9.46	10.10	10.58	12.15	8.49	9.00	9.63	10.12	11.69
4H	2H	6.70	7.31	7.83	8.42	9.96	6.36	6.97	7.49	8.08	9.62
	3H	8.52	9.03	9.66	10.17	11.72	8.14	8.65	9.28	9.78	11.34
	4H	9.21	9.68	10.35	10.81	12.38	8.82	9.28	9.96	10.41	11.98
	6H	9.70	10.10	10.85	11.25	12.81	9.30	9.70	10.45	10.85	12.41
	8H	9.83	10.21	10.98	11.35	12.93	9.43	9.81	10.58	10.95	12.53
	12H	9.89	10.23	11.05	11.38	12.96	9.48	9.82	10.64	10.97	12.56
8H	4H	9.39	9.76	10.53	10.90	12.48	9.04	9.41	10.18	10.55	12.13
	6H	9.99	10.29	11.15	11.48	13.05	9.63	9.94	10.80	11.12	12.70
	8H	10.19	10.46	11.36	11.62	13.22	9.83	10.10	11.00	11.26	12.86
	12H	10.30	10.53	11.47	11.69	13.33	9.93	10.16	11.10	11.32	12.96
12H	4H	9.36	9.70	10.53	10.85	12.44	9.02	9.36	10.18	10.51	12.10
	6H	10.01	10.28	11.18	11.44	13.04	9.67	9.94	10.84	11.10	12.70
	8H	10.23	10.46	11.40	11.62	13.25	9.88	10.12	11.06	11.27	12.91

END OF REPORT