

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917937

Luminaire Tested: DFN2DIP-TR2F0-030D060US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917937
REPORT IS A COMBINATION OF REPORTS P901783 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D060US930-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6750.7 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 73.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLLONL

Luminous Intensity Polar Plot

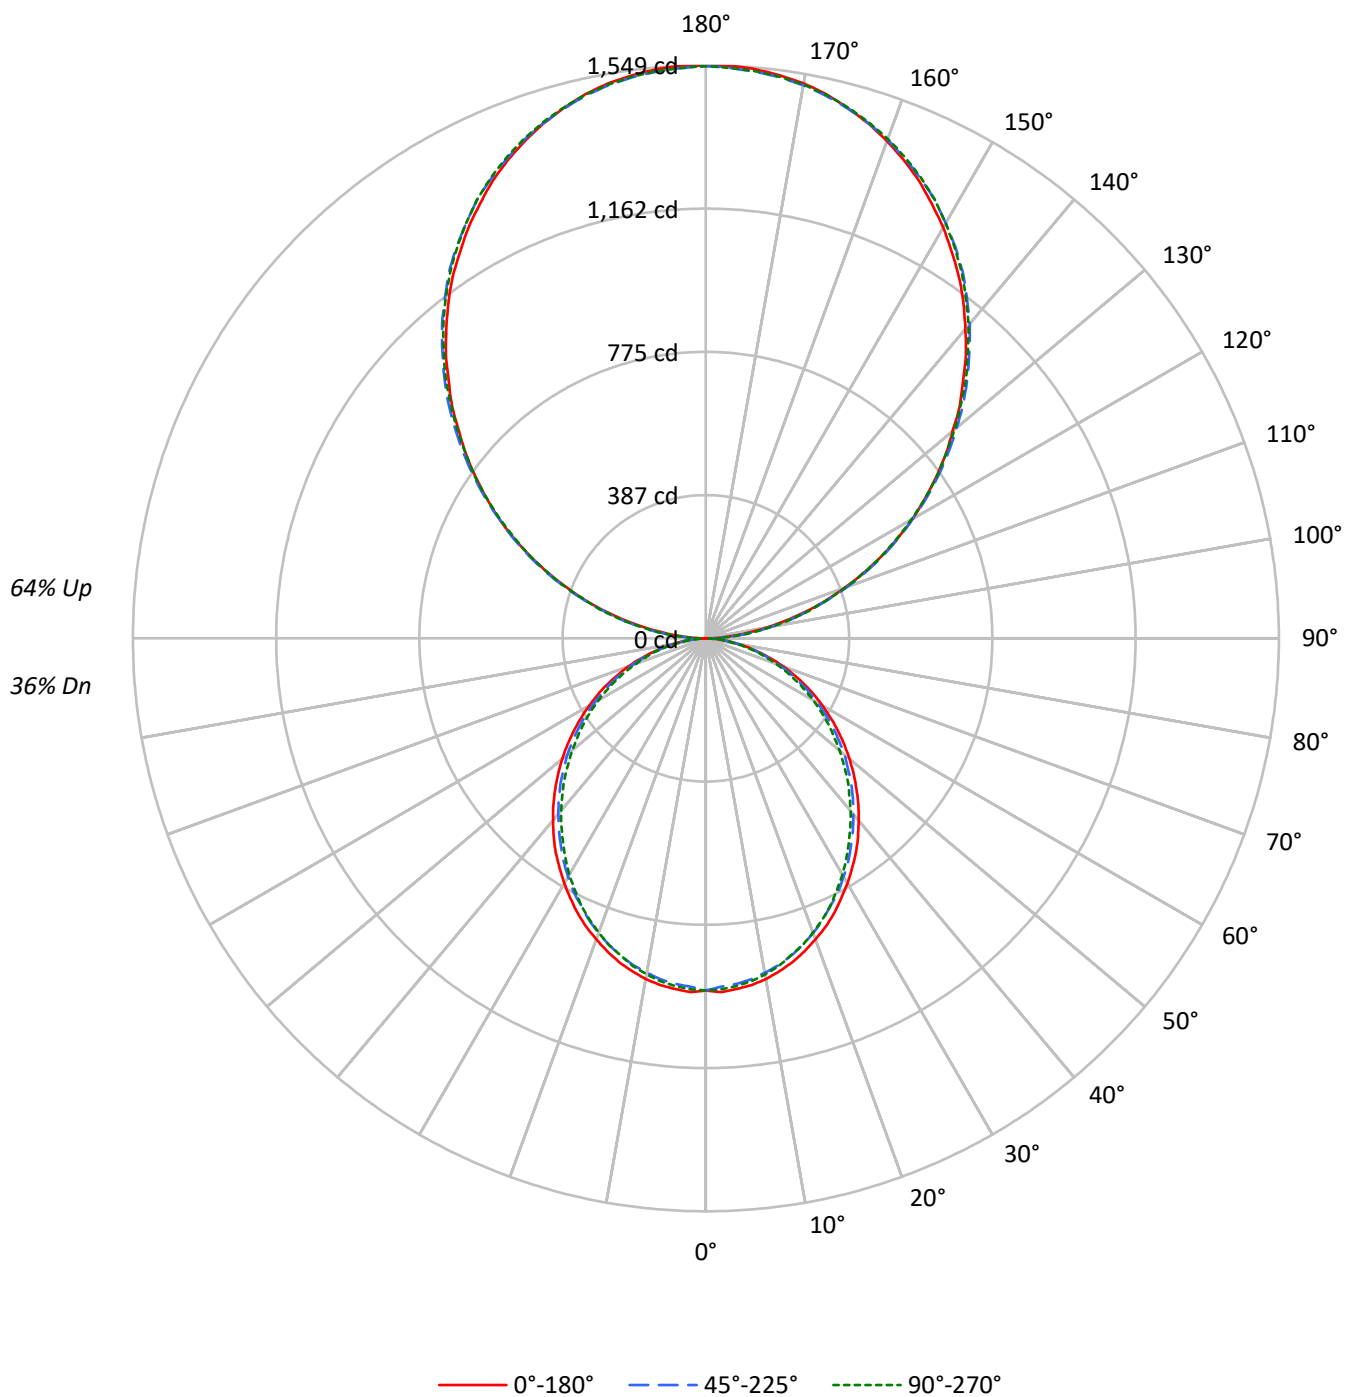

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2123	2123	2123
5°	2123	2088	2103
10°	2103	2056	2071
15°	2069	2017	2023
20°	2024	1965	1974
25°	1979	1904	1918
30°	1923	1847	1847
35°	1871	1781	1773
40°	1807	1714	1702
45°	1742	1646	1629
50°	1672	1575	1545
55°	1598	1492	1467
60°	1514	1395	1378
65°	1421	1294	1272
70°	1304	1171	1158
75°	1144	1023	1047
80°	949	834	847
85°	647	526	525

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2020 cd/sqm

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	89.6	1.3
10°-20°	252.0	3.7
20°-30°	370.4	5.5
30°-40°	430.2	6.4
40°-50°	429.7	6.4
50°-60°	374.6	5.5
60°-70°	277.0	4.1
70°-80°	156.7	2.3
80°-90°	45.7	0.7
90°-100°	95.7	1.4
100°-110°	304.2	4.5
110°-120°	520.6	7.7
120°-130°	684.6	10.1
130°-140°	768.4	11.4
140°-150°	753.5	11.2
150°-160°	632.1	9.4
160°-170°	419.2	6.2
170°-180°	146.5	2.2
0°-30°	712.0	10.5
0°-40°	1142.2	16.9
0°-60°	1946.5	28.8
0°-90°	2425.8	35.9
90°-120°	920.5	13.6
90°-150°	3127.0	46.3
90°-180°	4325.0	64.1
0°-180°	6750.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	952	952	952	952	952	
5°	952	948	938	945	944	90
15°	906	901	889	892	888	255
25°	820	813	797	799	797	377
35°	707	698	684	678	674	442
45°	576	569	556	545	542	444
55°	436	430	419	408	404	390
65°	294	288	279	271	266	290
75°	154	152	147	142	144	164
85°	38	37	36	33	32	42
90°	1	17	46	43	44	7
95°	68	81	84	84	81	76
105°	281	284	287	290	290	296
115°	522	530	528	526	522	517
125°	760	771	768	764	762	679
135°	983	997	1000	999	995	760
145°	1193	1202	1210	1211	1206	745
155°	1364	1368	1372	1379	1374	628
165°	1484	1483	1483	1492	1486	419
175°	1544	1541	1538	1547	1539	147
180°	1547	1547	1547	1547	1547	

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	951.7	951.7	951.7	951.7	951.7
2.5°	957.2	952.7	942.6	951.7	950.0
5°	951.7	948.1	938.0	945.3	943.5
7.5°	945.3	939.9	929.8	937.2	935.3
10°	935.3	928.9	917.9	925.2	922.5
12.5°	921.5	916.1	905.1	909.6	907.8
15°	906.0	900.6	888.6	892.3	887.7
17.5°	886.7	881.3	869.4	873.9	869.4
20°	865.7	860.2	847.4	850.1	846.5
22.5°	844.7	836.5	824.5	824.5	822.6
25°	819.9	812.7	797.1	798.9	797.1
27.5°	792.5	786.0	774.2	771.5	767.0
30°	765.1	757.7	744.0	741.3	737.6
32.5°	735.8	730.3	715.7	710.1	706.5
35°	707.4	698.3	683.6	678.1	673.5
37.5°	675.4	667.2	652.5	646.0	641.5
40°	642.5	635.1	620.4	612.3	608.6
42.5°	610.4	603.1	588.5	579.3	573.8
45°	575.7	569.2	555.5	545.4	541.8
47.5°	541.8	535.4	520.7	510.6	505.2
50°	506.1	501.5	488.7	475.9	471.3
52.5°	471.3	464.9	453.1	443.0	436.5
55°	435.7	430.2	419.1	408.2	403.7
57.5°	399.9	395.3	383.4	372.4	368.8
60°	364.2	360.6	347.8	337.7	335.0
62.5°	329.5	323.0	313.9	304.8	301.1
65°	293.8	288.3	279.2	270.9	266.4
67.5°	257.2	252.6	244.3	238.0	234.3
70°	223.3	219.6	211.4	205.0	201.4
72.5°	188.6	184.8	180.3	173.9	171.2
75°	153.7	152.0	147.3	141.9	143.7
77.5°	122.6	119.0	117.1	114.4	111.7
80°	91.6	90.6	88.7	86.0	84.2
82.5°	62.2	62.2	61.4	57.6	57.6
85°	37.5	36.6	35.7	32.9	32.0
87.5°	16.5	14.7	12.8	10.1	9.1
90°	1.4	16.8	45.7	42.9	44.3
92.5°	28.9	39.2	40.6	42.0	42.0
95°	68.1	81.1	83.5	83.5	81.1
97.5°	113.3	125.5	130.6	130.6	130.6
100°	165.6	176.3	180.0	180.0	178.6
102.5°	220.6	228.5	233.7	235.1	233.7
105°	280.8	284.5	287.3	289.7	289.7
107.5°	340.5	346.1	346.1	347.0	340.5
110°	398.4	405.8	405.8	405.8	402.0

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	460.8	468.7	467.3	463.6	460.8
115°	522.4	529.9	527.5	526.1	522.4
117.5°	583.5	593.8	587.2	583.5	579.8
120°	645.1	655.3	645.1	645.1	640.8
122.5°	701.0	714.0	707.5	703.8	701.0
125°	759.8	771.4	767.7	763.5	762.1
127.5°	817.2	831.6	826.5	820.9	817.2
130°	870.8	887.6	885.3	882.5	877.3
132.5°	931.0	944.0	944.9	938.4	934.7
135°	982.8	997.2	1000.0	998.6	994.8
137.5°	1040.6	1052.2	1054.6	1053.6	1048.1
140°	1091.4	1103.1	1109.6	1109.6	1104.5
142.5°	1143.6	1155.3	1159.0	1160.4	1155.3
145°	1193.1	1202.4	1209.9	1211.3	1206.2
147.5°	1237.4	1249.0	1254.7	1256.9	1251.8
150°	1283.1	1291.0	1296.2	1300.3	1296.2
152.5°	1323.6	1331.6	1338.1	1343.3	1338.1
155°	1364.2	1368.0	1372.1	1378.8	1374.5
157.5°	1399.2	1402.1	1404.4	1413.7	1407.2
160°	1430.5	1433.3	1434.7	1442.6	1437.0
162.5°	1459.4	1459.4	1460.8	1469.7	1463.1
165°	1484.1	1482.7	1482.7	1492.1	1485.6
167.5°	1506.5	1502.4	1502.4	1511.6	1505.1
170°	1523.3	1519.6	1518.2	1527.5	1519.6
172.5°	1535.0	1531.2	1529.8	1539.1	1531.2
175°	1544.3	1540.6	1537.7	1547.1	1539.1
177.5°	1549.4	1545.7	1542.9	1550.8	1542.9
180°	1547.1	1547.1	1547.1	1547.1	1547.1

TEST NUMBER: P917937

CATALOG NUMBER: DFN2DIP-TR2F0-030D060US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.04	9.36	10.11	11.57	7.87	8.62	8.94	9.69	11.15
	3H	9.92	10.59	11.00	11.67	13.15	9.46	10.13	10.54	11.21	12.69
	4H	10.49	11.12	11.58	12.21	13.69	10.03	10.66	11.12	11.75	13.23
	6H	10.86	11.45	11.96	12.53	14.03	10.40	10.99	11.50	12.07	13.57
	8H	10.96	11.51	12.06	12.61	14.10	10.50	11.06	11.60	12.16	13.64
	12H	10.99	11.52	12.10	12.62	14.13	10.53	11.06	11.64	12.15	13.67
4H	2H	8.73	9.37	9.83	10.45	11.93	8.39	9.03	9.49	10.11	11.59
	3H	10.56	11.09	11.66	12.20	13.69	10.18	10.71	11.28	11.82	13.31
	4H	11.25	11.74	12.36	12.84	14.35	10.86	11.34	11.97	12.44	13.96
	6H	11.74	12.16	12.85	13.28	14.79	11.34	11.76	12.46	12.88	14.39
	8H	11.87	12.26	12.99	13.38	14.90	11.48	11.87	12.59	12.98	14.50
	12H	11.93	12.28	13.06	13.41	14.94	11.52	11.88	12.66	13.00	14.53
8H	4H	11.43	11.82	12.54	12.93	14.46	11.08	11.47	12.19	12.58	14.11
	6H	12.03	12.35	13.16	13.51	15.03	11.68	12.00	12.81	13.15	14.68
	8H	12.23	12.51	13.37	13.65	15.19	11.87	12.16	13.02	13.29	14.83
	12H	12.34	12.59	13.49	13.72	15.30	11.97	12.22	13.12	13.35	14.93
12H	4H	11.41	11.76	12.54	12.89	14.42	11.06	11.42	12.20	12.54	14.07
	6H	12.05	12.33	13.19	13.47	15.01	11.71	11.99	12.85	13.13	14.67
	8H	12.27	12.52	13.42	13.65	15.23	11.92	12.17	13.07	13.30	14.88

END OF REPORT