

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917953

Luminaire Tested: DFN2DIP-TR2F0-040D050US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917953
REPORT IS A COMBINATION OF REPORTS P901775 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-040D050US930-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6836.3 lumens
Efficiency: N/A
Efficacy: 91.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 74.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLLONL

Luminous Intensity Polar Plot

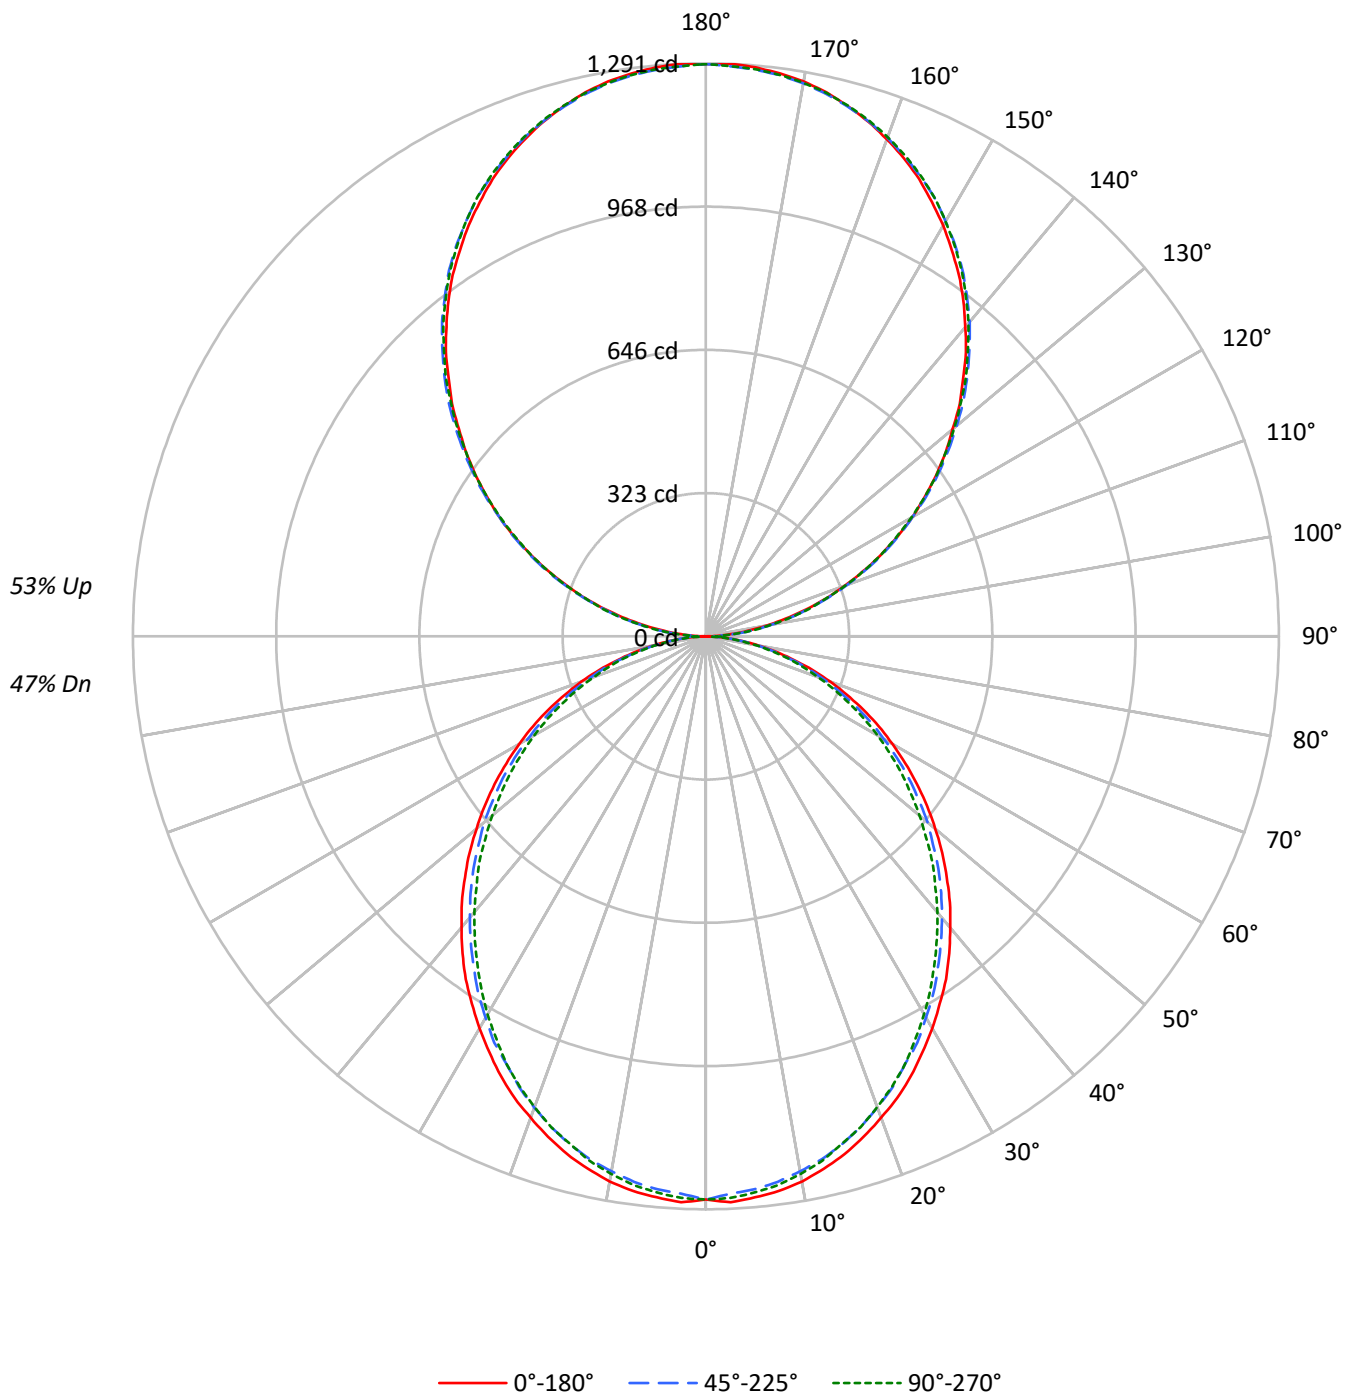

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	35	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	33	29	30	27	24
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	35	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2830	2830	2830
5°	2831	2785	2805
10°	2804	2741	2762
15°	2758	2689	2698
20°	2698	2620	2632
25°	2638	2539	2557
30°	2565	2463	2463
35°	2494	2375	2364
40°	2408	2285	2270
45°	2323	2194	2172
50°	2229	2100	2060
55°	2130	1990	1956
60°	2018	1861	1837
65°	1896	1726	1696
70°	1739	1561	1544
75°	1525	1364	1396
80°	1265	1112	1129
85°	862	701	701

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2323 cd/sqm

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.4	1.7
10°-20°	336.0	4.9
20°-30°	493.8	7.2
30°-40°	573.6	8.4
40°-50°	572.9	8.4
50°-60°	499.5	7.3
60°-70°	369.3	5.4
70°-80°	208.9	3.1
80°-90°	58.8	0.9
90°-100°	79.8	1.2
100°-110°	253.5	3.7
110°-120°	433.8	6.3
120°-130°	570.5	8.3
130°-140°	640.4	9.4
140°-150°	627.9	9.2
150°-160°	526.8	7.7
160°-170°	349.3	5.1
170°-180°	122.1	1.8
0°-30°	949.3	13.9
0°-40°	1522.9	22.3
0°-60°	2595.3	38.0
0°-90°	3232.2	47.3
90°-120°	767.0	11.2
90°-150°	2605.8	38.1
90°-180°	3604.0	52.7
0°-180°	6836.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1269	1269	1269	1269	1269	
5°	1269	1264	1251	1260	1258	120
15°	1208	1201	1185	1190	1184	340
25°	1093	1084	1063	1065	1063	503
35°	943	931	912	904	898	589
45°	768	759	741	727	722	592
55°	581	574	559	544	538	519
65°	392	384	372	361	355	387
75°	205	203	196	189	192	219
85°	50	49	48	44	43	56
90°	1	14	38	36	37	7
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1268.9	1268.9	1268.9	1268.9	1268.9
2.5°	1276.3	1270.2	1256.8	1268.9	1266.6
5°	1268.9	1264.1	1250.7	1260.4	1258.1
7.5°	1260.4	1253.1	1239.7	1249.5	1247.1
10°	1247.1	1238.5	1223.9	1233.6	1230.0
12.5°	1228.7	1221.4	1206.8	1212.9	1210.4
15°	1207.9	1200.7	1184.8	1189.7	1183.6
17.5°	1182.3	1175.1	1159.2	1165.2	1159.2
20°	1154.2	1147.0	1129.9	1133.5	1128.8
22.5°	1126.3	1115.2	1099.3	1099.3	1096.9
25°	1093.2	1083.5	1062.8	1065.2	1062.8
27.5°	1056.6	1048.1	1032.3	1028.7	1022.6
30°	1020.1	1010.3	992.1	988.4	983.5
32.5°	981.0	973.8	954.2	946.9	941.9
35°	943.2	931.1	911.5	904.2	898.1
37.5°	900.5	889.5	869.9	861.4	855.3
40°	856.6	846.8	827.2	816.4	811.5
42.5°	813.9	804.0	784.6	772.3	765.1
45°	767.5	759.0	740.6	727.3	722.4
47.5°	722.4	713.8	694.3	680.9	673.6
50°	674.7	668.6	651.6	634.5	628.4
52.5°	628.4	619.9	604.1	590.6	582.0
55°	580.9	573.5	558.9	544.2	538.2
57.5°	533.2	527.2	511.2	496.6	491.7
60°	485.6	480.8	463.7	450.3	446.6
62.5°	439.3	430.7	418.6	406.3	401.5
65°	391.8	384.3	372.2	361.2	355.1
67.5°	342.9	336.7	325.9	317.3	312.4
70°	297.7	292.9	281.8	273.3	268.5
72.5°	251.4	246.5	240.4	231.9	228.2
75°	205.0	202.6	196.4	189.1	191.6
77.5°	163.5	158.6	156.1	152.5	148.9
80°	122.1	120.7	118.3	114.7	112.3
82.5°	83.0	83.0	81.9	76.9	76.9
85°	50.0	48.8	47.6	43.9	42.7
87.5°	22.0	19.6	17.1	13.5	12.1
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2

TEST NUMBER: P917953

CATALOG NUMBER: DFN2DIP-TR2F0-040D050US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.50	11.34	11.48	12.33	13.64	10.08	10.91	11.06	11.91	13.22
	3H	12.13	12.89	13.13	13.89	15.22	11.67	12.42	12.66	13.43	14.76
	4H	12.71	13.42	13.71	14.42	15.76	12.25	12.96	13.25	13.96	15.30
	6H	13.09	13.74	14.10	14.75	16.10	12.63	13.28	13.64	14.29	15.64
	8H	13.18	13.80	14.20	14.83	16.18	12.72	13.35	13.74	14.37	15.72
	12H	13.22	13.81	14.25	14.83	16.21	12.76	13.35	13.78	14.37	15.74
4H	2H	10.95	11.66	11.96	12.67	14.01	10.61	11.32	11.62	12.33	13.67
	3H	12.79	13.38	13.80	14.41	15.77	12.40	12.99	13.42	14.03	15.38
	4H	13.48	14.02	14.51	15.05	16.43	13.09	13.63	14.11	14.66	16.03
	6H	13.97	14.44	15.01	15.49	16.86	13.58	14.04	14.61	15.09	16.46
	8H	14.11	14.55	15.15	15.59	16.98	13.71	14.15	14.75	15.19	16.58
	12H	14.17	14.57	15.23	15.62	17.01	13.76	14.16	14.82	15.22	16.61
8H	4H	13.66	14.10	14.70	15.14	16.53	13.31	13.75	14.35	14.79	16.18
	6H	14.27	14.63	15.33	15.71	17.10	13.91	14.28	14.98	15.36	16.74
	8H	14.47	14.79	15.54	15.86	17.26	14.12	14.43	15.18	15.50	16.91
	12H	14.59	14.87	15.66	15.93	17.38	14.22	14.50	15.29	15.56	17.01
12H	4H	13.65	14.04	14.70	15.10	16.49	13.30	13.70	14.36	14.75	16.15
	6H	14.29	14.61	15.36	15.68	17.08	13.95	14.27	15.02	15.34	16.74
	8H	14.52	14.79	15.59	15.86	17.30	14.17	14.45	15.24	15.51	16.96

END OF REPORT