

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917995

Luminaire Tested: DFN2DIP-TR2F0-060D050US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917995
REPORT IS A COMBINATION OF REPORTS P901780 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D050US930-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7765.7 lumens
Efficiency: N/A
Efficacy: 79.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 97.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLLONL

Luminous Intensity Polar Plot

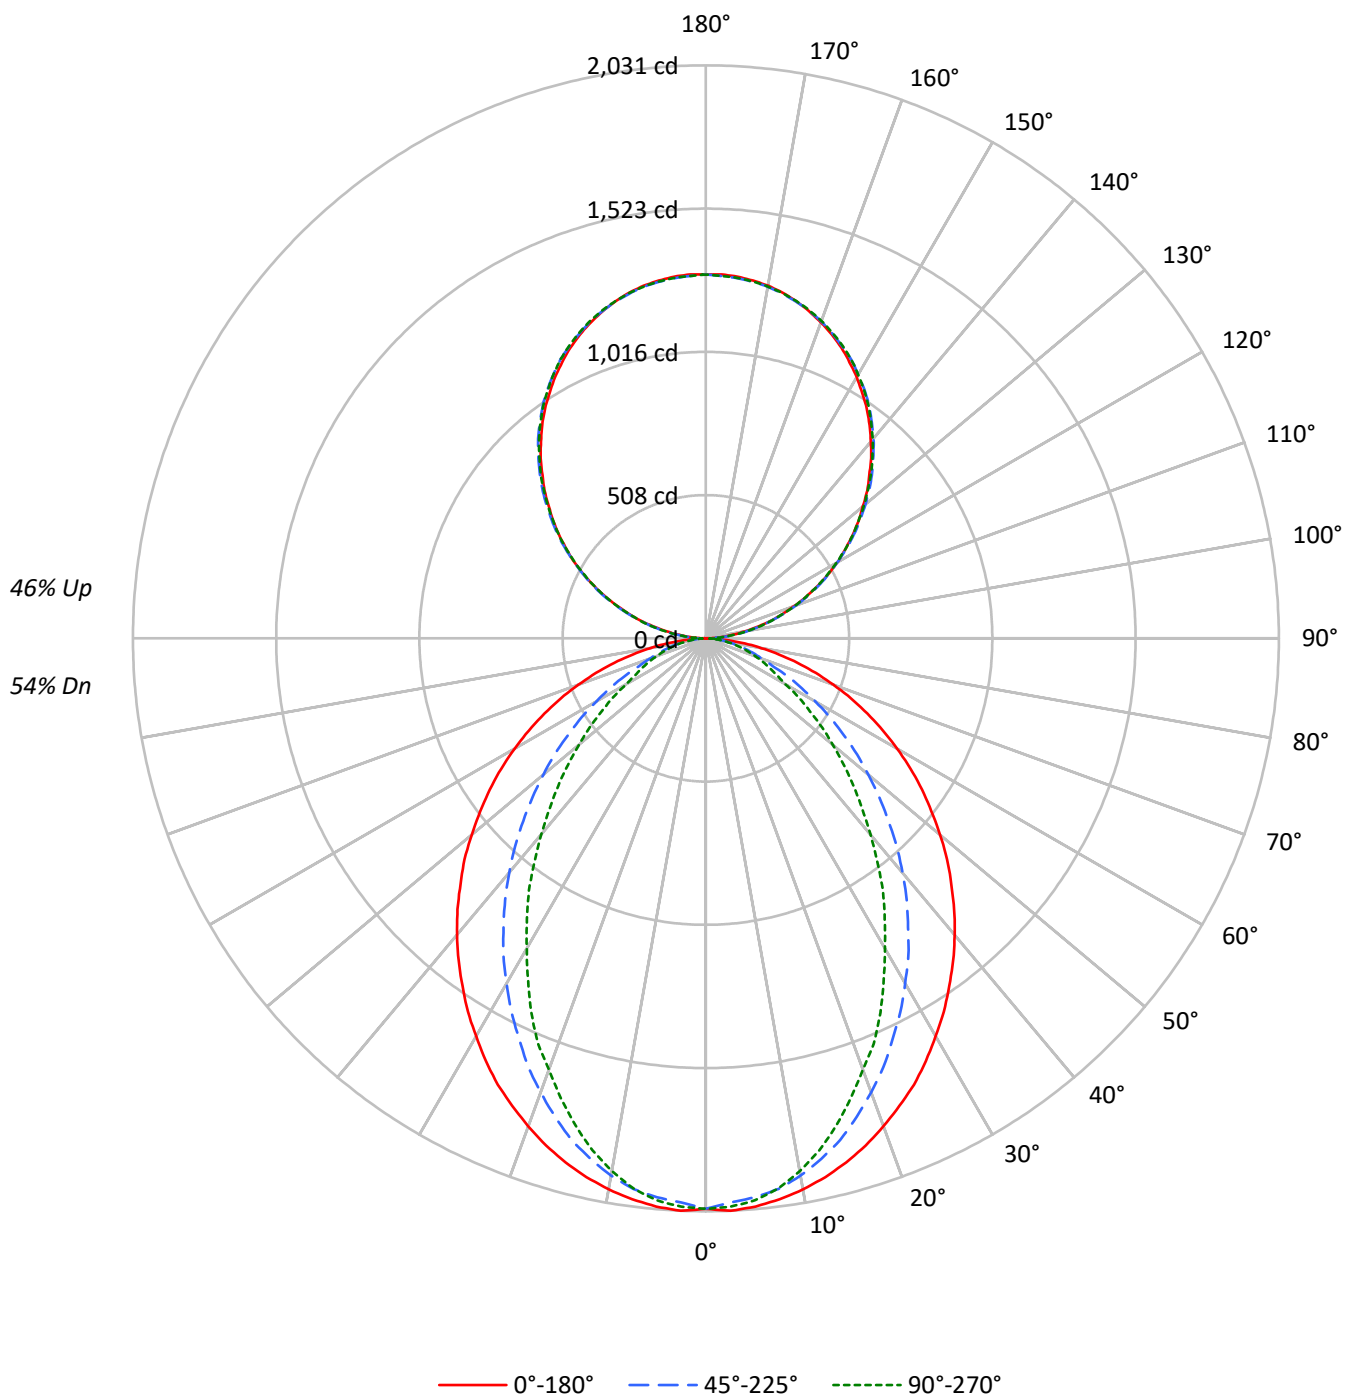

TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	43	40	38
4	76	66	58	52	71	61	55	49	53	48	44	46	42	38	38	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	29	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4509	4509	4509
5°	4510	4428	4458
10°	4459	4331	4306
15°	4391	4178	4074
20°	4302	3971	3793
25°	4213	3742	3522
30°	4094	3507	3180
35°	3977	3256	2880
40°	3858	2997	2538
45°	3721	2711	2228
50°	3578	2423	1926
55°	3428	2117	1636
60°	3255	1799	1339
65°	3054	1476	1197
70°	2811	1175	1072
75°	2505	1016	960
80°	2064	825	810
85°	1355	511	570

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3721 cd/sqm

TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	2.4
10°-20°	520.2	6.7
20°-30°	730.3	9.4
30°-40°	796.1	10.3
40°-50°	731.7	9.4
50°-60°	574.6	7.4
60°-70°	374.0	4.8
70°-80°	192.5	2.5
80°-90°	52.8	0.7
90°-100°	79.8	1.0
100°-110°	253.5	3.3
110°-120°	433.8	5.6
120°-130°	570.5	7.3
130°-140°	640.4	8.2
140°-150°	627.9	8.1
150°-160°	526.8	6.8
160°-170°	349.3	4.5
170°-180°	122.1	1.6
0°-30°	1439.9	18.5
0°-40°	2236.0	28.8
0°-60°	3542.3	45.6
0°-90°	4161.7	53.6
90°-120°	767.0	9.9
90°-150°	2605.8	33.6
90°-180°	3604.0	46.4
0°-180°	7765.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	1	14	38	36	37	8
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0



TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2

TEST NUMBER: P917995

CATALOG NUMBER: DFN2DIP-TR2F0-060D050US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.58	13.44	13.51	14.38	15.61	8.56	9.42	9.49	10.37	11.59
	3H	14.24	15.00	15.18	15.96	17.20	9.74	10.51	10.68	11.46	12.71
	4H	14.83	15.56	15.79	16.52	17.77	10.18	10.90	11.14	11.86	13.12
	6H	15.23	15.90	16.20	16.87	18.13	10.49	11.16	11.46	12.12	13.39
	8H	15.35	15.99	16.33	16.97	18.23	10.57	11.21	11.55	12.19	13.45
	12H	15.40	16.01	16.38	16.98	18.27	10.61	11.21	11.59	12.19	13.48
4H	2H	12.60	13.32	13.56	14.28	15.54	9.15	9.88	10.11	10.83	12.09
	3H	14.40	15.01	15.38	16.00	17.26	10.48	11.09	11.46	12.08	13.34
	4H	15.08	15.63	16.06	16.61	17.90	11.02	11.57	12.00	12.55	13.84
	6H	15.57	16.05	16.57	17.05	18.34	11.42	11.90	12.42	12.90	14.19
	8H	15.73	16.18	16.73	17.18	18.48	11.54	11.98	12.54	12.98	14.29
	12H	15.82	16.22	16.83	17.23	18.54	11.60	12.00	12.61	13.01	14.32
8H	4H	15.04	15.49	16.04	16.49	17.79	11.29	11.73	12.28	12.73	14.03
	6H	15.59	15.95	16.61	16.99	18.30	11.78	12.15	12.80	13.19	14.49
	8H	15.79	16.11	16.82	17.14	18.46	11.96	12.28	12.99	13.31	14.63
	12H	15.91	16.19	16.94	17.22	18.58	12.07	12.35	13.10	13.37	14.74
12H	4H	15.00	15.40	16.01	16.41	17.72	11.29	11.69	12.30	12.70	14.01
	6H	15.56	15.88	16.59	16.91	18.23	11.83	12.15	12.86	13.18	14.50
	8H	15.76	16.05	16.80	17.07	18.44	12.02	12.31	13.06	13.33	14.70