

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920652

Luminaire Tested: DFN2DIP-TR2F0-030D030US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920652
REPORT IS A COMBINATION OF REPORTS P900233 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D030US935-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4843.1 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 47
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

Luminous Intensity Polar Plot

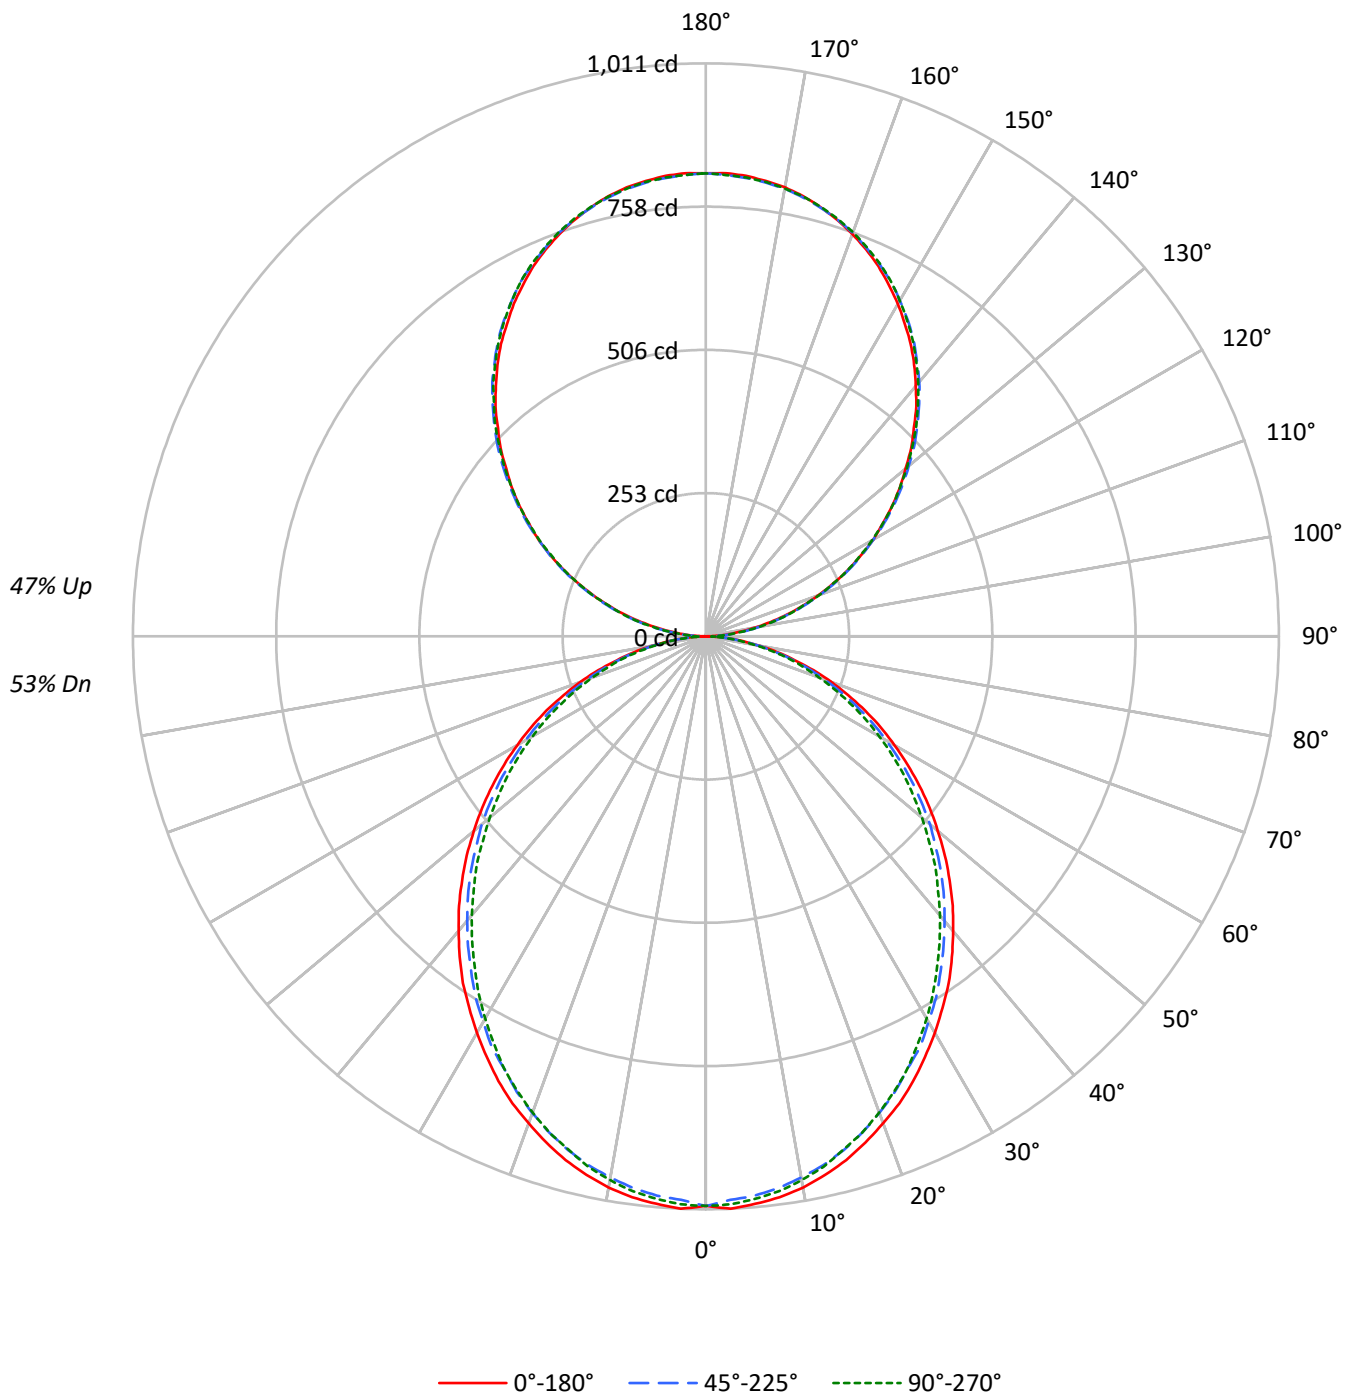

TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2242	2242	2242
5°	2242	2205	2221
10°	2220	2171	2188
15°	2184	2130	2137
20°	2137	2075	2085
25°	2090	2011	2025
30°	2031	1951	1951
35°	1976	1881	1873
40°	1908	1810	1798
45°	1840	1738	1720
50°	1765	1663	1632
55°	1687	1576	1549
60°	1598	1474	1455
65°	1501	1367	1344
70°	1377	1237	1223
75°	1208	1081	1106
80°	1001	881	894
85°	683	555	555

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1840 cd/sqm

TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	94.6	2.0
10°-20°	266.2	5.5
20°-30°	391.1	8.1
30°-40°	454.3	9.4
40°-50°	453.7	9.4
50°-60°	395.6	8.2
60°-70°	292.5	6.0
70°-80°	165.5	3.4
80°-90°	46.0	0.9
90°-100°	50.6	1.0
100°-110°	160.6	3.3
110°-120°	274.9	5.7
120°-130°	361.5	7.5
130°-140°	405.7	8.4
140°-150°	397.9	8.2
150°-160°	333.8	6.9
160°-170°	221.3	4.6
170°-180°	77.4	1.6
0°-30°	751.9	15.5
0°-40°	1206.2	24.9
0°-60°	2055.6	42.4
0°-90°	2559.5	52.8
90°-120°	486.0	10.0
90°-150°	1651.1	34.1
90°-180°	2284.0	47.2
0°-180°	4843.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1005	1005	1005	1005	1005	
5°	1005	1001	991	998	996	95
15°	957	951	938	942	938	269
25°	866	858	842	844	842	398
35°	747	737	722	716	711	467
45°	608	601	587	576	572	469
55°	460	454	443	431	426	411
65°	310	304	295	286	281	307
75°	162	160	156	150	152	173
85°	40	39	38	35	34	44
90°	1	9	24	23	23	5
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	

TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1005.0	1005.0	1005.0	1005.0	1005.0
2.5°	1010.9	1006.1	995.4	1005.0	1003.2
5°	1005.0	1001.3	990.6	998.3	996.4
7.5°	998.3	992.6	981.9	989.7	987.7
10°	987.7	980.9	969.4	977.1	974.2
12.5°	973.2	967.4	955.9	960.6	958.7
15°	956.7	951.1	938.4	942.3	937.5
17.5°	936.4	930.7	918.1	922.9	918.1
20°	914.2	908.4	894.9	897.8	894.0
22.5°	892.1	883.4	870.7	870.7	868.7
25°	865.9	858.2	841.8	843.7	841.8
27.5°	836.9	830.1	817.6	814.8	809.9
30°	808.0	800.2	785.7	782.8	778.9
32.5°	777.1	771.3	755.8	749.9	746.1
35°	747.1	737.4	721.9	716.1	711.3
37.5°	713.3	704.6	689.1	682.3	677.4
40°	678.5	670.7	655.2	646.6	642.7
42.5°	644.6	636.9	621.5	611.7	606.0
45°	608.0	601.1	586.6	576.0	572.1
47.5°	572.1	565.4	549.9	539.2	533.5
50°	534.4	529.6	516.1	502.6	497.7
52.5°	497.7	490.9	478.5	467.8	461.0
55°	460.1	454.3	442.6	431.1	426.3
57.5°	422.3	417.5	404.9	393.3	389.4
60°	384.6	380.8	367.3	356.6	353.8
62.5°	347.9	341.1	331.5	321.8	318.0
65°	310.3	304.4	294.8	286.1	281.3
67.5°	271.6	266.7	258.0	251.3	247.5
70°	235.8	232.0	223.3	216.5	212.7
72.5°	199.1	195.2	190.4	183.7	180.8
75°	162.3	160.5	155.6	149.8	151.8
77.5°	129.5	125.6	123.6	120.8	118.0
80°	96.7	95.7	93.7	90.8	88.9
82.5°	65.7	65.7	64.8	60.9	60.9
85°	39.6	38.7	37.7	34.8	33.8
87.5°	17.4	15.5	13.5	10.7	9.6
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3



TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P920652

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.21	11.09	11.14	12.04	13.27	9.78	10.67	10.71	11.62	12.85
	3H	11.84	12.64	12.79	13.60	14.85	11.38	12.18	12.33	13.14	14.39
	4H	12.42	13.17	13.38	14.13	15.40	11.96	12.71	12.92	13.68	14.94
	6H	12.80	13.50	13.77	14.46	15.74	12.34	13.04	13.31	14.00	15.28
	8H	12.90	13.56	13.87	14.54	15.82	12.44	13.10	13.42	14.09	15.36
	12H	12.94	13.57	13.92	14.55	15.84	12.48	13.10	13.46	14.08	15.38
4H	2H	10.66	11.41	11.63	12.38	13.64	10.32	11.08	11.29	12.04	13.30
	3H	12.50	13.13	13.48	14.12	15.40	12.12	12.75	13.09	13.74	15.02
	4H	13.20	13.77	14.18	14.76	16.06	12.81	13.38	13.79	14.37	15.67
	6H	13.69	14.19	14.69	15.20	16.50	13.30	13.79	14.29	14.80	16.10
	8H	13.83	14.30	14.83	15.30	16.61	13.44	13.90	14.43	14.90	16.22
	12H	13.90	14.31	14.91	15.33	16.65	13.49	13.91	14.51	14.93	16.25
8H	4H	13.39	13.85	14.38	14.85	16.17	13.04	13.50	14.03	14.50	15.82
	6H	13.99	14.38	15.01	15.42	16.73	13.64	14.02	14.66	15.07	16.38
	8H	14.20	14.54	15.23	15.57	16.90	13.84	14.18	14.87	15.21	16.54
	12H	14.32	14.61	15.35	15.64	17.01	13.95	14.24	14.98	15.27	16.64
12H	4H	13.37	13.79	14.39	14.81	16.13	13.03	13.45	14.04	14.47	15.78
	6H	14.02	14.36	15.05	15.39	16.72	13.68	14.01	14.71	15.05	16.38
	8H	14.24	14.54	15.28	15.57	16.94	13.90	14.20	14.93	15.22	16.60

END OF REPORT