

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920694

Luminaire Tested: DFN2DIP-TR2F0-050D030US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920694
REPORT IS A COMBINATION OF REPORTS P900238 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D030US935-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5945.2 lumens
Efficiency: N/A
Efficacy: 85.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 69.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

Luminous Intensity Polar Plot

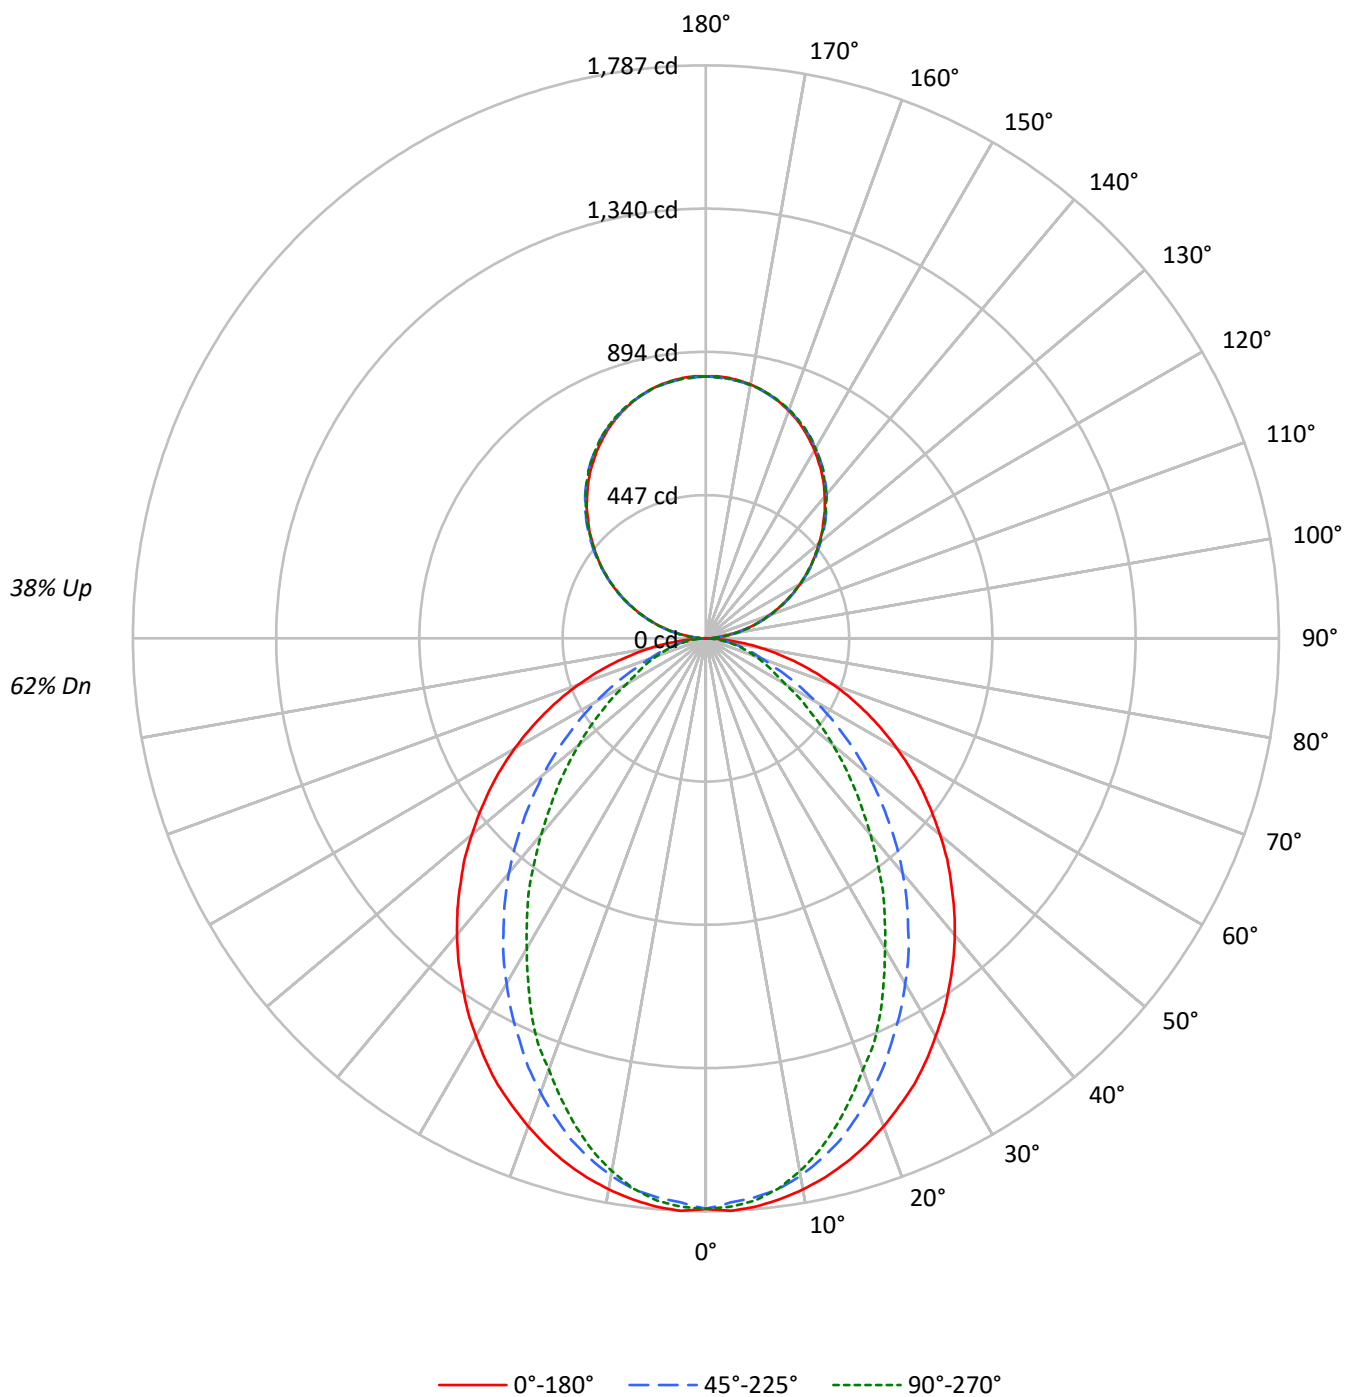

TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	101	97	93	90	94	91	88	85	80	77	75	69	68	66	60	59	58
2	92	85	79	74	86	80	75	70	71	67	63	62	59	56	53	51	49
3	85	75	68	63	79	71	65	60	63	58	54	55	51	48	48	45	43
4	78	67	60	54	73	63	57	51	56	51	46	49	45	42	43	40	37
5	72	60	52	46	67	57	50	44	51	45	41	45	40	37	39	36	33
6	66	54	46	41	62	51	44	39	46	40	36	41	36	32	36	32	29
7	62	49	42	36	58	47	40	35	42	36	32	37	33	29	33	29	26
8	57	45	37	32	54	43	36	31	38	33	28	34	30	26	30	27	24
9	53	41	34	29	50	39	32	28	35	30	26	32	27	24	28	24	22
10	50	38	31	26	47	36	30	25	33	27	23	29	25	22	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3969	3969	3969
5°	3969	3897	3924
10°	3924	3811	3789
15°	3864	3677	3586
20°	3787	3495	3338
25°	3707	3293	3099
30°	3603	3086	2799
35°	3500	2865	2535
40°	3395	2637	2234
45°	3275	2386	1961
50°	3149	2132	1695
55°	3017	1863	1440
60°	2864	1582	1179
65°	2688	1299	1054
70°	2474	1035	944
75°	2205	894	845
80°	1818	726	713
85°	1193	451	502

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3275 cd/sqm

TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.8	2.8
10°-20°	457.8	7.7
20°-30°	642.7	10.8
30°-40°	700.6	11.8
40°-50°	643.9	10.8
50°-60°	505.7	8.5
60°-70°	329.2	5.5
70°-80°	169.5	2.9
80°-90°	45.6	0.8
90°-100°	50.6	0.9
100°-110°	160.6	2.7
110°-120°	274.9	4.6
120°-130°	361.5	6.1
130°-140°	405.7	6.8
140°-150°	397.9	6.7
150°-160°	333.8	5.6
160°-170°	221.3	3.7
170°-180°	77.4	1.3
0°-30°	1267.2	21.3
0°-40°	1967.8	33.1
0°-60°	3117.4	52.4
0°-90°	3661.6	61.6
90°-120°	486.0	8.2
90°-150°	1651.1	27.8
90°-180°	2284.0	38.4
0°-180°	5945.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1779	1779	1779	1779	1779	
5°	1779	1771	1750	1765	1760	169
15°	1692	1675	1620	1589	1573	477
25°	1536	1484	1378	1312	1288	706
35°	1324	1242	1100	998	963	828
45°	1082	974	805	691	652	836
55°	823	697	523	427	396	735
65°	556	425	280	226	221	551
75°	296	184	129	118	116	313
85°	69	35	31	31	31	79
90°	1	9	24	23	23	6
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	

TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1779.3	1779.3	1779.3	1779.3	1779.3
2.5°	1787.3	1779.3	1761.5	1777.7	1774.4
5°	1779.3	1771.2	1750.2	1764.7	1760.0
7.5°	1764.7	1755.1	1732.6	1739.0	1730.9
10°	1745.4	1734.1	1702.0	1697.1	1687.5
12.5°	1721.3	1706.8	1663.3	1653.7	1635.9
15°	1692.3	1674.6	1619.9	1589.3	1573.2
17.5°	1658.5	1632.7	1565.0	1529.6	1503.8
20°	1619.9	1587.6	1507.1	1467.0	1431.4
22.5°	1578.0	1540.9	1447.5	1392.8	1368.7
25°	1536.1	1484.5	1378.3	1312.3	1288.1
27.5°	1486.3	1431.4	1313.9	1238.2	1201.2
30°	1433.1	1371.8	1243.0	1161.0	1117.4
32.5°	1381.6	1307.4	1175.5	1078.8	1038.5
35°	1323.6	1241.5	1099.8	998.3	962.9
37.5°	1267.2	1178.6	1029.0	917.7	877.6
40°	1207.6	1111.1	954.8	840.5	798.7
42.5°	1146.5	1043.4	880.8	761.6	721.4
45°	1082.1	974.1	805.1	690.7	652.0
47.5°	1020.9	906.6	732.7	618.3	582.9
50°	953.3	839.0	661.8	550.6	516.9
52.5°	887.2	766.4	594.2	487.9	457.4
55°	822.8	697.1	523.2	426.7	396.1
57.5°	756.8	628.0	460.5	370.4	344.6
60°	689.1	560.3	394.4	312.5	286.6
62.5°	623.2	494.4	338.1	260.9	248.1
65°	555.5	425.1	280.2	225.5	220.6
67.5°	491.1	360.7	225.5	198.0	193.2
70°	423.5	297.9	186.8	170.6	164.2
72.5°	359.1	239.9	156.2	143.4	140.1
75°	296.3	183.5	128.8	117.5	116.0
77.5°	233.5	130.4	101.5	95.0	91.7
80°	175.5	93.4	77.2	70.9	70.9
82.5°	122.3	62.9	53.1	49.9	49.9
85°	69.2	35.4	30.6	30.6	30.6
87.5°	25.8	12.8	12.8	11.3	11.3
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3



TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P920694

CATALOG NUMBER: DFN2DIP-TR2F0-050D030US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.82	13.76	13.68	14.63	15.73	8.81	9.74	9.67	10.62	11.71
	3H	14.49	15.32	15.36	16.21	17.33	9.99	10.82	10.86	11.71	12.83
	4H	15.08	15.87	15.97	16.76	17.90	10.43	11.22	11.32	12.11	13.25
	6H	15.49	16.22	16.39	17.12	18.26	10.74	11.47	11.64	12.37	13.52
	8H	15.61	16.30	16.52	17.22	18.36	10.83	11.52	11.74	12.44	13.58
	12H	15.67	16.32	16.58	17.23	18.40	10.87	11.53	11.78	12.44	13.61
4H	2H	12.85	13.64	13.74	14.53	15.67	9.40	10.19	10.29	11.08	12.22
	3H	14.66	15.32	15.57	16.24	17.39	10.74	11.40	11.65	12.32	13.47
	4H	15.34	15.94	16.26	16.86	18.03	11.28	11.88	12.19	12.80	13.97
	6H	15.84	16.35	16.77	17.30	18.47	11.69	12.20	12.62	13.14	14.32
	8H	16.00	16.48	16.93	17.42	18.61	11.81	12.29	12.74	13.23	14.42
	12H	16.09	16.52	17.04	17.48	18.67	11.87	12.30	12.82	13.26	14.45
8H	4H	15.31	15.79	16.24	16.73	17.92	11.56	12.04	12.49	12.97	14.16
	6H	15.86	16.25	16.81	17.23	18.42	12.06	12.45	13.01	13.43	14.62
	8H	16.06	16.41	17.02	17.38	18.59	12.23	12.58	13.20	13.55	14.76
	12H	16.19	16.49	17.15	17.46	18.71	12.35	12.65	13.31	13.61	14.87
12H	4H	15.27	15.70	16.22	16.66	17.85	11.56	11.99	12.51	12.95	14.14
	6H	15.83	16.18	16.80	17.15	18.36	12.10	12.45	13.06	13.42	14.63
	8H	16.04	16.35	17.01	17.31	18.57	12.30	12.61	13.27	13.57	14.83

END OF REPORT