

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920704

Luminaire Tested: DFN2DIP-TR2F0-050D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920704
REPORT IS A COMBINATION OF REPORTS P900267 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D060US935-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8833.9 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

Luminous Intensity Polar Plot

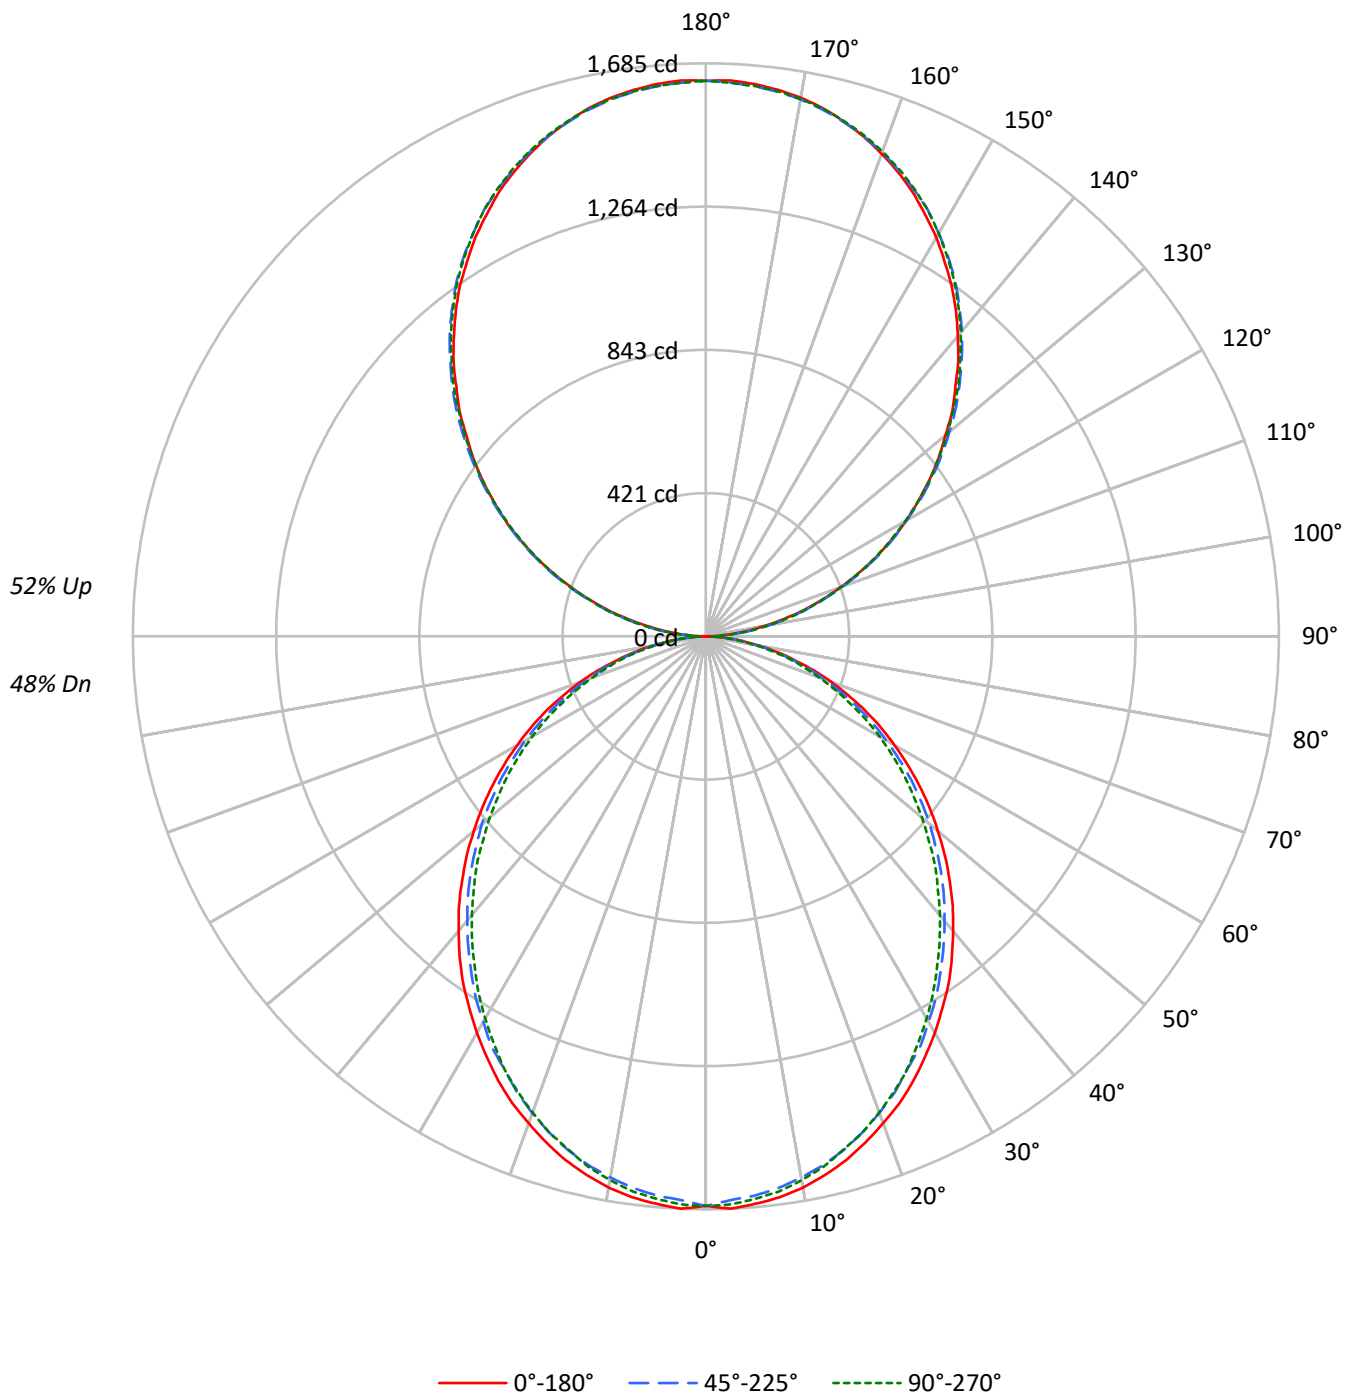

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3736	3736	3736
5°	3737	3676	3703
10°	3701	3618	3646
15°	3641	3550	3561
20°	3562	3459	3475
25°	3483	3352	3376
30°	3385	3252	3252
35°	3293	3134	3121
40°	3179	3016	2996
45°	3066	2897	2868
50°	2942	2771	2720
55°	2812	2627	2582
60°	2664	2456	2425
65°	2502	2278	2239
70°	2296	2061	2038
75°	2013	1800	1844
80°	1669	1469	1490
85°	1138	926	926

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3066 cd/sqm

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.8
10°-20°	443.6	5.0
20°-30°	651.9	7.4
30°-40°	757.2	8.6
40°-50°	756.2	8.6
50°-60°	659.4	7.5
60°-70°	487.4	5.5
70°-80°	275.8	3.1
80°-90°	77.4	0.9
90°-100°	101.1	1.1
100°-110°	321.2	3.6
110°-120°	549.7	6.2
120°-130°	723.0	8.2
130°-140°	811.5	9.2
140°-150°	795.8	9.0
150°-160°	667.5	7.6
160°-170°	442.7	5.0
170°-180°	154.7	1.8
0°-30°	1253.2	14.2
0°-40°	2010.3	22.8
0°-60°	3425.9	38.8
0°-90°	4266.6	48.3
90°-120°	972.0	11.0
90°-150°	3302.3	37.4
90°-180°	4567.0	51.7
0°-180°	8833.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	2	18	48	45	47	9
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P920704

CATALOG NUMBER: DFN2DIP-TR2F0-050D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.56	12.41	12.53	13.39	14.69	11.14	11.98	12.11	12.97	14.27
	3H	13.20	13.96	14.18	14.95	16.27	12.74	13.50	13.72	14.49	15.81
	4H	13.77	14.49	14.76	15.49	16.81	13.31	14.03	14.30	15.03	16.35
	6H	14.15	14.81	15.16	15.81	17.15	13.69	14.35	14.70	15.35	16.69
	8H	14.24	14.87	15.26	15.89	17.23	13.79	14.42	14.80	15.44	16.77
	12H	14.28	14.88	15.30	15.90	17.26	13.82	14.42	14.84	15.43	16.79
4H	2H	12.01	12.73	13.01	13.73	15.05	11.67	12.39	12.68	13.39	14.72
	3H	13.85	14.45	14.86	15.48	16.82	13.47	14.07	14.48	15.09	16.43
	4H	14.54	15.09	15.56	16.11	17.47	14.15	14.70	15.17	15.72	17.08
	6H	15.04	15.51	16.07	16.55	17.91	14.64	15.11	15.67	16.16	17.51
	8H	15.17	15.62	16.20	16.65	18.02	14.78	15.22	15.81	16.25	17.63
	12H	15.24	15.63	16.28	16.69	18.06	14.83	15.23	15.88	16.28	17.66
8H	4H	14.73	15.17	15.76	16.21	17.58	14.38	14.82	15.41	15.86	17.23
	6H	15.33	15.70	16.39	16.77	18.15	14.98	15.35	16.04	16.42	17.79
	8H	15.54	15.86	16.60	16.92	18.31	15.18	15.50	16.24	16.56	17.95
	12H	15.65	15.94	16.72	16.99	18.42	15.28	15.57	16.35	16.62	18.06
12H	4H	14.71	15.11	15.76	16.16	17.54	14.37	14.77	15.42	15.82	17.20
	6H	15.36	15.68	16.42	16.74	18.13	15.02	15.34	16.08	16.40	17.79
	8H	15.58	15.86	16.65	16.92	18.35	15.24	15.52	16.30	16.58	18.01