

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920717

Luminaire Tested: DFN2DIP-TR2F0-060D040US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920717
REPORT IS A COMBINATION OF REPORTS P901769 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D040US935-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8162.3 lumens
Efficiency: N/A
Efficacy: 91.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

Luminous Intensity Polar Plot

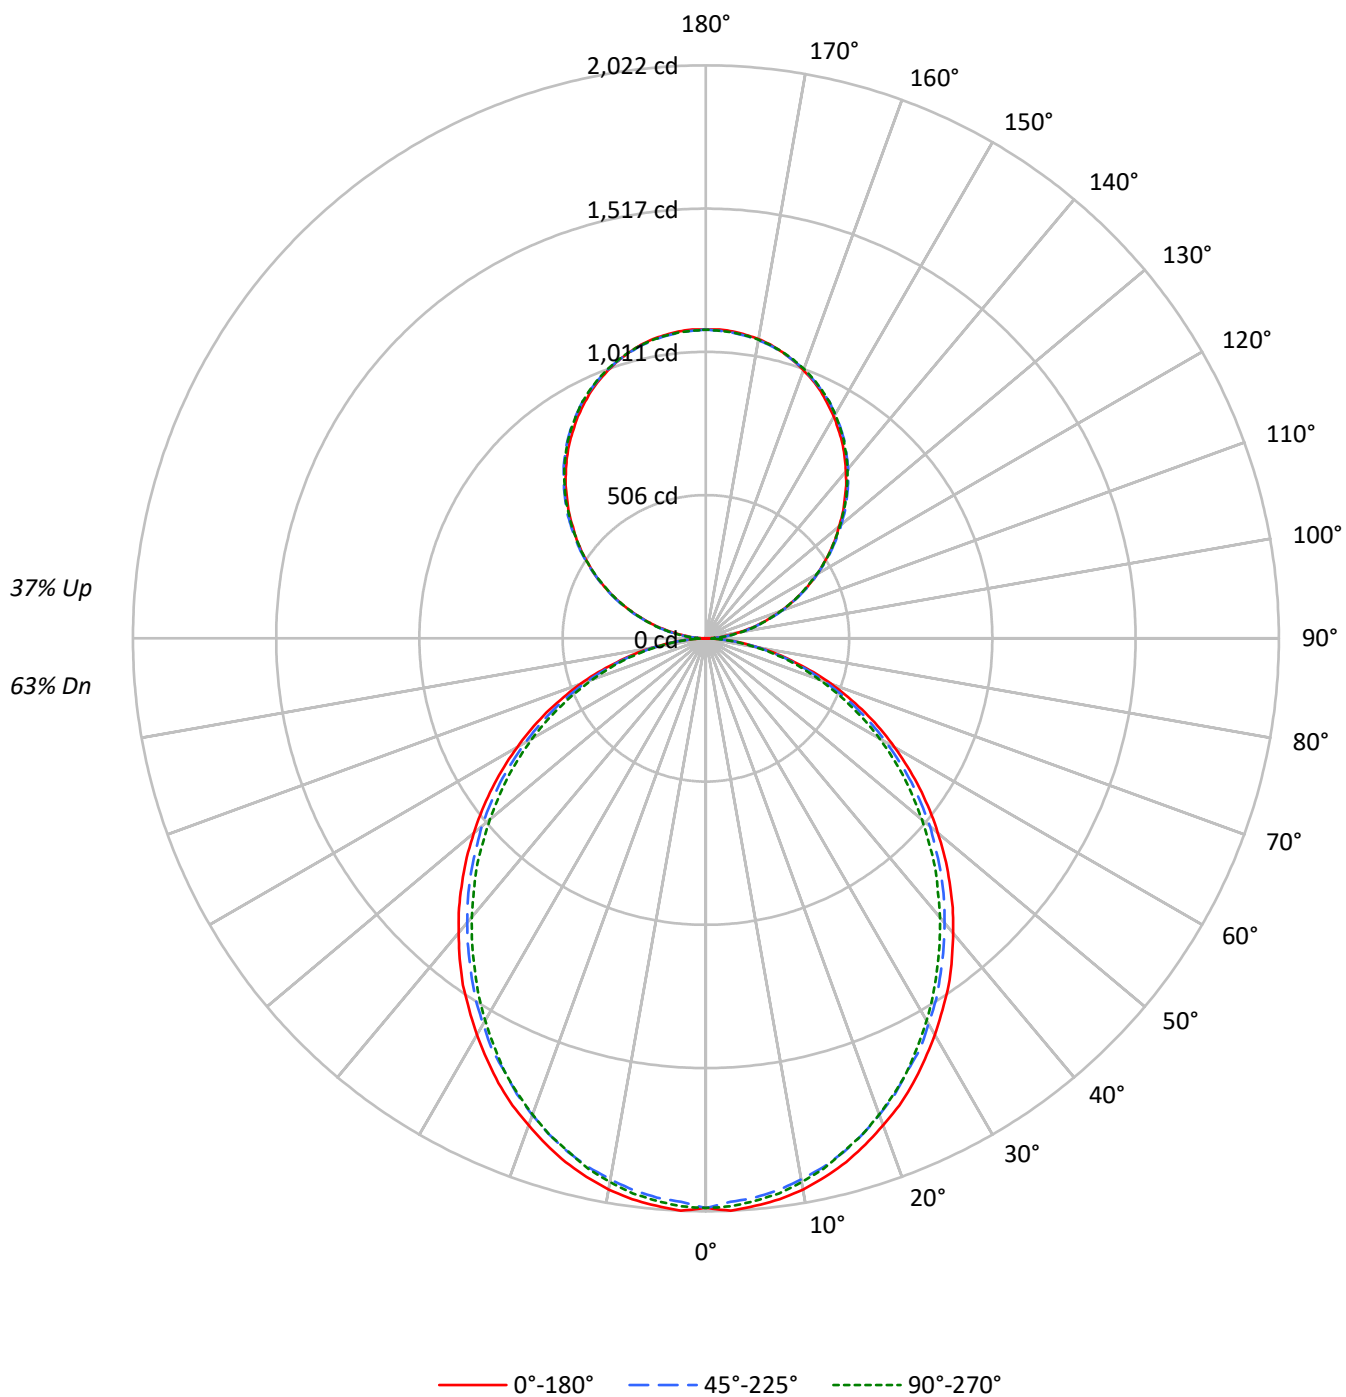

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4483	4483	4483
5°	4484	4411	4443
10°	4441	4341	4375
15°	4369	4260	4274
20°	4274	4151	4170
25°	4179	4022	4051
30°	4063	3902	3902
35°	3951	3762	3745
40°	3815	3619	3595
45°	3679	3476	3441
50°	3530	3326	3264
55°	3374	3152	3099
60°	3197	2947	2910
65°	3002	2733	2687
70°	2755	2473	2445
75°	2415	2161	2212
80°	2003	1762	1788
85°	1364	1110	1111

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3679 cd/sqm

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.3
10°-20°	532.3	6.5
20°-30°	782.3	9.6
30°-40°	908.6	11.1
40°-50°	907.5	11.1
50°-60°	791.3	9.7
60°-70°	584.9	7.2
70°-80°	330.9	4.1
80°-90°	90.4	1.1
90°-100°	67.4	0.8
100°-110°	214.2	2.6
110°-120°	366.5	4.5
120°-130°	482.0	5.9
130°-140°	541.0	6.6
140°-150°	530.5	6.5
150°-160°	445.0	5.5
160°-170°	295.1	3.6
170°-180°	103.2	1.3
0°-30°	1503.8	18.4
0°-40°	2412.4	29.6
0°-60°	4111.1	50.4
0°-90°	5117.4	62.7
90°-120°	648.0	7.9
90°-150°	2201.5	27.0
90°-180°	3045.0	37.3
0°-180°	8162.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	12	32	30	31	8
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P920717

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.45	14.44	14.29	15.30	16.38	13.03	14.02	13.87	14.88	15.96
	3H	15.10	15.98	15.95	16.86	17.96	14.64	15.52	15.49	16.39	17.50
	4H	15.67	16.51	16.54	17.39	18.51	15.21	16.05	16.08	16.93	18.05
	6H	16.06	16.84	16.94	17.72	18.85	15.60	16.38	16.48	17.26	18.39
	8H	16.16	16.90	17.05	17.80	18.93	15.70	16.44	16.59	17.34	18.47
	12H	16.21	16.91	17.10	17.81	18.96	15.74	16.44	16.64	17.34	18.50
4H	2H	13.92	14.76	14.79	15.64	16.75	13.58	14.42	14.45	15.30	16.41
	3H	15.77	16.47	16.65	17.38	18.51	15.38	16.08	16.27	16.99	18.13
	4H	16.47	17.11	17.37	18.01	19.17	16.07	16.71	16.97	17.62	18.78
	6H	16.97	17.52	17.88	18.45	19.61	16.57	17.12	17.48	18.06	19.21
	8H	17.11	17.63	18.02	18.55	19.72	16.71	17.23	17.63	18.15	19.32
	12H	17.18	17.64	18.11	18.59	19.76	16.77	17.24	17.71	18.18	19.36
8H	4H	16.67	17.18	17.58	18.11	19.28	16.31	16.83	17.23	17.75	18.93
	6H	17.27	17.70	18.22	18.67	19.84	16.92	17.35	17.86	18.32	19.49
	8H	17.48	17.86	18.43	18.82	20.00	17.12	17.50	18.07	18.46	19.65
	12H	17.60	17.94	18.56	18.89	20.12	17.23	17.57	18.19	18.52	19.75
12H	4H	16.66	17.12	17.59	18.06	19.24	16.31	16.78	17.24	17.72	18.90
	6H	17.30	17.68	18.25	18.64	19.83	16.96	17.34	17.91	18.29	19.48
	8H	17.53	17.86	18.49	18.81	20.05	17.19	17.52	18.14	18.47	19.71