

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923382

Luminaire Tested: DFN2DIP-TR2F0-030D030US940-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923382
REPORT IS A COMBINATION OF REPORTS P900234 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-030D030US940-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4641.3 lumens
Efficiency: N/A
Efficacy: 98.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 47
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

Luminous Intensity Polar Plot

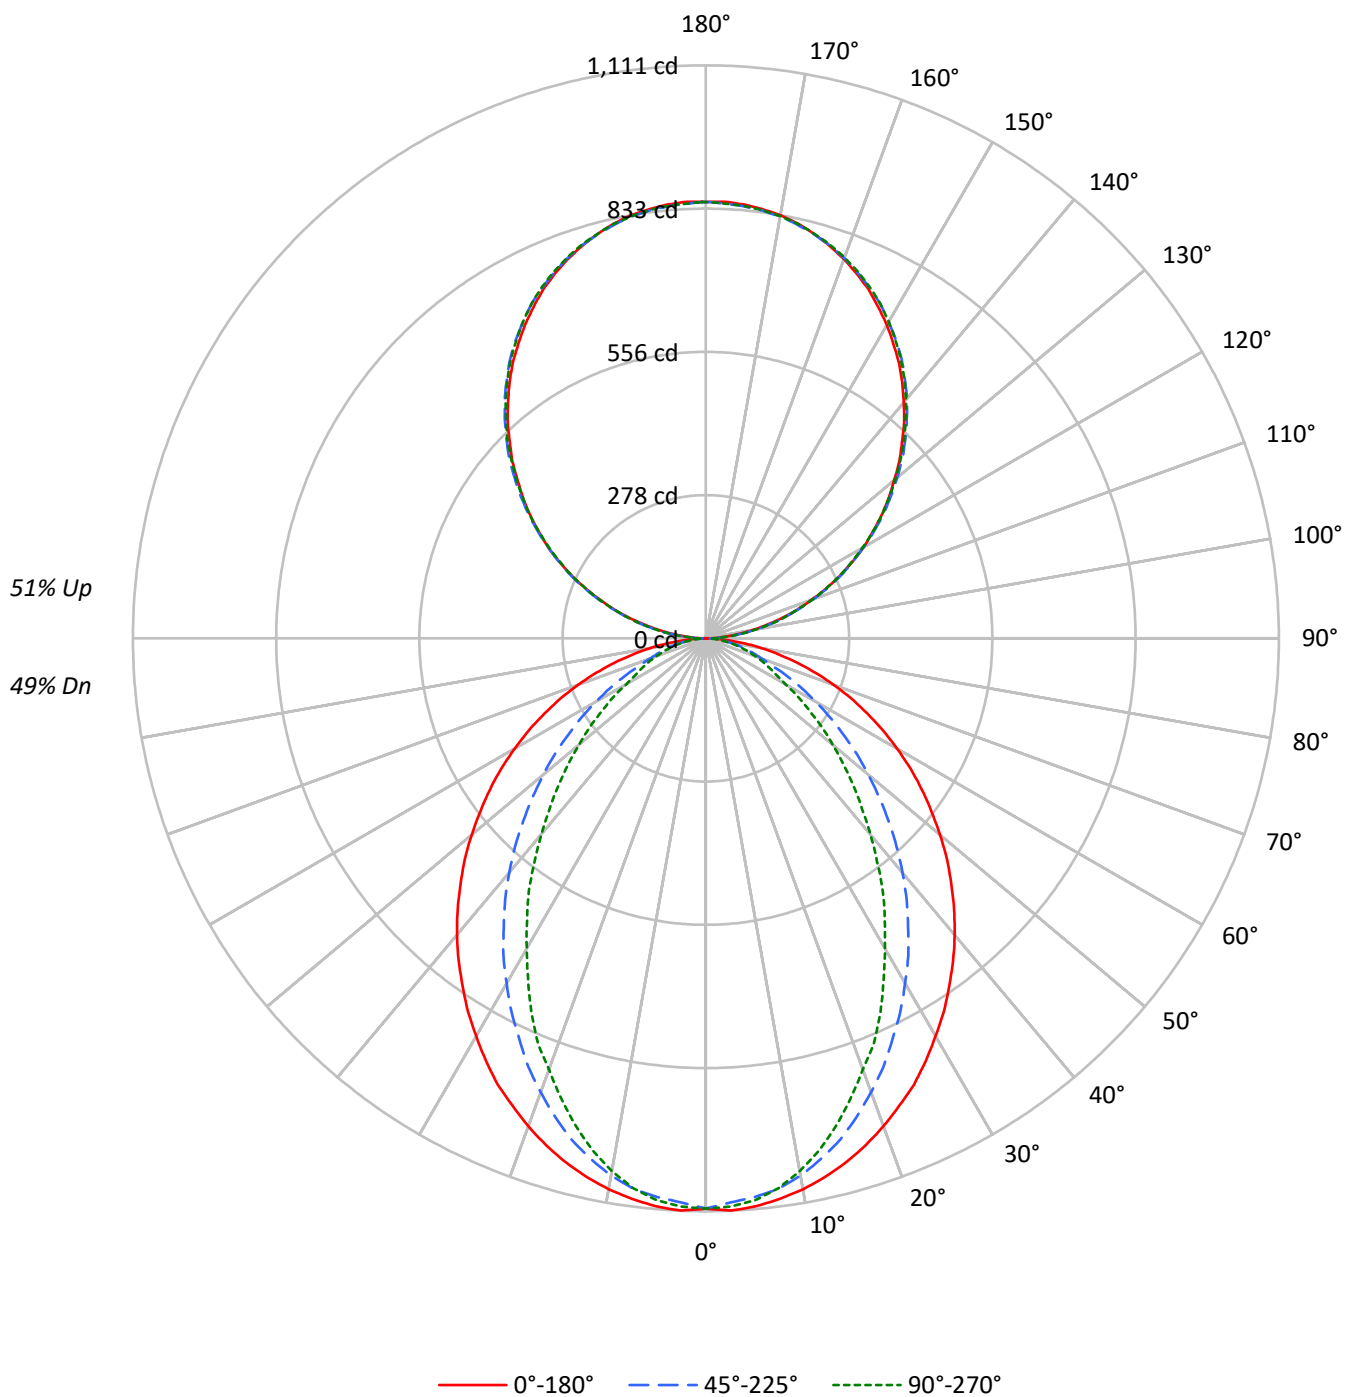

TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2466	2466	2466
5°	2466	2421	2438
10°	2438	2369	2355
15°	2401	2285	2228
20°	2353	2172	2074
25°	2304	2046	1926
30°	2239	1918	1739
35°	2175	1780	1575
40°	2110	1639	1388
45°	2035	1482	1219
50°	1957	1325	1053
55°	1874	1158	895
60°	1780	983	733
65°	1670	807	655
70°	1537	643	586
75°	1369	556	525
80°	1130	451	443
85°	741	280	312

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2035 cd/sqm

TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.6	2.2
10°-20°	284.5	6.1
20°-30°	399.4	8.6
30°-40°	435.3	9.4
40°-50°	400.1	8.6
50°-60°	314.2	6.8
60°-70°	204.5	4.4
70°-80°	105.3	2.3
80°-90°	29.3	0.6
90°-100°	52.3	1.1
100°-110°	166.3	3.6
110°-120°	284.7	6.1
120°-130°	374.4	8.1
130°-140°	420.2	9.1
140°-150°	412.1	8.9
150°-160°	345.7	7.4
160°-170°	229.2	4.9
170°-180°	80.1	1.7
0°-30°	787.5	17.0
0°-40°	1222.8	26.3
0°-60°	1937.2	41.7
0°-90°	2276.3	49.0
90°-120°	503.4	10.8
90°-150°	1710.0	36.8
90°-180°	2365.0	51.0
0°-180°	4641.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1106	1106	1106	1106	1106	
5°	1106	1101	1088	1097	1094	105
15°	1052	1040	1007	988	978	296
25°	955	922	856	816	800	439
35°	822	771	683	620	598	515
45°	672	605	500	429	405	519
55°	511	433	325	265	246	457
65°	345	264	174	140	137	342
75°	184	114	80	73	72	195
85°	43	22	19	19	19	49
90°	1	9	25	24	24	5
95°	37	44	46	46	44	41
105°	154	156	157	158	158	162
115°	286	290	288	288	286	283
125°	416	422	420	418	417	371
135°	537	545	547	546	544	415
145°	652	658	662	662	660	408
155°	746	748	750	754	752	343
165°	812	811	811	816	812	229
175°	844	842	841	846	842	80
180°	846	846	846	846	846	

TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1105.6	1105.6	1105.6	1105.6	1105.6
2.5°	1110.6	1105.6	1094.6	1104.7	1102.7
5°	1105.6	1100.6	1087.6	1096.6	1093.6
7.5°	1096.6	1090.7	1076.7	1080.6	1075.6
10°	1084.6	1077.6	1057.7	1054.5	1048.7
12.5°	1069.6	1060.6	1033.6	1027.6	1016.5
15°	1051.6	1040.5	1006.6	987.6	977.6
17.5°	1030.5	1014.6	972.5	950.6	934.5
20°	1006.6	986.5	936.5	911.6	889.5
22.5°	980.6	957.5	899.5	865.5	850.5
25°	954.6	922.5	856.5	815.5	800.4
27.5°	923.5	889.5	816.5	769.5	746.4
30°	890.6	852.5	772.4	721.5	694.4
32.5°	858.4	812.4	730.5	670.4	645.3
35°	822.5	771.4	683.4	620.4	598.3
37.5°	787.5	732.4	639.4	570.2	545.4
40°	750.5	690.5	593.3	522.3	496.3
42.5°	712.4	648.5	547.3	473.2	448.3
45°	672.4	605.3	500.3	429.2	405.2
47.5°	634.4	563.4	455.3	384.1	362.2
50°	592.4	521.3	411.3	342.1	321.2
52.5°	551.3	476.3	369.3	303.2	284.2
55°	511.2	433.2	325.1	265.2	246.2
57.5°	470.3	390.2	286.2	230.2	214.1
60°	428.2	348.2	245.1	194.1	178.2
62.5°	387.3	307.2	210.1	162.1	154.2
65°	345.2	264.1	174.1	140.1	137.1
67.5°	305.2	224.1	140.1	123.1	120.0
70°	263.1	185.1	116.0	106.0	102.0
72.5°	223.1	149.0	97.0	89.1	87.0
75°	184.0	114.0	80.1	73.0	72.1
77.5°	145.1	81.0	63.0	59.0	57.0
80°	109.1	58.1	48.0	44.1	44.1
82.5°	76.0	39.1	33.0	31.0	31.0
85°	43.0	21.9	19.0	19.0	19.0
87.5°	16.1	7.9	7.9	7.0	7.0
90°	0.8	9.2	25.0	23.5	24.3
92.5°	15.8	21.4	22.2	22.9	22.9
95°	37.3	44.4	45.7	45.7	44.4
97.5°	62.0	68.6	71.4	71.4	71.4
100°	90.5	96.4	98.4	98.4	97.7
102.5°	120.6	125.0	127.8	128.6	127.8
105°	153.6	155.6	157.1	158.4	158.4
107.5°	186.2	189.2	189.2	189.8	186.2
110°	217.8	221.9	221.9	221.9	219.9



TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	252.0	256.4	255.6	253.5	252.0
115°	285.7	289.7	288.5	287.8	285.7
117.5°	319.1	324.7	321.1	319.1	317.0
120°	352.8	358.4	352.8	352.8	350.4
122.5°	383.3	390.5	386.9	384.9	383.3
125°	415.5	421.9	419.8	417.5	416.8
127.5°	446.8	454.8	452.0	448.9	446.8
130°	476.2	485.4	484.1	482.6	479.7
132.5°	509.1	516.2	516.7	513.2	511.1
135°	537.4	545.3	546.9	546.1	544.0
137.5°	569.0	575.4	576.7	576.2	573.1
140°	596.8	603.2	606.8	606.8	604.0
142.5°	625.4	631.8	633.8	634.6	631.8
145°	652.5	657.5	661.6	662.4	659.6
147.5°	676.7	683.1	686.1	687.4	684.6
150°	701.7	706.1	708.8	711.1	708.8
152.5°	723.9	728.2	731.7	734.6	731.7
155°	746.1	748.1	750.4	753.9	751.7
157.5°	765.2	766.7	768.0	773.1	769.5
160°	782.3	783.8	784.6	788.9	785.9
162.5°	798.1	798.1	798.9	803.7	800.1
165°	811.6	810.8	810.8	815.9	812.3
167.5°	823.9	821.5	821.5	826.6	823.0
170°	833.0	831.0	830.3	835.4	831.0
172.5°	839.4	837.4	836.6	841.7	837.4
175°	844.5	842.5	841.0	846.1	841.7
177.5°	847.3	845.3	843.7	848.1	843.7
180°	846.1	846.1	846.1	846.1	846.1

TEST NUMBER: P923382

CATALOG NUMBER: DFN2DIP-TR2F0-030D030US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.06	10.89	11.03	11.87	13.15	6.05	6.87	7.02	7.85	9.14
	3H	11.72	12.45	12.70	13.44	14.75	7.22	7.95	8.20	8.94	10.25
	4H	12.31	13.00	13.30	14.00	15.31	7.66	8.35	8.65	9.35	10.66
	6H	12.71	13.35	13.72	14.35	15.68	7.96	8.60	8.97	9.60	10.93
	8H	12.83	13.43	13.84	14.45	15.78	8.05	8.65	9.06	9.67	11.00
	12H	12.88	13.46	13.89	14.46	15.82	8.08	8.66	9.10	9.67	11.02
4H	2H	10.08	10.77	11.08	11.77	13.08	6.63	7.32	7.63	8.32	9.63
	3H	11.88	12.46	12.89	13.48	14.81	7.96	8.53	8.97	9.56	10.89
	4H	12.55	13.08	13.57	14.09	15.45	8.49	9.02	9.51	10.03	11.39
	6H	13.04	13.50	14.07	14.54	15.89	8.89	9.35	9.92	10.39	11.74
	8H	13.21	13.63	14.24	14.66	16.03	9.01	9.44	10.04	10.47	11.83
	12H	13.29	13.67	14.34	14.72	16.09	9.07	9.45	10.12	10.50	11.87
8H	4H	12.51	12.94	13.54	13.97	15.34	8.76	9.18	9.79	10.21	11.58
	6H	13.05	13.40	14.11	14.48	15.84	9.25	9.60	10.31	10.68	12.04
	8H	13.26	13.56	14.32	14.62	16.00	9.43	9.74	10.49	10.80	12.18
	12H	13.38	13.65	14.44	14.70	16.13	9.54	9.81	10.60	10.86	12.29
12H	4H	12.46	12.85	13.51	13.89	15.26	8.76	9.14	9.81	10.19	11.56
	6H	13.03	13.34	14.09	14.39	15.78	9.30	9.60	10.36	10.66	12.05
	8H	13.23	13.50	14.30	14.56	15.98	9.49	9.76	10.56	10.82	12.24

END OF REPORT