

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923424

Luminaire Tested: DFN2DIP-TR2F0-050D040US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923424
REPORT IS A COMBINATION OF REPORTS P900247 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D040US940-FLLFLL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7570.7 lumens
Efficiency: N/A
Efficacy: 98.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

Luminous Intensity Polar Plot

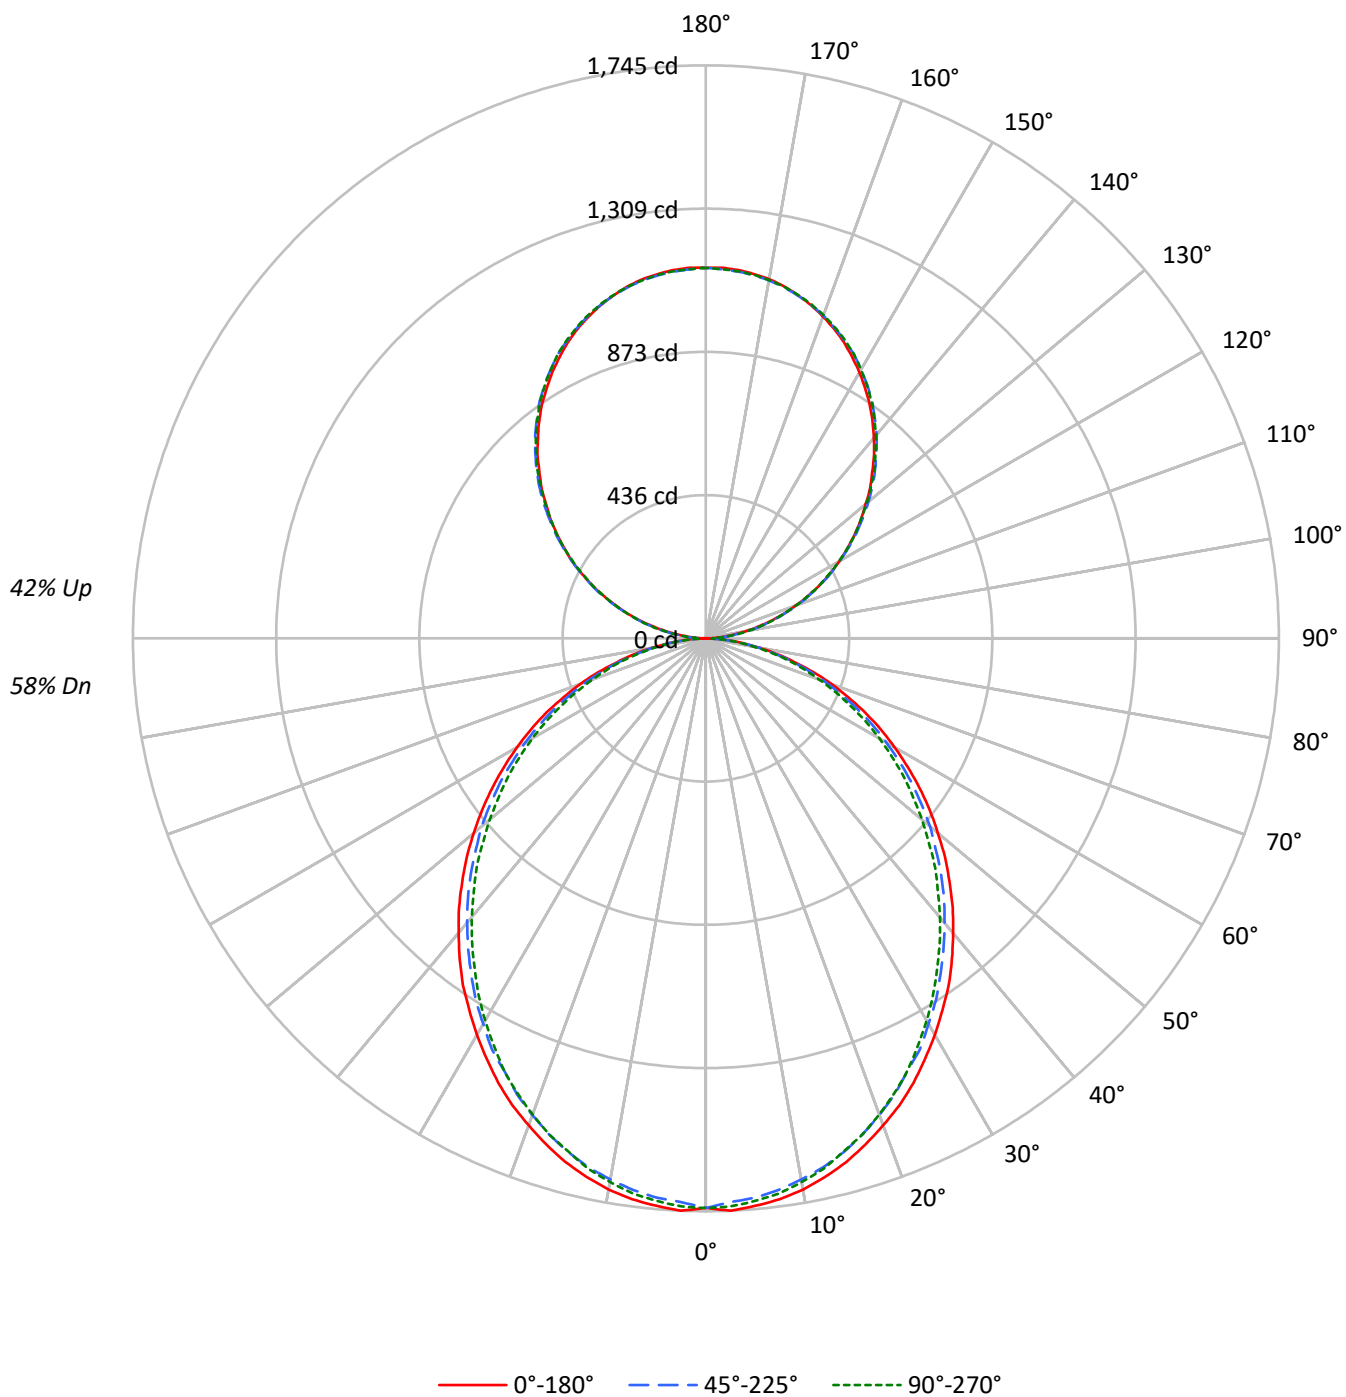

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3869	3869	3869
5°	3870	3807	3835
10°	3833	3747	3776
15°	3770	3677	3688
20°	3689	3583	3599
25°	3607	3471	3496
30°	3506	3368	3368
35°	3410	3246	3232
40°	3293	3124	3103
45°	3176	3000	2970
50°	3047	2870	2817
55°	2912	2720	2674
60°	2759	2544	2511
65°	2591	2359	2319
70°	2378	2134	2110
75°	2085	1865	1909
80°	1729	1521	1543
85°	1178	959	959

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3176 cd/sqm

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	2.2
10°-20°	459.4	6.1
20°-30°	675.2	8.9
30°-40°	784.2	10.4
40°-50°	783.2	10.3
50°-60°	682.9	9.0
60°-70°	504.8	6.7
70°-80°	285.6	3.8
80°-90°	78.6	1.0
90°-100°	69.8	0.9
100°-110°	221.8	2.9
110°-120°	379.5	5.0
120°-130°	499.2	6.6
130°-140°	560.3	7.4
140°-150°	549.4	7.3
150°-160°	460.9	6.1
160°-170°	305.7	4.0
170°-180°	106.8	1.4
0°-30°	1297.9	17.1
0°-40°	2082.0	27.5
0°-60°	3548.1	46.9
0°-90°	4417.2	58.3
90°-120°	671.2	8.9
90°-150°	2280.1	30.1
90°-180°	3153.0	41.6
0°-180°	7570.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	1	12	33	31	32	7
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P923424

CATALOG NUMBER: DFN2DIP-TR2F0-050D040US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.58	13.52	13.46	14.42	15.57	12.16	13.10	13.04	14.00	15.15
	3H	14.22	15.07	15.12	15.98	17.15	13.76	14.61	14.66	15.52	16.69
	4H	14.80	15.60	15.71	16.52	17.70	14.34	15.14	15.25	16.06	17.24
	6H	15.18	15.92	16.11	16.85	18.04	14.72	15.46	15.65	16.38	17.58
	8H	15.28	15.98	16.21	16.93	18.12	14.82	15.53	15.75	16.47	17.66
	12H	15.32	15.99	16.26	16.93	18.15	14.86	15.53	15.80	16.46	17.68
4H	2H	13.04	13.84	13.96	14.76	15.94	12.70	13.50	13.62	14.42	15.60
	3H	14.89	15.56	15.81	16.50	17.70	14.50	15.17	15.43	16.12	17.32
	4H	15.59	16.20	16.52	17.14	18.36	15.19	15.80	16.13	16.74	17.97
	6H	16.08	16.61	17.03	17.58	18.80	15.69	16.21	16.64	17.18	18.40
	8H	16.22	16.72	17.18	17.68	18.91	15.83	16.32	16.78	17.28	18.52
	12H	16.29	16.73	17.26	17.71	18.95	15.89	16.33	16.86	17.31	18.55
8H	4H	15.78	16.27	16.73	17.23	18.47	15.43	15.92	16.38	16.88	18.12
	6H	16.39	16.79	17.36	17.80	19.03	16.03	16.44	17.01	17.44	18.68
	8H	16.59	16.95	17.58	17.94	19.20	16.24	16.60	17.22	17.59	18.84
	12H	16.71	17.03	17.70	18.01	19.31	16.34	16.66	17.33	17.64	18.94
12H	4H	15.77	16.21	16.74	17.19	18.43	15.42	15.87	16.39	16.84	18.09
	6H	16.41	16.77	17.40	17.76	19.02	16.07	16.43	17.06	17.42	18.68
	8H	16.64	16.96	17.63	17.94	19.24	16.30	16.61	17.29	17.60	18.90

END OF REPORT