

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923429

Luminaire Tested: DFN2DIP-TR2F0-050D050US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923429
REPORT IS A COMBINATION OF REPORTS P901777 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D050US940-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8359.8 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLLONL

Luminous Intensity Polar Plot

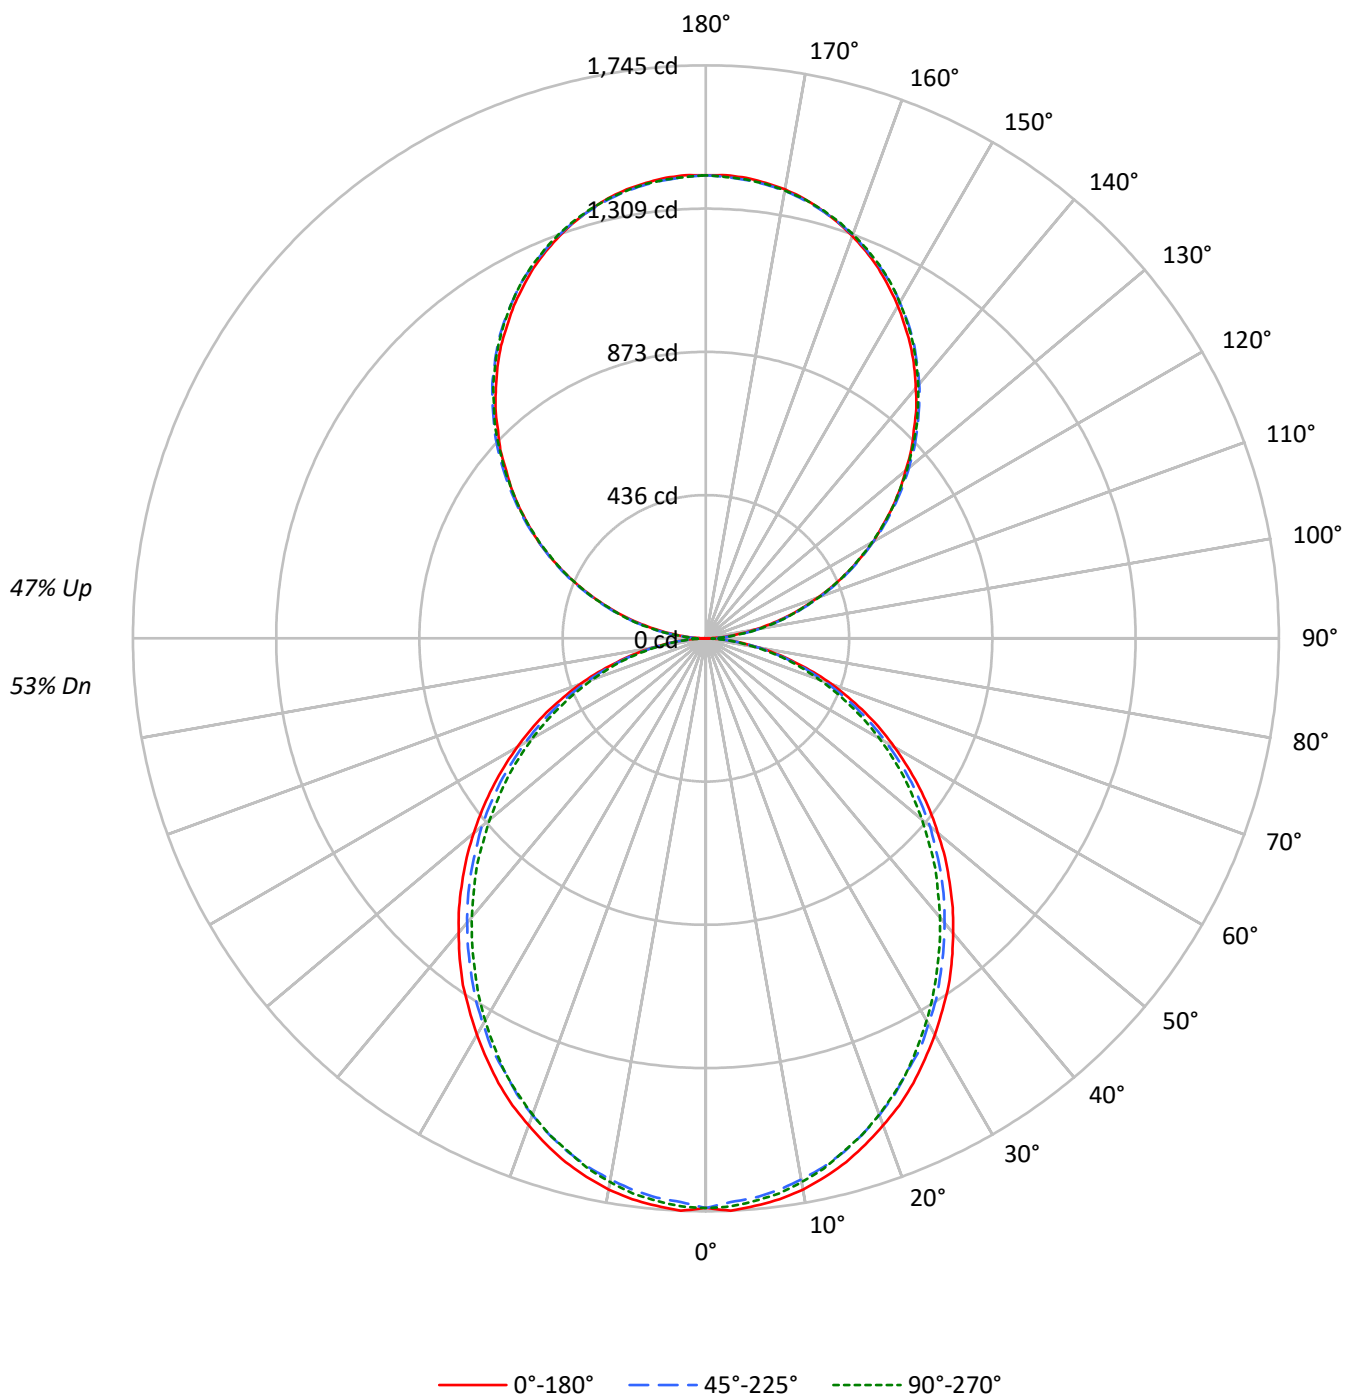

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3869	3869	3869
5°	3870	3807	3835
10°	3833	3747	3776
15°	3770	3677	3688
20°	3689	3583	3599
25°	3607	3471	3496
30°	3506	3368	3368
35°	3410	3246	3232
40°	3293	3124	3103
45°	3176	3000	2970
50°	3047	2870	2817
55°	2912	2720	2674
60°	2759	2544	2511
65°	2591	2359	2319
70°	2378	2134	2110
75°	2085	1865	1909
80°	1729	1521	1543
85°	1178	959	959

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3176 cd/sqm

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	2.0
10°-20°	459.4	5.5
20°-30°	675.2	8.1
30°-40°	784.2	9.4
40°-50°	783.2	9.4
50°-60°	682.9	8.2
60°-70°	504.8	6.0
70°-80°	285.6	3.4
80°-90°	79.4	0.9
90°-100°	87.3	1.0
100°-110°	277.2	3.3
110°-120°	474.5	5.7
120°-130°	624.0	7.5
130°-140°	700.4	8.4
140°-150°	686.8	8.2
150°-160°	576.1	6.9
160°-170°	382.1	4.6
170°-180°	133.5	1.6
0°-30°	1297.9	15.5
0°-40°	2082.0	24.9
0°-60°	3548.1	42.4
0°-90°	4418.0	52.8
90°-120°	838.9	10.0
90°-150°	2850.1	34.1
90°-180°	3942.0	47.2
0°-180°	8359.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	1	15	42	39	40	8
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1

TEST NUMBER: P923429

CATALOG NUMBER: DFN2DIP-TR2F0-050D050US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.10	12.99	13.04	13.94	15.17	11.68	12.57	12.61	13.52	14.75
	3H	13.74	14.54	14.69	15.50	16.75	13.28	14.08	14.22	15.04	16.29
	4H	14.32	15.07	15.27	16.03	17.29	13.85	14.61	14.81	15.57	16.83
	6H	14.70	15.39	15.67	16.36	17.64	14.24	14.93	15.21	15.90	17.18
	8H	14.79	15.46	15.77	16.44	17.71	14.34	15.00	15.31	15.98	17.25
	12H	14.83	15.46	15.82	16.44	17.74	14.37	15.00	15.35	15.98	17.28
4H	2H	12.56	13.31	13.52	14.28	15.54	12.22	12.97	13.18	13.94	15.20
	3H	14.40	15.03	15.37	16.02	17.30	14.02	14.64	14.99	15.64	16.91
	4H	15.10	15.67	16.08	16.66	17.96	14.70	15.28	15.68	16.26	17.56
	6H	15.59	16.09	16.59	17.10	18.39	15.19	15.69	16.19	16.70	18.00
	8H	15.73	16.19	16.73	17.20	18.51	15.33	15.79	16.33	16.80	18.11
	12H	15.79	16.21	16.81	17.23	18.55	15.39	15.81	16.40	16.82	18.14
8H	4H	15.28	15.75	16.28	16.75	18.06	14.93	15.40	15.93	16.40	17.71
	6H	15.89	16.27	16.91	17.32	18.63	15.54	15.92	16.56	16.97	18.28
	8H	16.09	16.43	17.12	17.46	18.79	15.74	16.08	16.77	17.11	18.44
	12H	16.21	16.51	17.24	17.54	18.91	15.84	16.14	16.88	17.17	18.54
12H	4H	15.27	15.69	16.28	16.71	18.03	14.92	15.34	15.94	16.36	17.68
	6H	15.91	16.25	16.94	17.28	18.61	15.57	15.91	16.60	16.94	18.27
	8H	16.14	16.44	17.17	17.46	18.84	15.79	16.09	16.83	17.12	18.49