

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923445

Luminaire Tested: DFN2DIP-TR2F0-060D040US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923445
REPORT IS A COMBINATION OF REPORTS P901769 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-060D040US940-FLLONL
Description: 2 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8453.4 lumens
Efficiency: N/A
Efficacy: 95.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLLONL

Luminous Intensity Polar Plot

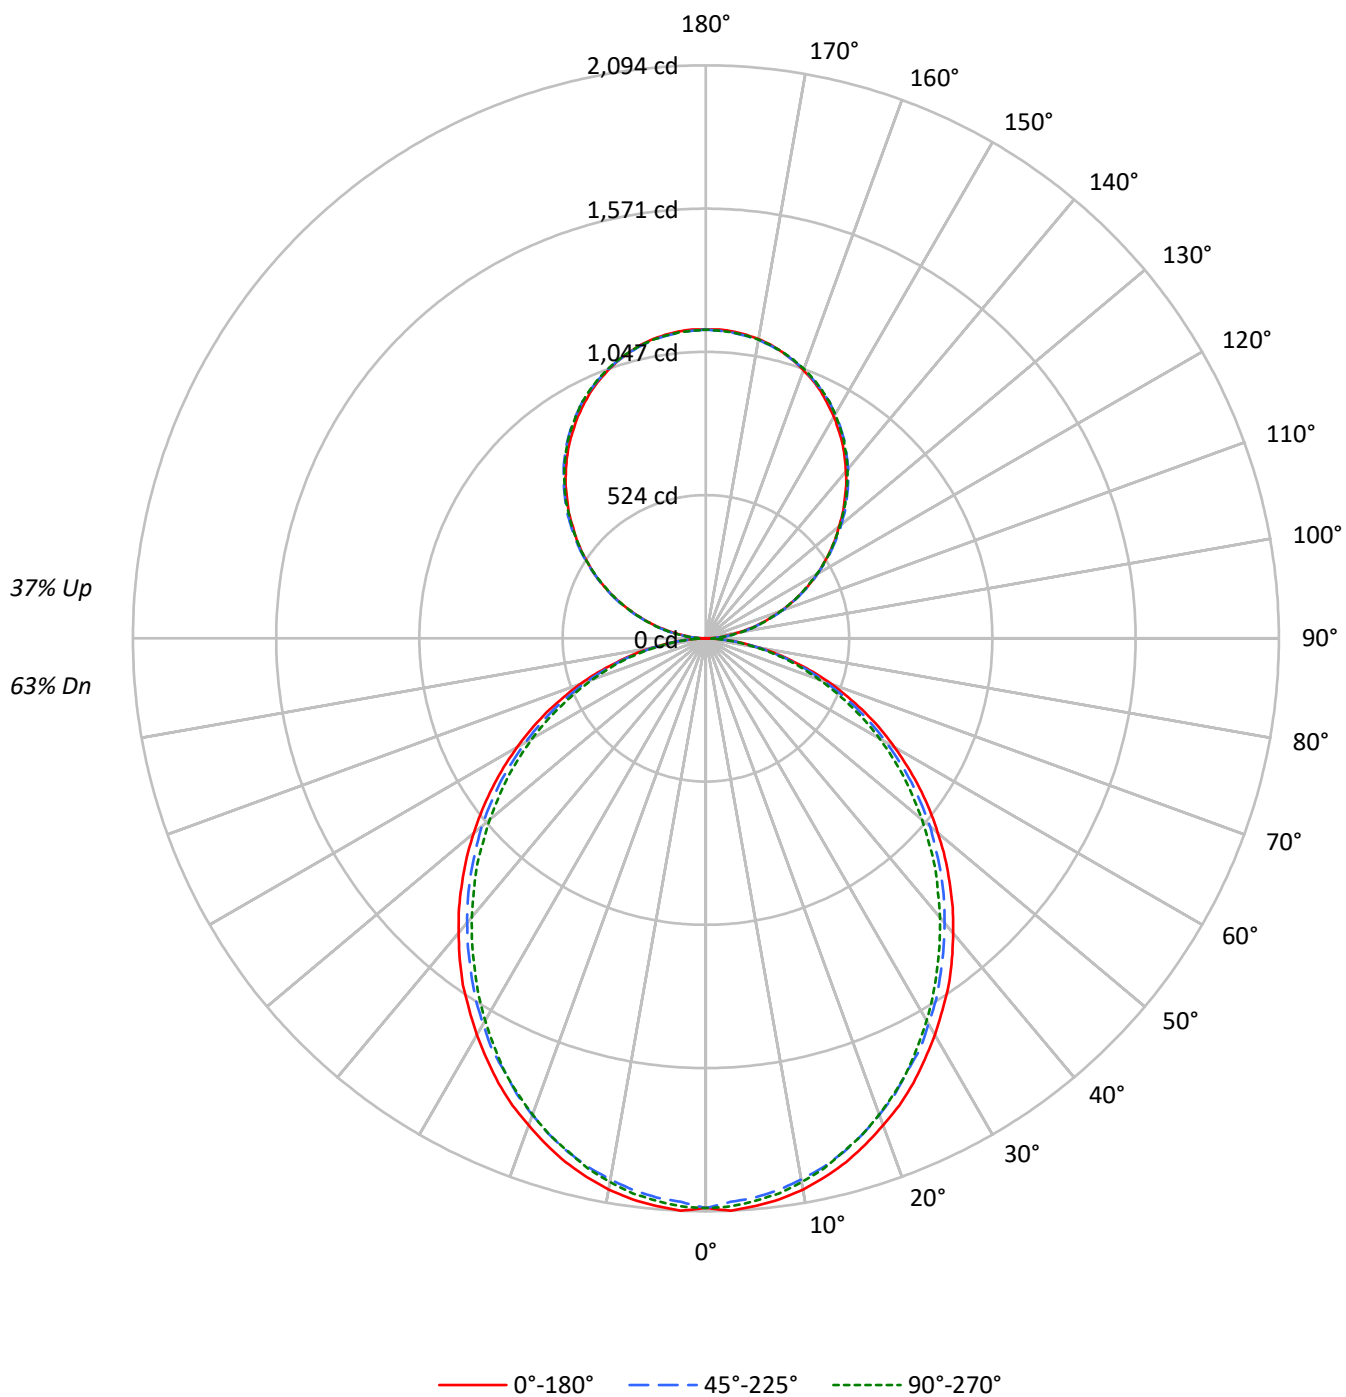

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4643	4643	4643
5°	4644	4568	4601
10°	4599	4496	4531
15°	4525	4412	4426
20°	4426	4299	4318
25°	4329	4166	4196
30°	4208	4041	4041
35°	4092	3896	3879
40°	3951	3749	3723
45°	3811	3600	3564
50°	3657	3444	3380
55°	3494	3265	3209
60°	3311	3053	3013
65°	3109	2831	2783
70°	2854	2561	2532
75°	2502	2238	2290
80°	2074	1825	1851
85°	1412	1150	1151

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3811 cd/sqm

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	2.3
10°-20°	551.3	6.5
20°-30°	810.2	9.6
30°-40°	941.0	11.1
40°-50°	939.8	11.1
50°-60°	819.5	9.7
60°-70°	605.8	7.2
70°-80°	342.7	4.1
80°-90°	93.7	1.1
90°-100°	69.8	0.8
100°-110°	221.8	2.6
110°-120°	379.5	4.5
120°-130°	499.2	5.9
130°-140°	560.3	6.6
140°-150°	549.4	6.5
150°-160°	460.9	5.5
160°-170°	305.7	3.6
170°-180°	106.8	1.3
0°-30°	1557.4	18.4
0°-40°	2498.4	29.6
0°-60°	4257.8	50.4
0°-90°	5300.0	62.7
90°-120°	671.2	7.9
90°-150°	2280.1	27.0
90°-180°	3153.0	37.3
0°-180°	8453.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	1	12	33	31	32	8
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P923445

CATALOG NUMBER: DFN2DIP-TR2F0-060D040US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.57	14.56	14.41	15.42	16.50	13.15	14.14	13.99	15.00	16.08
	3H	15.22	16.11	16.07	16.98	18.08	14.76	15.65	15.61	16.52	17.62
	4H	15.80	16.64	16.67	17.51	18.63	15.34	16.18	16.21	17.05	18.17
	6H	16.18	16.96	17.07	17.84	18.97	15.72	16.50	16.61	17.38	18.51
	8H	16.28	17.02	17.17	17.92	19.05	15.83	16.56	16.71	17.47	18.59
	12H	16.33	17.03	17.22	17.93	19.08	15.86	16.57	16.76	17.46	18.62
4H	2H	14.04	14.88	14.91	15.76	16.87	13.70	14.54	14.57	15.42	16.53
	3H	15.89	16.59	16.78	17.50	18.63	15.51	16.21	16.39	17.12	18.25
	4H	16.59	17.23	17.49	18.14	19.29	16.20	16.83	17.09	17.74	18.90
	6H	17.09	17.64	18.00	18.57	19.73	16.69	17.25	17.61	18.18	19.34
	8H	17.23	17.75	18.15	18.67	19.84	16.83	17.35	17.75	18.28	19.45
	12H	17.30	17.77	18.23	18.71	19.89	16.90	17.36	17.83	18.30	19.48
8H	4H	16.79	17.30	17.70	18.23	19.40	16.44	16.95	17.35	17.88	19.05
	6H	17.40	17.82	18.34	18.79	19.96	17.04	17.47	17.99	18.44	19.61
	8H	17.60	17.98	18.55	18.94	20.13	17.25	17.62	18.20	18.58	19.77
	12H	17.72	18.06	18.68	19.01	20.25	17.36	17.69	18.31	18.64	19.88
12H	4H	16.78	17.24	17.71	18.18	19.36	16.43	16.90	17.37	17.84	19.02
	6H	17.42	17.80	18.37	18.76	19.95	17.08	17.46	18.03	18.42	19.61
	8H	17.65	17.99	18.61	18.94	20.17	17.31	17.64	18.26	18.59	19.83

END OF REPORT