

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926127

Luminaire Tested: DFN2DIP-TR2F0-040D020US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926127
REPORT IS A COMBINATION OF REPORTS P901746 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-040D020US950-RLLONL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4932.2 lumens
Efficiency: N/A
Efficacy: 96.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 51.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLLONL

Luminous Intensity Polar Plot

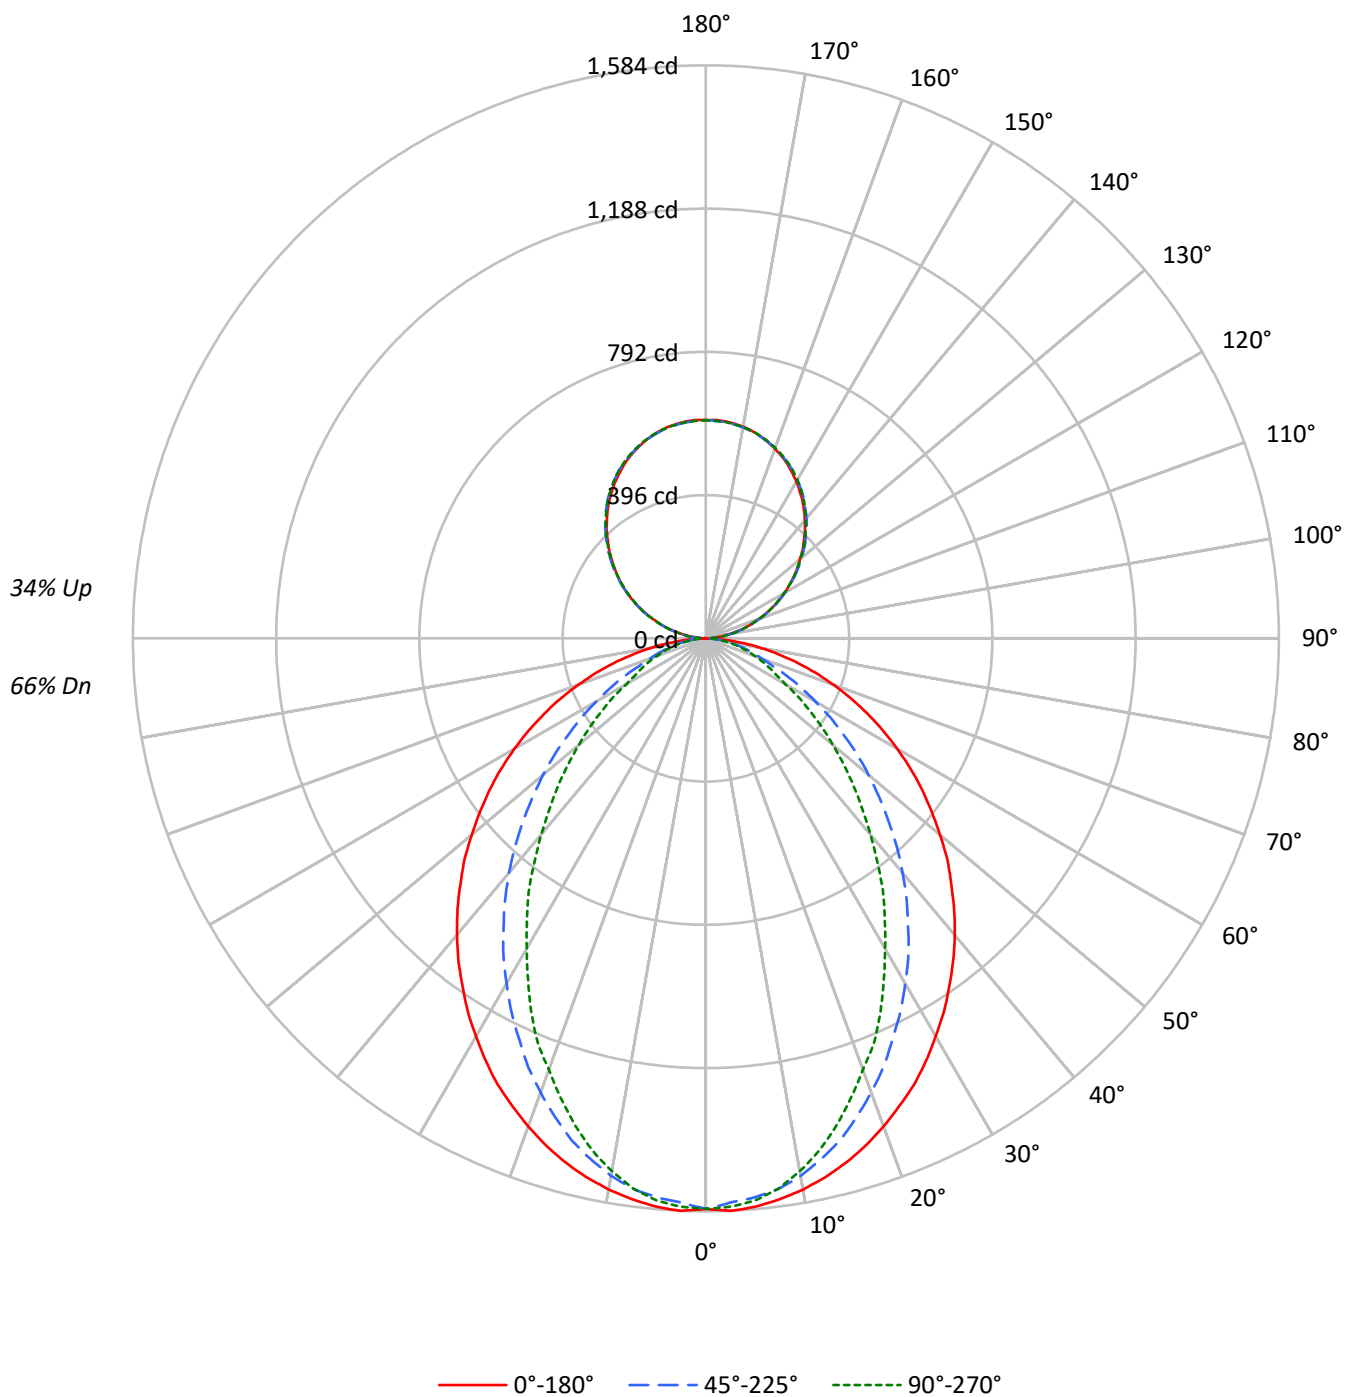

TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3518	3518	3518
5°	3518	3454	3478
10°	3478	3379	3359
15°	3425	3259	3179
20°	3356	3098	2959
25°	3286	2919	2747
30°	3194	2736	2481
35°	3103	2540	2247
40°	3010	2338	1980
45°	2903	2115	1738
50°	2791	1890	1502
55°	2674	1651	1277
60°	2538	1403	1045
65°	2383	1151	934
70°	2193	917	836
75°	1953	793	749
80°	1610	643	632
85°	1057	399	445

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2903 cd/sqm

TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.8	3.0
10°-20°	405.8	8.2
20°-30°	569.7	11.6
30°-40°	621.0	12.6
40°-50°	570.8	11.6
50°-60°	448.2	9.1
60°-70°	291.8	5.9
70°-80°	150.2	3.0
80°-90°	40.1	0.8
90°-100°	37.3	0.8
100°-110°	118.7	2.4
110°-120°	203.0	4.1
120°-130°	267.0	5.4
130°-140°	299.7	6.1
140°-150°	293.9	6.0
150°-160°	246.5	5.0
160°-170°	163.5	3.3
170°-180°	57.1	1.2
0°-30°	1123.3	22.8
0°-40°	1744.3	35.4
0°-60°	2763.3	56.0
0°-90°	3245.3	65.8
90°-120°	359.0	7.3
90°-150°	1219.7	24.7
90°-180°	1687.0	34.2
0°-180°	4932.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1577	1577	1577	1577	1577	
5°	1577	1570	1551	1564	1560	150
15°	1500	1484	1436	1409	1395	423
25°	1362	1316	1222	1163	1142	626
35°	1173	1100	975	885	853	734
45°	959	864	714	612	578	741
55°	729	618	464	378	351	652
65°	492	377	248	200	196	488
75°	262	163	114	104	103	278
85°	61	31	27	27	27	70
90°	1	7	18	17	17	5
95°	26	32	32	32	32	30
105°	110	111	112	113	113	116
115°	204	207	206	205	204	202
125°	296	301	300	298	297	265
135°	383	389	390	390	388	296
145°	465	469	472	472	470	291
155°	532	534	535	538	536	245
165°	579	578	578	582	580	163
175°	602	601	600	603	600	57
180°	603	603	603	603	603	

TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1577.2	1577.2	1577.2	1577.2	1577.2
2.5°	1584.3	1577.2	1561.4	1575.8	1572.9
5°	1577.2	1570.0	1551.4	1564.3	1560.1
7.5°	1564.3	1555.8	1535.8	1541.4	1534.3
10°	1547.2	1537.2	1508.7	1504.3	1495.9
12.5°	1525.8	1512.9	1474.3	1465.8	1450.1
15°	1500.1	1484.3	1435.9	1408.8	1394.6
17.5°	1470.1	1447.2	1387.2	1355.9	1333.0
20°	1435.9	1407.2	1335.9	1300.3	1268.8
22.5°	1398.8	1365.9	1283.0	1234.6	1213.3
25°	1361.6	1315.9	1221.7	1163.3	1141.7
27.5°	1317.5	1268.8	1164.6	1097.6	1064.7
30°	1270.3	1216.0	1101.8	1029.1	990.5
32.5°	1224.6	1158.9	1042.0	956.3	920.5
35°	1173.3	1100.4	974.9	884.9	853.4
37.5°	1123.3	1044.7	912.0	813.5	777.9
40°	1070.5	984.9	846.4	745.1	708.0
42.5°	1016.2	924.9	780.8	675.1	639.5
45°	959.2	863.5	713.7	612.3	578.0
47.5°	905.0	803.6	649.5	548.1	516.7
50°	845.0	743.6	586.6	488.1	458.2
52.5°	786.4	679.3	526.7	432.4	405.4
55°	729.3	618.0	463.8	378.3	351.2
57.5°	670.9	556.7	408.2	328.3	305.5
60°	610.8	496.7	349.6	276.9	254.1
62.5°	552.5	438.3	299.7	231.2	219.9
65°	492.5	376.7	248.3	199.9	195.5
67.5°	435.4	319.7	199.9	175.5	171.2
70°	375.4	264.1	165.5	151.3	145.5
72.5°	318.3	212.6	138.4	127.1	124.2
75°	262.5	162.7	114.2	104.2	102.8
77.5°	207.0	115.5	90.0	84.2	81.3
80°	155.5	82.8	68.4	62.9	62.9
82.5°	108.5	55.7	47.1	44.2	44.2
85°	61.3	31.4	27.1	27.1	27.1
87.5°	22.9	11.4	11.4	10.0	10.0
90°	0.6	6.6	17.8	16.7	17.3
92.5°	11.3	15.3	15.8	16.4	16.4
95°	26.5	31.7	32.5	32.5	31.7
97.5°	44.2	48.9	50.9	50.9	50.9
100°	64.6	68.8	70.2	70.2	69.6
102.5°	86.1	89.1	91.1	91.7	91.1
105°	109.5	111.0	112.1	113.0	113.0
107.5°	132.8	135.0	135.0	135.4	132.8
110°	155.4	158.3	158.3	158.3	156.8



TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	179.7	182.8	182.3	180.8	179.7
115°	203.8	206.6	205.8	205.2	203.8
117.5°	227.6	231.6	229.1	227.6	226.1
120°	251.6	255.6	251.6	251.6	249.9
122.5°	273.4	278.5	276.0	274.6	273.4
125°	296.3	300.9	299.5	297.8	297.3
127.5°	318.7	324.4	322.4	320.2	318.7
130°	339.6	346.2	345.3	344.2	342.2
132.5°	363.1	368.2	368.5	366.0	364.5
135°	383.3	388.9	390.0	389.5	388.0
137.5°	405.8	410.4	411.4	411.0	408.8
140°	425.7	430.3	432.8	432.8	430.8
142.5°	446.1	450.6	452.1	452.6	450.6
145°	465.4	469.0	471.9	472.4	470.4
147.5°	482.6	487.2	489.4	490.3	488.3
150°	500.5	503.5	505.5	507.1	505.5
152.5°	516.3	519.4	521.9	523.9	521.9
155°	532.1	533.6	535.2	537.8	536.1
157.5°	545.8	546.8	547.8	551.4	548.8
160°	558.0	559.0	559.6	562.7	560.5
162.5°	569.3	569.3	569.7	573.3	570.7
165°	578.9	578.3	578.3	581.9	579.5
167.5°	587.6	585.9	585.9	589.6	587.1
170°	594.2	592.7	592.1	595.8	592.7
172.5°	598.7	597.2	596.7	600.4	597.2
175°	602.4	600.9	599.8	603.4	600.4
177.5°	604.4	602.9	601.8	604.8	601.8
180°	603.4	603.4	603.4	603.4	603.4

TEST NUMBER: P926127

CATALOG NUMBER: DFN2DIP-TR2F0-040D020US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.75	13.73	13.57	14.56	15.59	8.73	9.71	9.55	10.54	11.57
	3H	14.41	15.29	15.24	16.13	17.19	9.91	10.79	10.74	11.63	12.69
	4H	15.01	15.84	15.86	16.69	17.76	10.36	11.19	11.21	12.04	13.10
	6H	15.42	16.18	16.28	17.04	18.12	10.68	11.44	11.53	12.29	13.38
	8H	15.54	16.27	16.41	17.14	18.22	10.76	11.49	11.63	12.36	13.44
	12H	15.60	16.29	16.47	17.16	18.26	10.80	11.49	11.68	12.36	13.47
4H	2H	12.78	13.61	13.63	14.46	15.53	9.33	10.16	10.18	11.01	12.07
	3H	14.60	15.28	15.46	16.17	17.25	10.68	11.36	11.54	12.24	13.33
	4H	15.28	15.90	16.15	16.78	17.89	11.22	11.84	12.09	12.72	13.83
	6H	15.78	16.31	16.67	17.22	18.33	11.63	12.16	12.52	13.07	14.18
	8H	15.94	16.44	16.83	17.34	18.47	11.75	12.25	12.64	13.15	14.28
	12H	16.03	16.48	16.94	17.40	18.53	11.81	12.26	12.72	13.18	14.31
8H	4H	15.25	15.75	16.14	16.65	17.78	11.49	11.99	12.39	12.89	14.02
	6H	15.80	16.21	16.72	17.15	18.28	12.00	12.41	12.91	13.35	14.48
	8H	16.00	16.37	16.93	17.30	18.44	12.17	12.54	13.10	13.47	14.62
	12H	16.13	16.45	17.06	17.38	18.57	12.29	12.61	13.22	13.53	14.73
12H	4H	15.21	15.66	16.12	16.58	17.71	11.50	11.95	12.41	12.87	14.00
	6H	15.77	16.14	16.70	17.07	18.22	12.04	12.41	12.97	13.34	14.48
	8H	15.98	16.31	16.91	17.23	18.43	12.24	12.56	13.17	13.49	14.68

END OF REPORT