

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926146

Luminaire Tested: DFN2DIP-TR2F0-050D020US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926146
REPORT IS A COMBINATION OF REPORTS P900228 AND P897145
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR2F0-050D020US950-RLLFLL
Description: 2 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5743.1 lumens
Efficiency: N/A
Efficacy: 91.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.04' x L: 2.36' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 62.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

Luminous Intensity Polar Plot

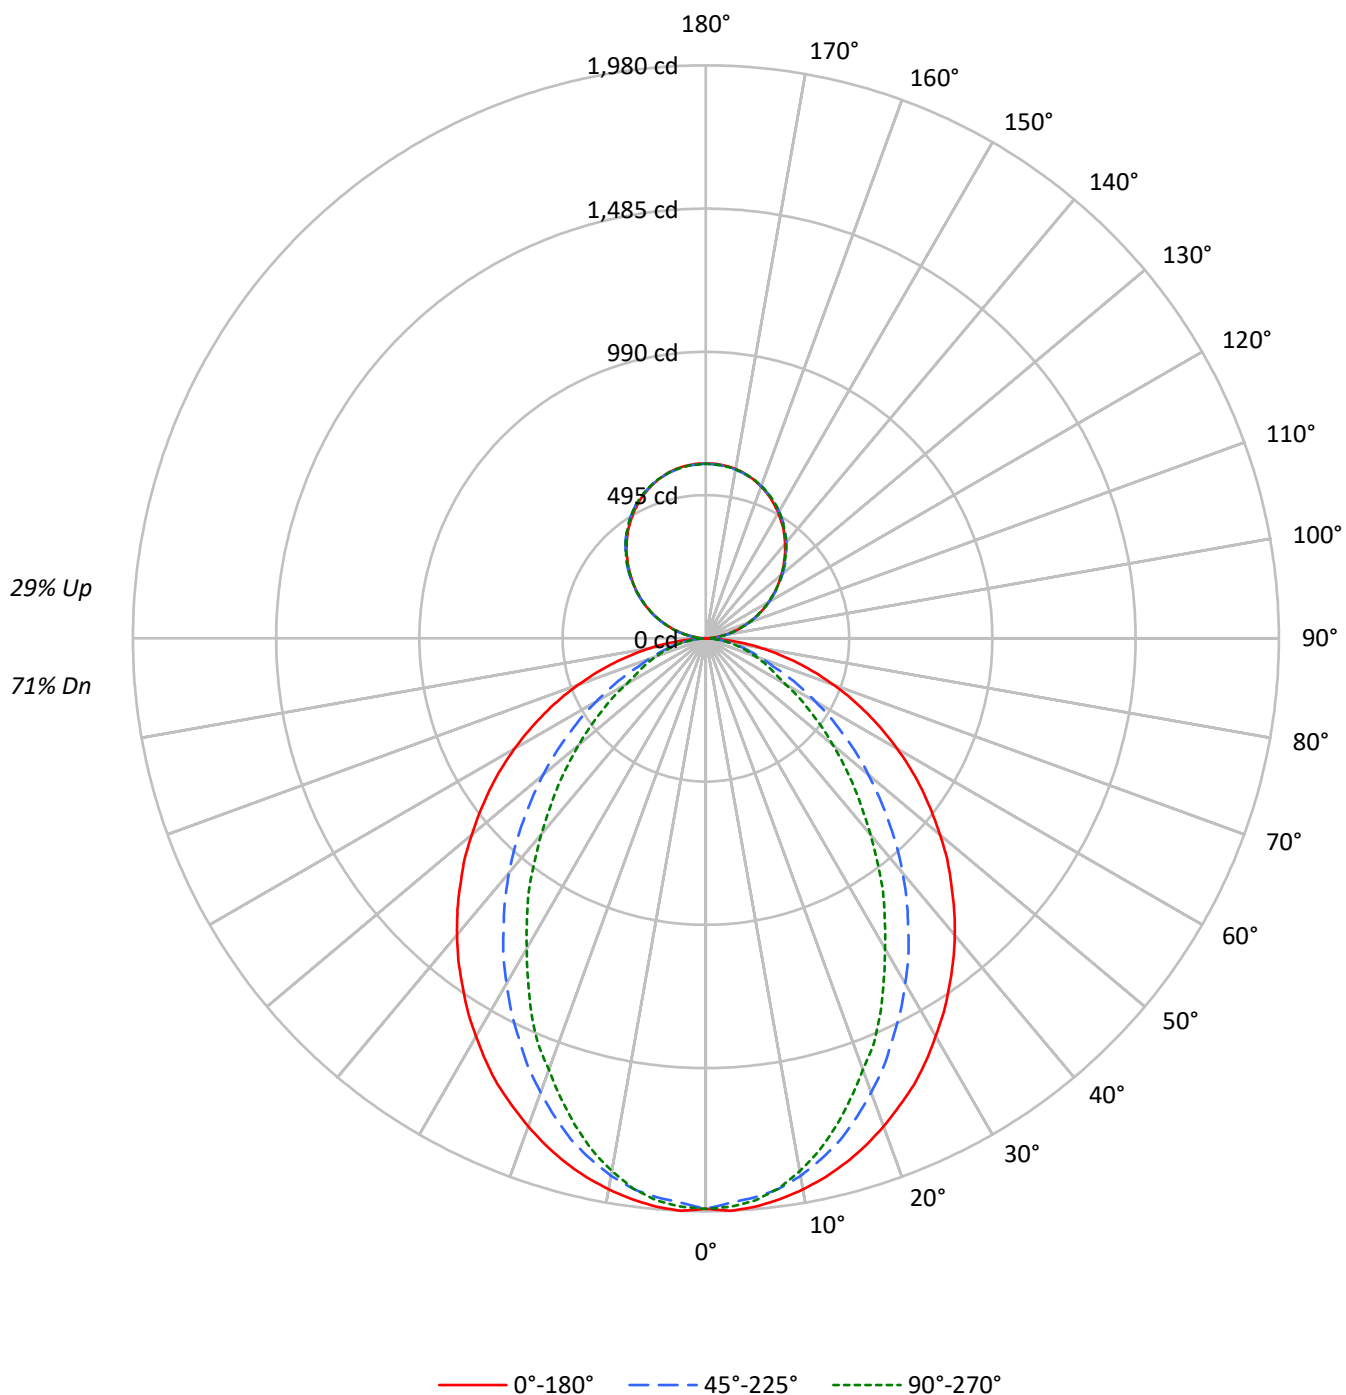

TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95		85	85	85		75
1	103	99	95	92	97	94	90	88	84	82	79		76	74	72		67
2	94	87	81	76	89	83	78	73	75	71	67		67	64	61		60
3	87	77	70	64	82	74	67	62	67	61	57		60	56	53		54
4	80	69	61	55	75	66	59	53	60	54	49		54	49	46		49
5	74	62	54	48	69	59	52	46	54	48	43		49	44	40		44
6	68	56	48	42	64	54	46	41	49	43	38		44	39	36		40
7	63	51	43	37	60	49	41	36	45	38	34		41	36	32		37
8	59	47	39	33	56	45	37	32	41	35	31		37	32	29		34
9	55	43	35	30	52	41	34	29	38	32	28		35	30	26		32
10	52	39	32	27	49	38	31	27	35	29	25		32	27	24		30

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4397	4397	4397
5°	4398	4318	4348
10°	4347	4223	4198
15°	4281	4074	3973
20°	4196	3873	3699
25°	4108	3649	3434
30°	3992	3420	3101
35°	3878	3175	2809
40°	3762	2922	2475
45°	3628	2643	2173
50°	3489	2363	1878
55°	3343	2064	1595
60°	3173	1753	1306
65°	2978	1439	1167
70°	2741	1146	1046
75°	2443	991	936
80°	2013	805	789
85°	1323	499	556

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3628 cd/sqm

TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	3.2
10°-20°	507.2	8.8
20°-30°	712.1	12.4
30°-40°	776.3	13.5
40°-50°	713.5	12.4
50°-60°	560.3	9.8
60°-70°	364.7	6.4
70°-80°	187.7	3.3
80°-90°	49.6	0.9
90°-100°	37.3	0.6
100°-110°	118.7	2.1
110°-120°	203.0	3.5
120°-130°	267.0	4.6
130°-140°	299.7	5.2
140°-150°	293.9	5.1
150°-160°	246.5	4.3
160°-170°	163.5	2.8
170°-180°	57.1	1.0
0°-30°	1404.1	24.4
0°-40°	2180.4	38.0
0°-60°	3454.1	60.1
0°-90°	4056.2	70.6
90°-120°	359.0	6.3
90°-150°	1219.7	21.2
90°-180°	1687.0	29.4
0°-180°	5743.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	7	18	17	17	6
95°	26	32	32	32	32	30
105°	110	111	112	113	113	116
115°	204	207	206	205	204	202
125°	296	301	300	298	297	265
135°	383	389	390	390	388	296
145°	465	469	472	472	470	291
155°	532	534	535	538	536	245
165°	579	578	578	582	580	163
175°	602	601	600	603	600	57
180°	603	603	603	603	603	

TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	0.6	6.6	17.8	16.7	17.3
92.5°	11.3	15.3	15.8	16.4	16.4
95°	26.5	31.7	32.5	32.5	31.7
97.5°	44.2	48.9	50.9	50.9	50.9
100°	64.6	68.8	70.2	70.2	69.6
102.5°	86.1	89.1	91.1	91.7	91.1
105°	109.5	111.0	112.1	113.0	113.0
107.5°	132.8	135.0	135.0	135.4	132.8
110°	155.4	158.3	158.3	158.3	156.8



TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	179.7	182.8	182.3	180.8	179.7
115°	203.8	206.6	205.8	205.2	203.8
117.5°	227.6	231.6	229.1	227.6	226.1
120°	251.6	255.6	251.6	251.6	249.9
122.5°	273.4	278.5	276.0	274.6	273.4
125°	296.3	300.9	299.5	297.8	297.3
127.5°	318.7	324.4	322.4	320.2	318.7
130°	339.6	346.2	345.3	344.2	342.2
132.5°	363.1	368.2	368.5	366.0	364.5
135°	383.3	388.9	390.0	389.5	388.0
137.5°	405.8	410.4	411.4	411.0	408.8
140°	425.7	430.3	432.8	432.8	430.8
142.5°	446.1	450.6	452.1	452.6	450.6
145°	465.4	469.0	471.9	472.4	470.4
147.5°	482.6	487.2	489.4	490.3	488.3
150°	500.5	503.5	505.5	507.1	505.5
152.5°	516.3	519.4	521.9	523.9	521.9
155°	532.1	533.6	535.2	537.8	536.1
157.5°	545.8	546.8	547.8	551.4	548.8
160°	558.0	559.0	559.6	562.7	560.5
162.5°	569.3	569.3	569.7	573.3	570.7
165°	578.9	578.3	578.3	581.9	579.5
167.5°	587.6	585.9	585.9	589.6	587.1
170°	594.2	592.7	592.1	595.8	592.7
172.5°	598.7	597.2	596.7	600.4	597.2
175°	602.4	600.9	599.8	603.4	600.4
177.5°	604.4	602.9	601.8	604.8	601.8
180°	603.4	603.4	603.4	603.4	603.4

TEST NUMBER: P926146

CATALOG NUMBER: DFN2DIP-TR2F0-050D020US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.90	14.94	14.67	15.72	16.66	9.89	10.92	10.65	11.70	12.65
	3H	15.57	16.50	16.35	17.29	18.27	11.08	12.00	11.85	12.79	13.77
	4H	16.18	17.05	16.97	17.85	18.83	11.52	12.39	12.32	13.19	14.18
	6H	16.59	17.39	17.40	18.20	19.20	11.84	12.64	12.65	13.45	14.45
	8H	16.71	17.47	17.53	18.30	19.30	11.93	12.69	12.75	13.52	14.52
	12H	16.77	17.50	17.59	18.32	19.34	11.97	12.70	12.80	13.52	14.55
4H	2H	13.94	14.81	14.74	15.61	16.60	10.49	11.36	11.29	12.16	13.15
	3H	15.76	16.49	16.58	17.32	18.33	11.84	12.57	12.65	13.40	14.40
	4H	16.45	17.10	17.27	17.94	18.97	12.39	13.04	13.21	13.87	14.91
	6H	16.95	17.52	17.79	18.37	19.41	12.80	13.36	13.64	14.22	15.26
	8H	17.12	17.64	17.96	18.50	19.55	12.92	13.45	13.77	14.30	15.35
	12H	17.21	17.68	18.07	18.56	19.61	12.99	13.46	13.85	14.33	15.39
8H	4H	16.42	16.95	17.27	17.81	18.86	12.67	13.20	13.51	14.05	15.10
	6H	16.97	17.41	17.85	18.30	19.35	13.17	13.61	14.04	14.50	15.55
	8H	17.17	17.56	18.06	18.45	19.52	13.35	13.74	14.23	14.63	15.69
	12H	17.31	17.65	18.19	18.53	19.65	13.46	13.80	14.35	14.69	15.81
12H	4H	16.38	16.86	17.25	17.73	18.79	12.68	13.15	13.54	14.03	15.08
	6H	16.95	17.33	17.83	18.22	19.29	13.21	13.60	14.10	14.49	15.56
	8H	17.16	17.50	18.05	18.38	19.50	13.42	13.76	14.30	14.64	15.76

END OF REPORT